


WATER SERVICE INFORMATION					
ADDRESS	SIZE (mm) MATERIAL (STREET)	SIZE (mm) MATERIAL (PROP.)	SHORT & LONG MEASUREMENTS	CORP. LOCATION	REMARKS
327 INKSTER BLVD	20	20	0.91 EWL HSE	0.5 E OF S/C	OUTSIDE RENEWAL LIMITS
RESIDENTIAL	LEAD	LEAD	-	-	-
332 INKSTER BLVD	20	20	3.05 EWL HSE	OPP OF S/C	RECONNECT SERVICE
RESIDENTIAL	CU	CU	7.736 WWL SALTER ST	-	-
333 INKSTER BLVD	12	12	3.05 WEL HSE	0.5 E OF S/C	RENEW TO P/L W/20 CU
RESIDENTIAL	LEAD	LEAD	5.247 WWL SALTER ST	-	-
334 INKSTER BLVD	20	20	1.22 EWL HSE	OPP OF S/C	RECONNECT SERVICE
RESIDENTIAL	CU	CU	24.077 WWL SALTER ST	-	-
335 INKSTER BLVD	20	12	0.30 WEL HSE	0.9 W OF S/C	RECONNECT SERVICE
RESIDENTIAL	CU	LEAD	15.118 WWL SALTER ST	-	-
337 INKSTER BLVD	12	20	1.22 EEL HSE	0.6 W OF S/C	RENEW TO P/L W/20 CU
RESIDENTIAL	LEAD	CU	29.777 WWL SALTER ST	-	-
340 INKSTER BLVD	16	16	OPP WL HSE	0.6 E OF S/C	RENEW TO P/L W/20 CU
RESIDENTIAL	LEAD	LEAD	34.377 WWL SALTER ST	-	WYED W/342, SEPARATE SERVICES
341 INKSTER BLVD	16	12	1.73 WEL HSE	OPP OF S/C	RENEW TO P/L W/20 CU
RESIDENTIAL	LEAD	LEAD	37.124 WWL SALTER ST	-	-
342 INKSTER BLVD	16	16	OPP WL HSE #340	0.6 E OF S/C	RENEW TO P/L W/20 CU
RESIDENTIAL	LEAD	LEAD	34.377 WWL SALTER ST	-	WYED W/340, SEPARATE SERVICES
343 INKSTER BLVD	20	12	0.91 WEL HSE	OPP OF S/C	RECONNECT SERVICE
RESIDENTIAL	CU	LEAD	44.006 WWL SALTER ST	-	-
344 INKSTER BLVD	12	12	2.59 EWL HSE	1.5 W OF S/C	RENEW TO P/L W/20 CU
RESIDENTIAL	LEAD	LEAD	46.705 WWL SALTER ST	-	-
345 INKSTER BLVD	12	12	2.44 WEL HSE	1.5 W OF S/C	RENEW TO P/L W/20 CU
RESIDENTIAL	LEAD	LEAD	52.895 WWL SALTER ST	-	-
346 INKSTER BLVD	20	12	3.40 WEL HSE	0.9 W OF S/C	RECONNECT SERVICE
RESIDENTIAL	CU	LEAD	52.927 WWL SALTER ST	-	-
347 INKSTER BLVD	-	12	1.07 WML HSE	OPP OF S/C	MATERIAL TYPE TO BE CONFIRMED IN FIELD
RESIDENTIAL	-	LEAD	70.137 WWL SALTER ST	-	-
348 INKSTER BLVD	20	20	3.35 EWL HSE	0.3 W OF S/C	MATERIAL TYPE TO BE CONFIRMED IN FIELD
RESIDENTIAL	-	-	68.799 WWL SALTER ST	-	-
349 INKSTER BLVD	-	20	0.61 EEL HSE	OPP OF S/C	MATERIAL TYPE TO BE CONFIRMED IN FIELD
RESIDENTIAL	-	-	70.411 WWL SALTER ST	-	-
350 INKSTER BLVD	20	20	3.96 WEL HSE	OPP OF S/C	MATERIAL TYPE TO BE CONFIRMED IN FIELD
RESIDENTIAL	-	-	79.351 WWL SALTER ST	-	-
351 INKSTER BLVD	20	20	0.91 WEL HSE	OPP OF S/C	MATERIAL TYPE TO BE CONFIRMED IN FIELD
RESIDENTIAL	-	-	84.509 WWL SALTER ST	-	-
355 INKSTER BLVD	16	16	2.13 EWL HSE	0.3 W OF S/C	RENEW TO P/L W/20 CU
RESIDENTIAL	LEAD	LEAD	77.175 EEL POWERS ST	-	WYED W/357, SEPARATE SERVICES
360 INKSTER BLVD	20	20	2.59 EWL HSE	0.9 W OF S/C	RECONNECT SERVICE
RESIDENTIAL	CU	CU	83.345 EEL POWERS ST	-	-

\* SERVICES TO BE RENEWED TO P/L. ALL OTHERS TO BE RECONNECTED.

NOTE: CHAINAGES SHOWN ARE ALONG S. R. OF INKSTER BLVD

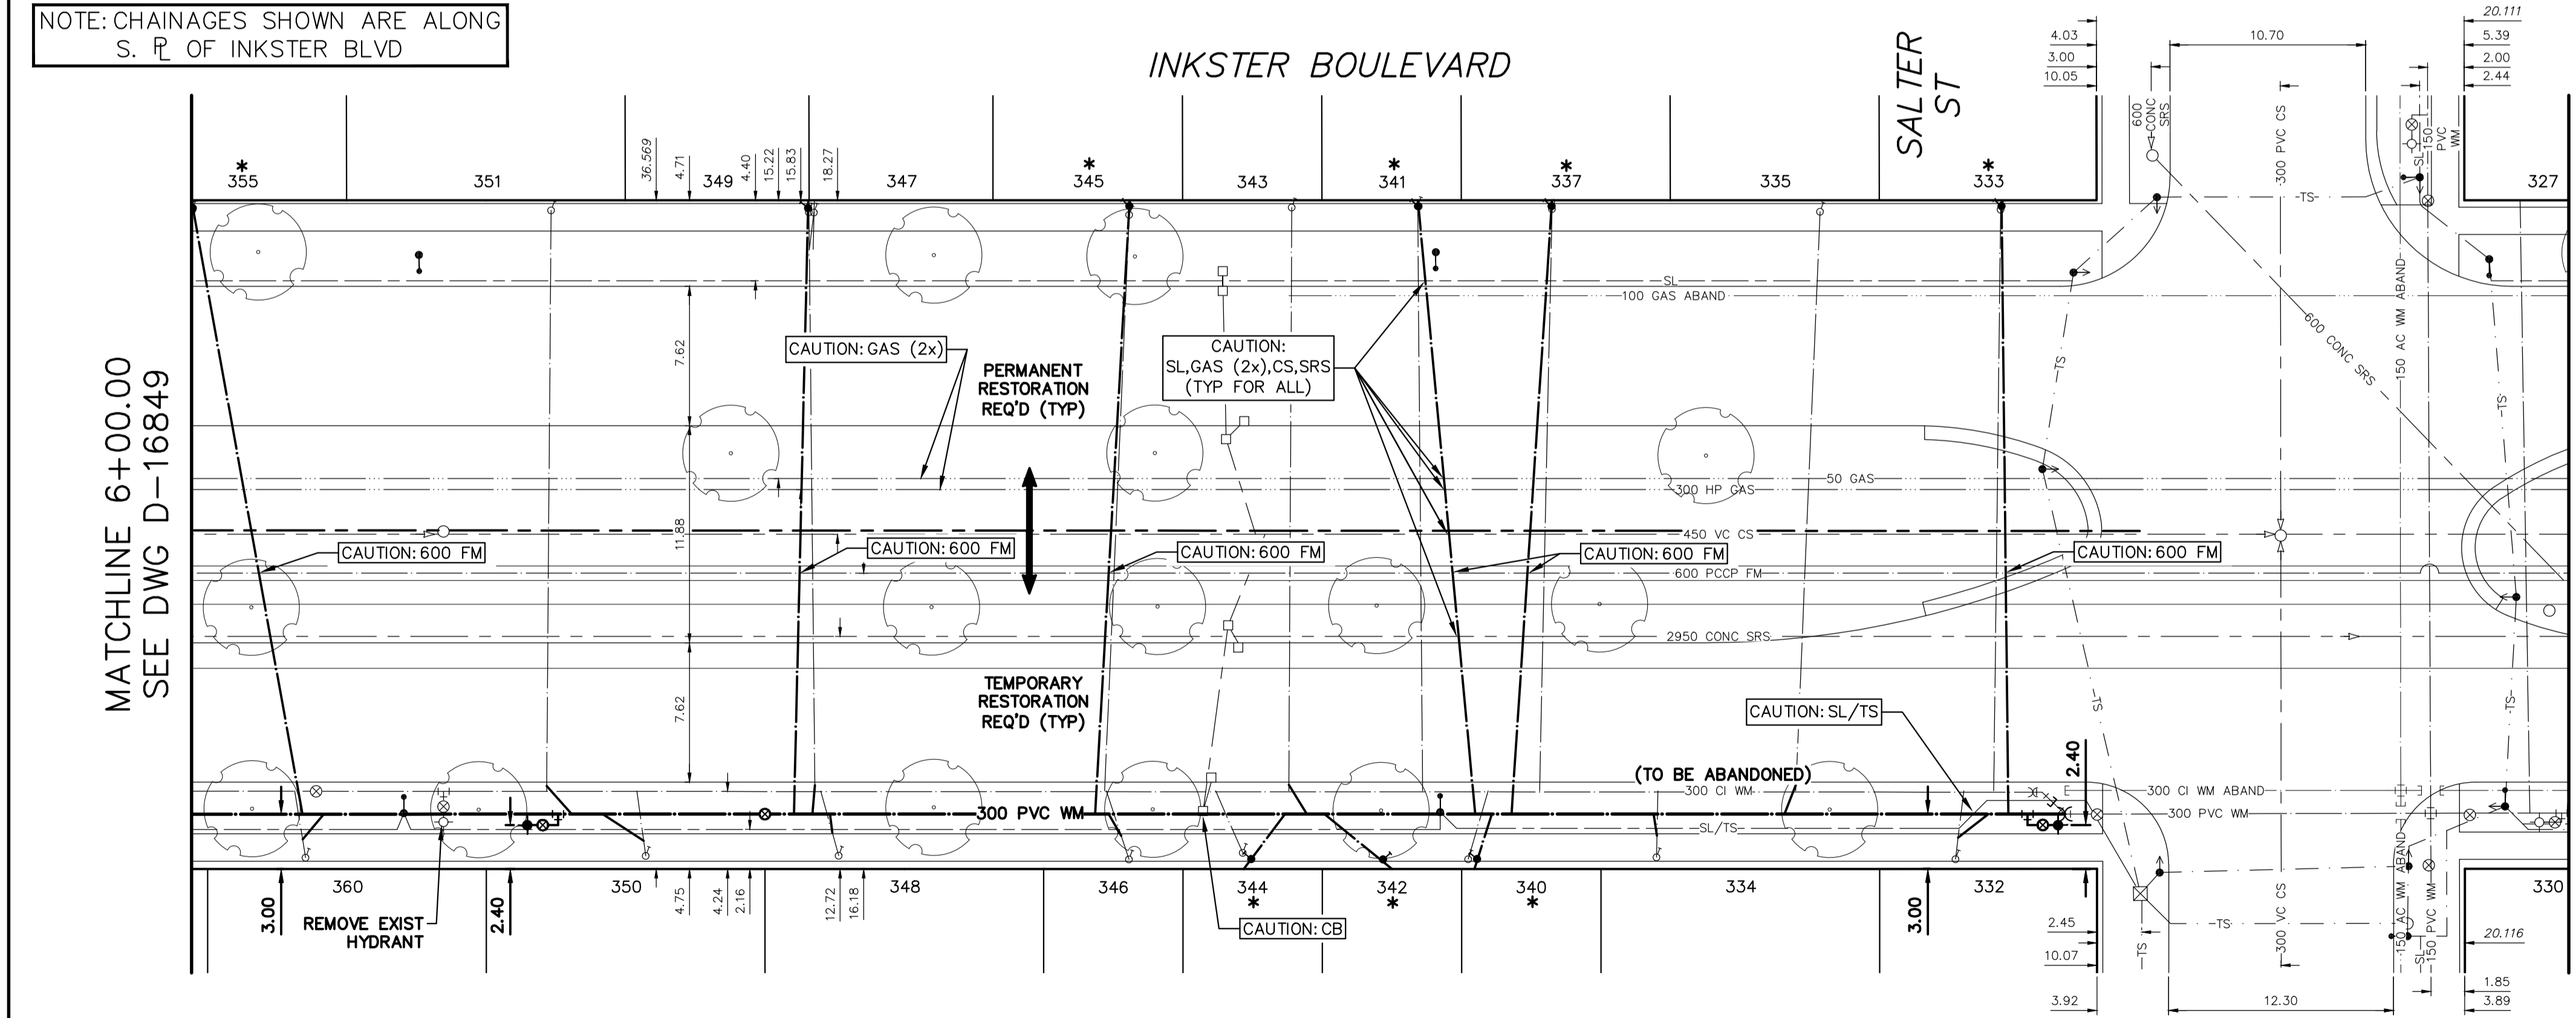

- ### CONSTRUCTION NOTES
- EXCAVATIONS WITHIN 3.0m OF THE OUTSIDE EDGE OF A FEEDER MAIN (EXCLUDING HYDROVAC HOLES) AND WHICH EXTEND BELOW THE OVERT OF THE FEEDER MAIN SHALL UTILIZE SHORING METHODS THAT PRECLUDE THE MOVEMENT OF NATIVE IN-SITU SOILS AND PIPE BEDDING (I.E. TIGHT SHORING SYSTEMS).
  - EXISTING FEEDER MAIN SHALL BE EXPOSED USING HYDROVAC EXCAVATION TO CONFIRM DEPTH PRIOR TO CROSSING OF NEW WATER MAINS OR WATER SERVICES.
  - MIN. CLEARANCE FOR ALL FEEDER MAIN CROSSINGS SHALL BE 1.0m UNDER OR 0.5m OVER EXISTING FEEDER MAIN.
  - THE CONTRACTOR SHALL CONSULT WITH MANITOBA HYDRO FOR HIGH PRESSURE GAS MAIN CROSSING REQUIREMENTS. FULL TIME SAFETY WATCH AND HYDROVAC EXCAVATION TO CONFIRM DEPTHS PRIOR TO CROSSING IS REQUIRED.

FOR INDEX SEE D-16845

NOTE: ALL VALVES TO BE INSTALLED COUNTERCLOCKWISE TO CLOSE

**ENGINEERS GEOSCIENTISTS MANITOBA**  
Certificate of Authorization MORRISON HERSHFIELD No. 1736

**METRIC**  
WHOLE NUMBERS INDICATE MILLIMETRES  
DECIMALIZED NUMBERS INDICATE METRES  
UNLESS OTHERWISE NOTED

**WARNING**  
IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:

- NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.
- TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.

SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

**LOCATION APPROVED UNDERGROUND STRUCTURES**

SUPV. U/G STRUCTURES COMMITTEE DATE

NOTE:  
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

VERTICAL DATUM: CGVD28 (HT2.0 Geoid)  
HORIZONTAL DATUM: NAD83 (June 1990), Zone 14

NO.	ISSUED FOR CONSTRUCTION	DATE	BY
0	ISSUED FOR CONSTRUCTION	2024/03/12	NJK
NO.	REVISIONS	DATE	BY

**MORRISON HERSHFIELD** now **Stantec**

DESIGNED BY: JKH  
DRAWN BY: DML

CHECKED BY: NJK  
APPROVED BY: ADB

SCALE:  
HORIZONTAL 1: 250  
VERTICAL 1: 50

RELEASED FOR CONSTRUCTION  
RYAN LUCKY

DATE: MARCH 12, 2024  
DATE: MARCH 11, 2024

PLOT DATE: 2024 03 12

ENGINEER'S SEAL

CONSULTANT DRAWING NUMBER

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT  
ENGINEERING SERVICES DIVISION

2024 WATER MAIN RENEWALS  
CONTRACT 6  
INKSTER BOULEVARD  
77m E OF POWERS STREET TO  
6m E OF SALTER STREET

SHEET 7 OF 12  
CITY DRAWING NUMBER  
D-16850

TENDER NUMBER: 162-2024  
CONTRACT NUMBER: 6

FILE PATH: X:\Pro\2023\230367800-2023-2025 McGregor-Inkster Renewals\09\_CAD\Water Main Renewal\07\_Sheets\  
FILE NAME: 2303678-Sheet-03.dwg