

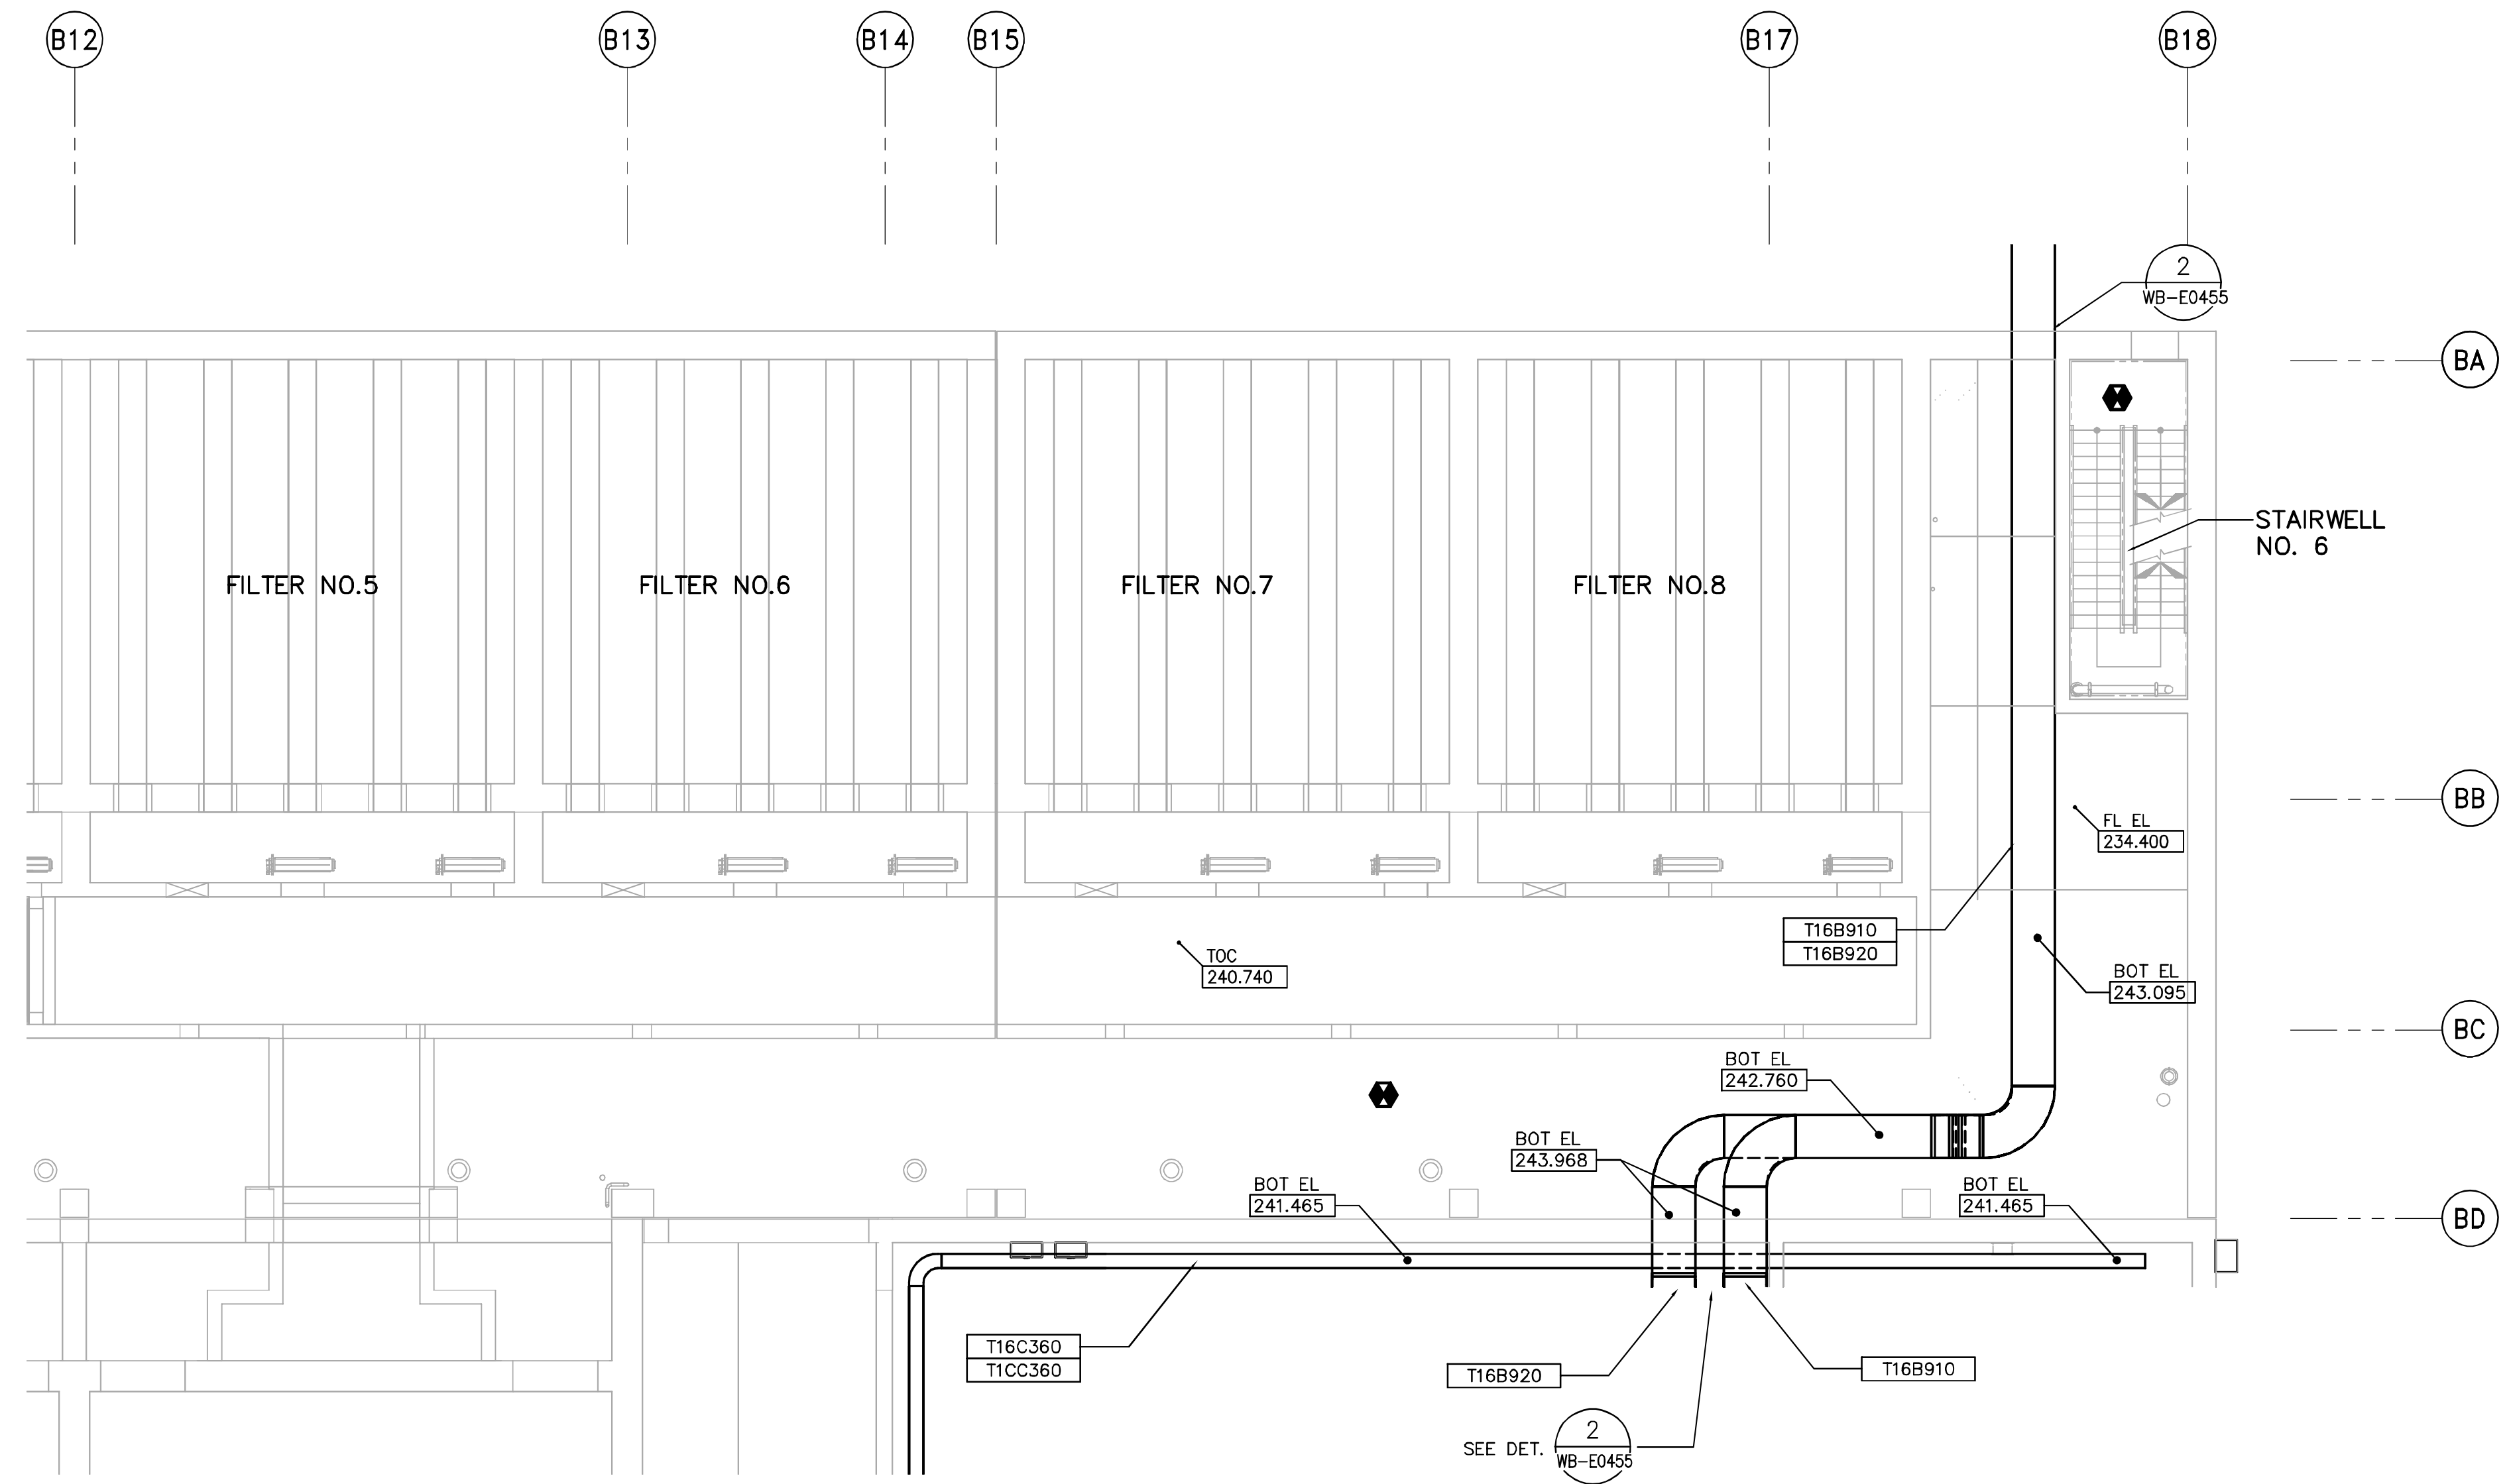


- NOTES:**
1. PROVIDE STAIRWELL SMOKE DETECTORS AS SHOWN ON FIRE PROTECTION DRAWINGS
  2. FOR CABLE TRAY TAGGING SEE DET. 3  
WB-E0455

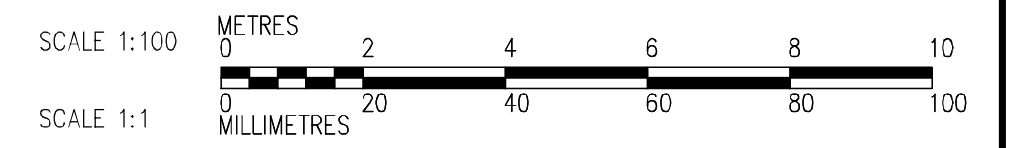

**SECOND FLOOR FACILITY PLAN (AREA 2)**  
1:100

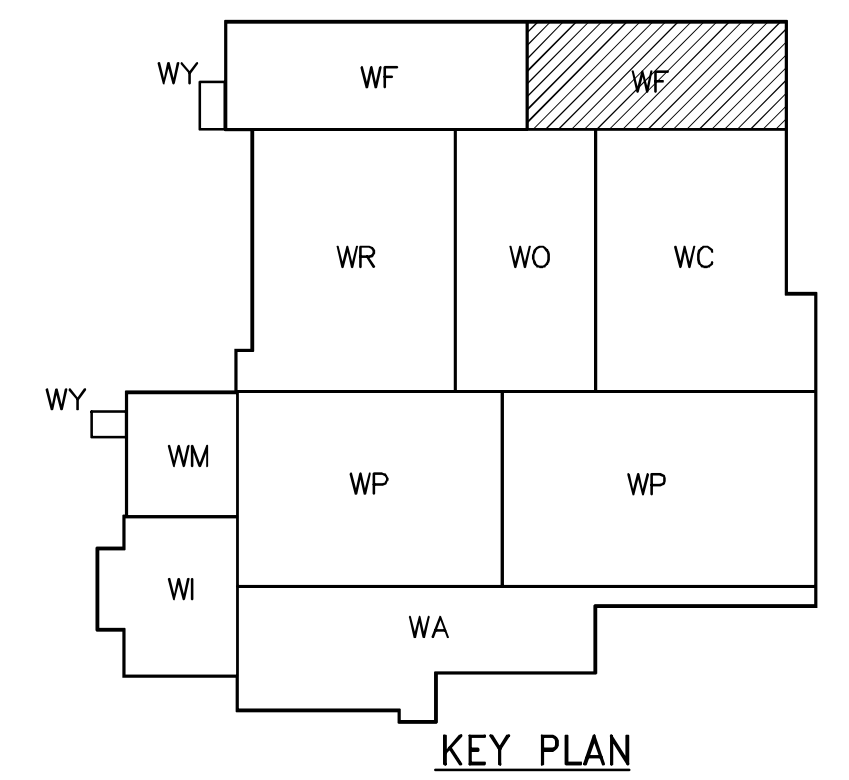

FOR INFORMATION ONLY - ISSUED WITH  
BID OPPORTUNITY 792-2006 - ADDENDUM 5

**APEGM**  
Certificate of Authorization  
CH2M HILL Canada Ltd.  
No. 1441 Expiry: April 30, 2007

NO.	REVISIONS	DATE	BY
02	ISSUED FOR CONSTRUCTION	06/07/28	LL
01	742-2005 ADDENDUM 3	06/05/05	LL
00	ISSUED FOR TENDER	06/03/29	LL

DESIGNED BY	LL	CHECKED BY	ND
DRAWN BY	TL	APPROVED BY	AHL
SCALE:	1:100	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2005/07/08	DATE	2006/03/29

ENGINEER'S SEAL  
ORIGINAL SIGNED BY  
L.D. LLEWELLYN  
2006/03/29  
CONSULTANT DRAWING NO.  
WF-E0122

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT  
ENGINEERING DIVISION

WATER TREATMENT PLANT  
FILTRATION  
MECHANICAL AND ELECTRICAL

ELECTRICAL  
FILTRATION AREA 2  
SECOND FLOOR FACILITY PLAN (AREA 2)

CITY FILE NUMBER  
SHEET OF  
CITY DRAWING NUMBER  
1-0601F-A-E0122-001-020