



ADDITION TO MAIN DISTRIBUTION

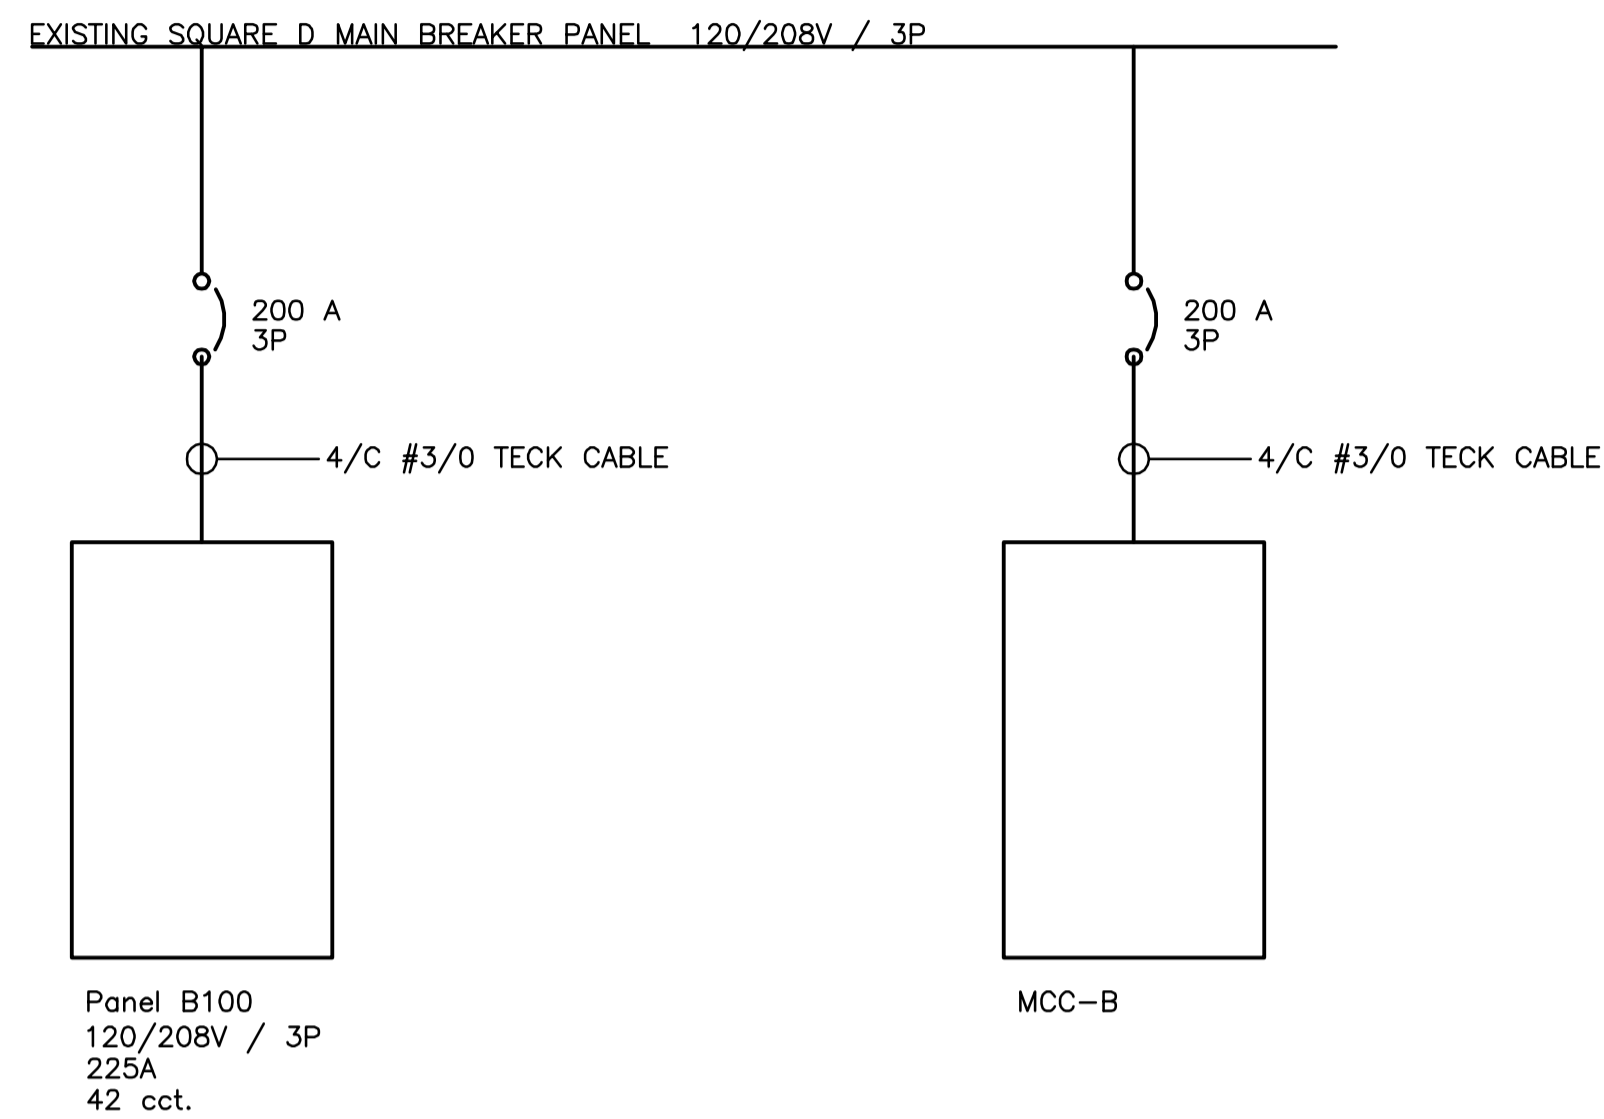

CHANGE TO DISTRIBUTION "B"

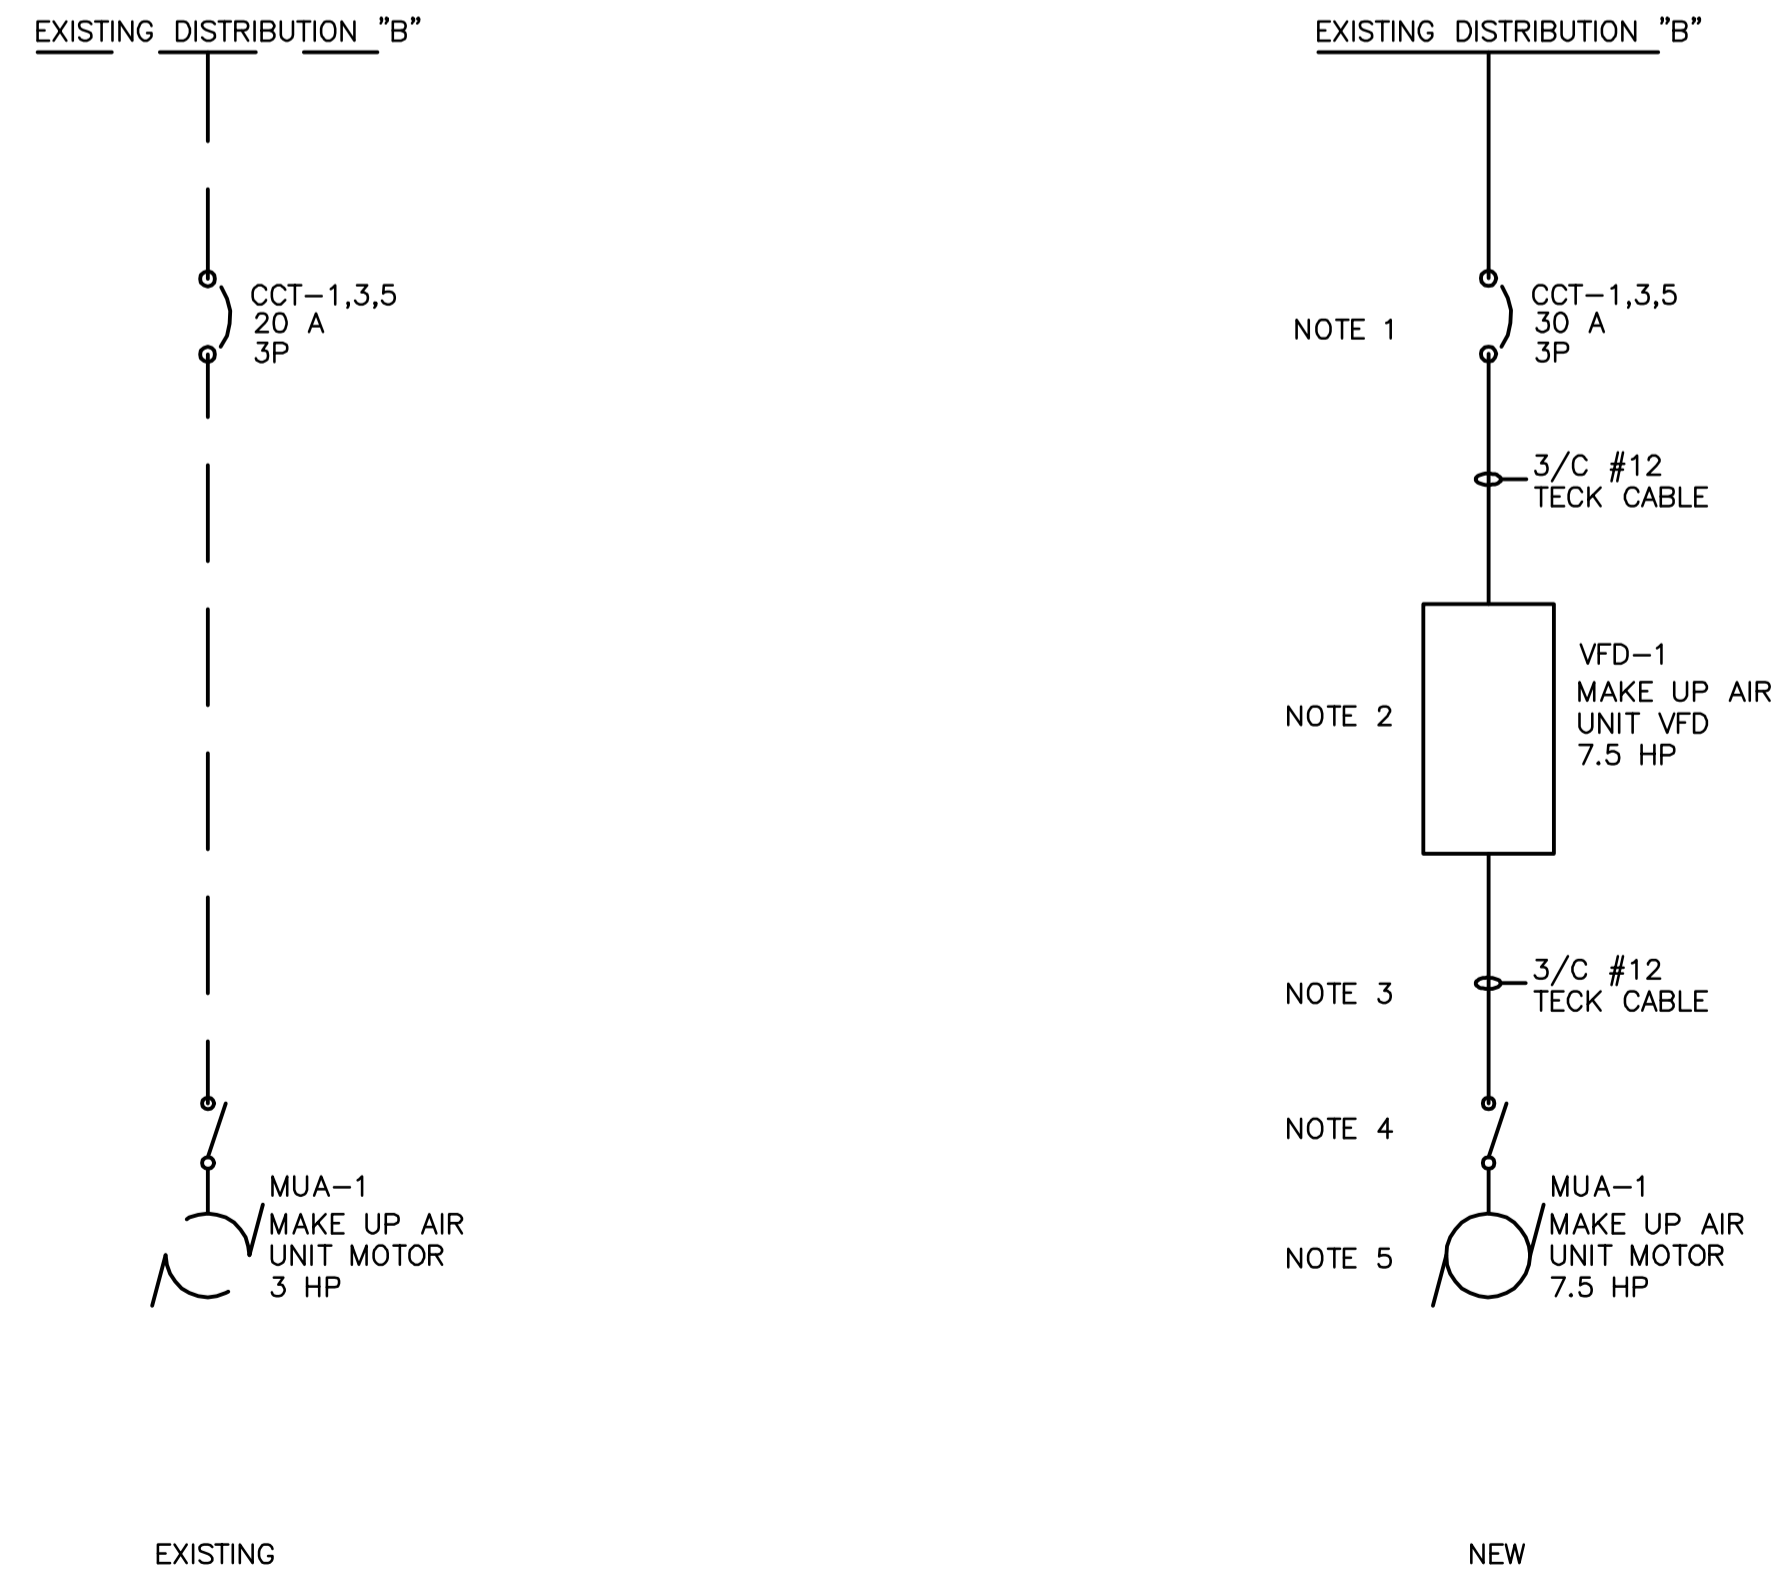

NOTES :

NOTES	
①	Replace existing breaker with new 30A breaker
②	VFD-1 supplied and installed by Div 23
③	Replace existing cable
④	In the disconnect switch, an "early-break" auxiliary set of contacts shall be interlocked with the VFD's Stop input
⑤	MUA-1 motor supplied and installed by Div 23

NO.	ISSUED FOR ADDENDUM 1	REVISION/DESCRIPTION	ES	2008.12.05
			BY	DATE

SEALS

DRAWN BY DATE	CHECKED BY USER APPROVAL	APPROVED

CITY OF WINNIPEG
 PLANNING, PROPERTY AND
 DEVELOPMENT DEPARTMENT
 CIVIC ACCOMMODATIONS DIVISION
 300 - 65 GARRY ST. R3C 4K4

PROJECT
 CONFEDERATION BUILDING
 SUPPLEMENTARY HEATING UPGRADES
 PHASE 1 - CITY BID OPP. NO. 757-2008
 457 MAIN STREET, WINNIPEG, MANITOBA
 SHEET TITLE
 BASEMENT LEVEL
 ELECTRICAL SINGLE LINE



Certificate of Authorization
 Earth Tech Canada Inc.
 No. 730 Expiry: April 30, 2009

© 2008 EARTH TECH (CANADA) INC. ALL RIGHTS RESERVED.
 THIS DOCUMENT IS PROTECTED BY COPYRIGHT LAW AND MAY NOT BE USED, REPRODUCED OR MODIFIED IN ANY MANNER OR FOR ANY PURPOSE EXCEPT WITH THE WRITTEN PERMISSION OF EARTH TECH (CANADA) INC. DOING BUSINESS AS AECOM (AECOM) OR A PARTY TO WHICH ITS COPYRIGHT HAS BEEN ASSIGNED. AECOM ACCEPTS NO RESPONSIBILITY, AND DENIES ANY LIABILITY WHATSOEVER, TO ANY PARTY THAT USES, REPRODUCES, MODIFIES, OR RELIES ON THIS DOCUMENT WITHOUT AECOM'S EXPRESS WRITTEN CONSENT.

SCALE	PROJECT NO.	SHEET NO.
AS SHOWN	105111	E02