

1.1 ELECTRICAL SPECIFICATIONS

- 1. THE CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE, SUBMIT AND FACILITATE ALL ITEMS RELATED TO MANITOBA HYDRO POWER SMART PROGRAM INCENTIVES.
2. REFER TO ARCHITECTURAL SPECIFICATIONS AND OTHER GENERAL CONDITIONS.
3. PROVIDE FOR A COMPLETE AND WORKING INSTALLATION AS HEREIN SPECIFIED AND AS SHOWN ON THE DRAWINGS.
4. THE ELECTRICAL INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE CANADIAN ELECTRICAL CODE, PROVINCIAL AND MUNICIPAL CODES AND REGULATIONS.
5. OBTAIN ALL PERMITS, APPROVALS AND PAY ALL RELATED FEES REQUIRED FOR THIS INSTALLATION.
6. ALL EQUIPMENT SUPPLIED UNDER THIS CONTRACT SHALL BE NEW AND BE C.S.A. APPROVED.
7. COORDINATE ALL CONDUIT RUNS AS SPECIFIED OR AS PER CONTRACT ADMINISTRATOR BEFORE INSTALLATION BEGINS.
8. ARRANGE FOR, AND COORDINATE, ROUGH-IN AND FINAL INSPECTIONS WITH INSPECTION AUTHORITIES, CONTRACT ADMINISTRATOR.
9. VISIT EXISTING SITE WHERE SUCH EQUIPMENT IS PRESENTLY INSTALLED, AND/OR OBTAIN OUTLETS, WIRING AND RECEPTACLE CONFIGURATIONS FROM EQUIPMENT MANUFACTURERS. EXACT CONFIGURATIONS MAY DIFFER FROM THOSE SHOWN ON THE DRAWINGS. INCLUDE ALL COSTS TO PROVIDE NECESSARY OUTLETS, WIRING AND RECEPTABLES.

1.2 EXAMINATION

- 1. EXAMINE THE ARCHITECTURAL AND MECHANICAL DRAWINGS TO ENSURE THAT THE WORK UNDER THIS CONTRACT CAN BE SATISFACTORILY CARRIED OUT. REPORT ANY DISCREPANCIES TO THE CONTRACT ADMINISTRATOR.
2. THE CONTRACTOR SHALL EXAMINE THE SITE, LOCAL CONDITIONS AND CONSIDER HOW THEY MAY AFFECT THE PROJECT.

1.3 SUPERVISION

- 1. SUPERVISE THE WORK AT ALL TIMES THROUGH A RESPONSIBLE AND COMPETENT JOURNEYMEN ELECTRICIAN / SUPERVISOR.
2. FULL COOPERATION SHALL BE SHOWN WITH OTHER TRADES TO FACILITATE INSTALLATIONS AND TO AVOID DELAYS IN CARRYING OUT THE WORK.

1.4 ACCURACY OF DATA

- 1. DRAWINGS ARE SCHEMATIC; EXACT LOCATIONS, DISTANCES, LEVELS AND OTHER DIMENSIONS SHALL BE GOVERNED BY THE BUILDING AS CONSTRUCTED.
2. OUTLETS OR EQUIPMENT SHALL BE MOVED TO ANY POINT WITHIN A 10' RADIUS WHEN RELOCATION IS REQUESTED BY THE CONTRACT ADMINISTRATOR BEFORE THE WORK HAS BEEN SUBSTANTIALLY COMPLETED, WITHOUT ADDITIONAL COST.
3. BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITH CIRCUITS ARRANGED EXACTLY AS SHOWN ON THE DRAWINGS. CONDUIT AND CABLE RUNS MAY BE MODIFIED TO SUIT THE INSTALLATION.

1.5 APPROVAL OF MATERIAL

- 1. REQUEST FOR APPROVAL OF MATERIAL AS EQUALS OR ALTERNATES TO THAT SPECIFIED SHALL BE SUBMITTED TO THE CONTRACT ADMINISTRATOR IN ACCORDANCE WITH B7.

1.6 SHOP DRAWINGS

- 1. PROVIDE SHOP DRAWINGS FOR REVIEW BY THE CONTRACT ADMINISTRATOR. THE SHOP DRAWINGS MUST BE ASSEMBLED INTO COMPLETE BROCHURES.
2. THE REVIEW OF THE SHOP DRAWINGS IS FOR THE SOLE PURPOSE OF ASCERTAINING CONFORMANCE WITH THE GENERAL DESIGN CONCEPT. THE REVIEW SHALL NOT MEAN APPROVAL OF THE DETAILED DESIGN INHERENT IN THE EQUIPMENT. THE RESPONSIBILITY FOR WHICH SHALL REMAIN WITH THE CONTRACTOR. THE REVIEW SHALL NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY TO MEET THE REQUIREMENTS OF THE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL REMAIN RESPONSIBLE FOR CONFIRMING AND CORRELATING THE DIMENSIONS ON THE JOBSITE, AND FOR INFORMATION THAT PERTAINS TO THE FABRICATION PROCESS, CONSTRUCTION TECHNIQUES, AND INSTALLATION DETAILS, AND FOR COORDINATING ALL WORK OF THE RELATED SUB-TRADES.
3. FABRICATION OF EQUIPMENT SHALL NOT COMMENCE UNTIL SHOP DRAWINGS OF SUCH EQUIPMENT HAVE BEEN REVIEWED AND APPROVED BY THE CONTRACT ADMINISTRATOR. TWO SETS SHALL BE SUBMITTED WITH LOCAL INSPECTION DEPARTMENT APPROVAL WHERE REQUIRED.
4. THE ELECTRICAL SUB-CONTRACTOR SHALL REVIEW ALL MECHANICAL SHOP DRAWINGS - REQUIRING ELECTRICAL CONNECTION - AND COORDINATE VOLTAGE AND SIZES WITH DIVISION 15 AND GENERAL CONTRACTOR.

1.7 AS-BUILT DRAWINGS

- 1. KEEP A RECORD SET OF DRAWINGS ON-SITE AT ALL TIMES RECORDING ANY CHANGES THAT MAY OCCUR. SUBMIT THESE DRAWINGS TO THE CONTRACT ADMINISTRATOR UPON COMPLETION OF THE WORK. AS-BUILTS SHALL INCLUDE TAGGING EXISTING AND NEW CIRCUITS AND EQUIPMENT.
2. SUBMIT A CERTIFICATE OF INSPECTION FROM THE LOCAL INSPECTION AUTHORITY UPON COMPLETION OF WORK.
3. THE CONTRACT ADMINISTRATOR RESERVES THE RIGHT TO RECOMMEND A PORTION OF THE CONTRACT FUNDS BE WITHHELD PENDING SUBMISSION OF ACCEPTABLE ON-SITE REDLINE DRAWINGS.

1.8 TESTING

- 1. THE ELECTRICAL INSTALLATION SHALL BE COMPLETELY TESTED DEMONSTRATING THE EQUIPMENT AND SYSTEMS INSTALLED PERFORM IN THE MANNER INTENDED.

1.9 GUARANTEE

- 1. THE SATISFACTORY OPERATION OF ALL WORK SHALL BE GUARANTEED FOR A PERIOD OF 12 CALENDAR MONTHS AFTER FINAL ACCEPTANCE OF THE BUILDING.

1.10 REQUEST FOR CHANGE

- 1. ALL QUOTATIONS IN RESPONSE TO REQUEST FOR CHANGE SHALL BE SUBMITTED COMPLETE WITH AN ITEMIZED COST BREAKDOWN OF ALL MATERIALS AND LABOUR REQUIRED IN THE CHANGE.

1.11 GROUNDING

- 1. THE ENTIRE INSTALLATION SHALL BE GROUNDED IN ACCORDANCE WITH THE LATEST EDITION OF CANADIAN ELECTRICAL CODE AND AS SHOWN ON DRAWINGS.

1.12 WORKMANSHIP

- 1. INSTALL EQUIPMENT, CONDUIT AND CABLES IN A WORKMANLIKE MANNER TO PRESENT A NEAT APPEARANCE TO THE SATISFACTION OF THE CONTRACT ADMINISTRATOR. INSTALL CONDUITS AND CABLE RUNS PARALLEL AND/OR PERPENDICULAR TO BUILDING GRID LINES & COLUMNS IN CEILING SPACES, CHASES & BEHIND FLOORING. IN AREAS WHERE SYSTEMS ARE TO BE EXPOSED, INSTALL NEATLY AND GROUP TO PRESENT A TIDY APPEARANCE.
2. INSTALL EQUIPMENT AND APPARATUS REQUIRING MAINTENANCE, ADJUSTMENT OR EVENTUAL REPLACEMENT WITH ADEQUATE CLEARANCES AND ACCESSIBILITY FOR SAME.
3. INCLUDE, IN THE WORK, ALL REQUIREMENTS SHOWN ON THE SHOP DRAWINGS OR MANUFACTURERS' INSTALLATION INSTRUCTIONS.
4. REPLACE WORK UNSATISFACTORY TO THE CONTRACT ADMINISTRATOR WITHOUT EXTRA COST.
5. USE OF CLIPS FOR SECURING AC90 TO CEILING SYSTEM IS PROHIBITED.
6. ALL CONDUITS MUST BE CLIPPED TO STRUCTURAL CONCRETE BY MEANS OF SUITABLE ANCHORS OR SUPPORTED BY UNISTRUIT HANGERS AS CLOSE TO UNDERSIDE AS POSSIBLE. TYE WRAPS FOR WIRE HANGING AND FASTENING IS NOT ACCEPTABLE. PERFORATED STRAPPING IS ALSO UNACCEPTABLE. ALL ELECTRICAL COMPONENTS MUST BE SUPPORTED INDEPENDENTLY.
7. ALL ELECTRICAL SUPPORTS AND HANGER SHALL CONFORM TO LATEST EDITION OF CANADIAN ELECTRICAL CODE AND/OR MANUFACTURERS INSTALLATION INSTRUCTIONS.

2.0 MATERIALS AND INSTALLATION

2.1 OUTLET BOXES

- 1. OUTLET, JUNCTION AND SWITCH BOXES SHALL BE GALVANIZED PRESSED STEEL OF SIZE AND TYPE TO SUIT EACH INDIVIDUAL APPLICATION.
2. OUTLETS SHALL NOT BE LOCATED ANYWHERE ON THE EXTERIOR CURTAIN WALL. OUTLETS SHOWN SHALL BE MOUNTED ON THE NEAREST DIVIDING WALL 2' FROM OUTSIDE WALL, OR NEAREST FURRED OUT COLUMN.
3. PROVIDE ALL REQUIRED ACCESS PANELS WITH SUITABLE FIRE RATINGS FOR THE WALL OR CEILING THEY ARE BEING INSTALLED IN.

2.2 WIRING METHODS

- 1. EXISTING WIRING INCLUDING INSULATION THAT IS FRAYED, CRACKED OR DEEM NOT TO CODE SHALL BE REPLACED TO MEET CODE.
2. UNLESS OTHERWISE SHOWN ON THE DRAWINGS, ALL WIRE SHALL BE COPPER, MINIMUM #12 AWG WITH 90 DEGREES CELSIUS XLINK INSULATION. WIRING TO BE INSTALLED IN CONDUIT (INCLUDING WIRING ON ROOF DECK FLUTES WHERE APPROVED).
3. WIRING IN CONCRETE OR MASONRY CONSTRUCTION SHALL BE INSTALLED IN STEEL ELECTRICAL METALLIC TUBING (EMT). PROVIDE A SEPARATE GROUNDING CONDUCTOR IN EMT CONDUIT RUNS EMBEDDED IN CONCRETE SLABS. CONDUITS INSTALLED IN AREAS EXPOSED TO MOISTURE SHALL HAVE WATERTIGHT FITTINGS.
4. ALL WIRING IN FINISHED AREAS SHALL BE CONCEALED. ALL CONDUCTORS AND CONDUITS SHALL BE RUN PERPENDICULAR OR PARALLEL TO THE BUILDING CORE WALLS.
5. CONDUIT AND WIRING SHALL BE GROUPED WHERE POSSIBLE AND CLIPPED IN A NEAT AND WORKMANLIKE MANNER.
6. AC-90 CABLE TO BE USED FOR DROPS FROM CONDUIT SYSTEMS TO RECESSED LIGHTING FIXTURES IN ACCESSIBLE CEILINGS OR OUTLET BOXES IN STEEL STUD WALLS ONLY. HOME RUNS SHALL BE IN CONDUIT. MAXIMUM RUN OF AC-90 IN ACCESSIBLE CEILING SPACE SHALL BE 5'-0" .
7. EACH CIRCUIT FOR COMPUTER EQUIPMENT, PRINTERS AND COPIERS SHALL HAVE A SEPARATE NEUTRAL CONDUCTOR.
8. PROVIDE ONE ISOLATED GROUND CONDUCTOR PER THREE 2 WIRE ISOLATED GROUND CIRCUITS.
9. CONDUIT RUNS SHALL BE INSTALLED AND INSPECTED BEFORE AC-90 ARE INSTALLED TO ENSURE CONFORMANCE WITH ITEM 5 HEREIN.
10. THREE WIRE AC-90 SHALL NOT BE USED FOR ISOLATED GROUND WIRING, UNLESS IT INCLUDES A GREEN INSULATED CONDUCTOR FOR THIS PURPOSE.
11. ALL AC-90 USED FOR DROPS SHALL BE RUN TIGHT TO DECK AND FOLLOW LINES OF BEAMS AND BUILDING.
12. ALL WIRING IN SERVICE AREAS TO BE IN SURFACE MOUNTED EMT. DO NOT RUN CONDUIT HORIZONTALLY ON WALLS, VERTICAL DROPS ONLY.

2.3 IDENTIFICATION OF EQUIPMENT

- 1. ALL EQUIPMENT SHALL BE IDENTIFIED WITH 3/8" X 1-1/2" (10" LETTERS) ENGRAVED LAMACOID NAMEPLATES INDICATING PANEL AND CIRCUIT NUMBER. LAMACOIDS SHALL BE EITHER SCREWED OR RIVETED IN PLACE. WITH EXCEPTION TO RECEPTACLES AND LIGHTING SWITCHES, SELF ADHESIVE TYPE IS ACCEPTABLE. LAMACOIDS SHALL BE WHITE LETTERING ON RED FACE FOR EMERGENCY AND FIRE ALARM DEVICES AND WHITE LETTERING ON BLACK FACE TO NORMAL POWER DEVICES AND COMMUNICATION PANELS.
2. PROVIDE 1" X 3" LAMACOIDS FOR EACH NEW COP BREAKER, INDICATING PANEL OR FEED BEING FED, IF APPLICABLE.

2.4 LUMINAIRES

- 1. SUPPLY AND INSTALL LUMINAIRES AND ASSOCIATE COMPONENTS, AS PER LUMINAIRE SCHEDULE TO OPERATE AS INTENDED WITH MANUFACTURERS INSTRUCTIONS.
2. ALL LUMINAIRES SHALL BE 4000 K, UNLESS NOTED OTHERWISE.
3. ALL SWITCHING SHALL BE RUN IN CONDUIT.

2.5 CUTTING AND PATCHING

- 1. ARRANGE AND PAY FOR ALL CUTTING AND PATCHING AS REQUIRED FOR THE ELECTRICAL INSTALLATION.
2. PROVIDE & INSTALL APPROPRIATE FIRE STOP AT ALL FIRE WALL & OR FLOOR PENETRATIONS. ACCEPTABLE MANUFACTURERS: HILTI, DOW CORNING, FIRE-STOP SYSTEMS (ELASTA-SEAL) OR G.E. SILICONE.
3. REFER TO MANUFACTURERS' SPECIFICATIONS FOR PRODUCT AND INSTALLATION DETAILS.

2.6 DEVICES

- 1. COLORS OF RECEPTABLES, SWITCHES, SWITCHES, OUTLETS AND COVER PLATES SHALL BE WHITE FOR NON-BLACK WALLS & BLACK FOR BLACK WALLS, UNLESS NOTED OTHERWISE.
2. SWITCHES SHALL BE "DECORA" STYLE, HUBBELL, ARROW HART, BRYANT, LEVITON, WOODHEAD, PASS & SEYMOUR, 15 AMPS, 125 / 347 VAC. MOUNT SWITCHES 42" ABOVE FINISH FLOOR, UNLESS OTHERWISE NOTED. OCCUPANCY LIGHT SWITCHES SHALL NOT BE MOUNTED BEHIND DOORS OR LOCATIONS RESTRICTING THE SENSOR AREA.
3. ACCEPTABLE MANUFACTURERS FOR "DECORA" STYLE RECEPTABLES INCLUDING GFCI SHALL BE HUBBELL, ARROW HART, BRYANT, LEVITON, WOODHEAD, PASS & SEYMOUR, MOUNT RECEPTABLES 18" ABOVE FINISH FLOOR, UNLESS OTHERWISE NOTED.
4. PROVIDE STAINLESS STEEL COVER PLATES FOR NON-BLACK WALLS & BLACK COVER PLATES FOR BLACK WALLS FOR DEVICES.

2.7 EQUIPMENT

- 1. ELECTRIC FAN FORTER HEATER, FF-1
2. RATING 5KW, 208V, 3PH, 60HZ
3. COLOUR: WHITE
4. ACCEPTABLE UNITS ARE OUELLET CAT # OCA05038, STELPRO, REZCOR OR EQUIV.
5. OPTIONS
5.1. CONTROL CIRCUIT, OUELLET OCA-120208V
5.2. TRIPLE-POLE CONTACTOR OUELLET OCA-3P
5.3. DIGITAL THERMOSTAT W/ CLEAR THERMOSTAT GUARD
5.4. SPECIAL BACK PLATE OUELLET OCA-0A28
5.5. WASHABLE AIR FILTER OUELLET F1W-28
2. RUNNING MAN EXIT SIGN
2. INPUT POWER: 120V
3. STEEL CONSTRUCTION, WHITE
4. UNIVERSAL MOUNT
EXIT (SINGLE FACE)
1. ACCEPTABLE UNITS ARE AMILITE RPST-U4M-WHT-4DC, BEGHELLI SL-RM4-1-Q-W, EMERGLITE
EXIT-1 (DOUBLE-FACE, UNIVERSAL MOUNT)
1. ACCEPTABLE UNITS ARE AMILITE, BEGHELLI SL-RM4-2-Q-W, EMERGLITE
EXIT-2 (DOUBLE-FACE, UNIVERSAL MOUNT, LEFT INDICATOR)
1. ACCEPTABLE UNITS ARE AMILITE, BEGHELLI SL-RM4-2-Q-W, EMERGLITE
3. EMERGENCY BATTERY BANK, EBB-3, WITH LAMP HEADS
1. INPUT POWER: 120VAC, OUTPUT(T)12V, 120W OPERATION)
2. MR-16 (2) HEADS, 7W LED)
3. STEEL CABINET 18GA., WHITE, WITH UNIVERSAL MOUNTING PLATE & MOUNTING SHELF
4. ACCEPTABLE UNITS AMILITE EBST-12144-2MB-4WLR-WHT-4TD, BEGHELLI NOVA N-12-120-2BTR4LED-MR16-AT-M8, EMERGLITE
4. EMERGENCY REMOTE HEADS
1. OPERATION 12VDC
2. DOUBLE HEADS, MR16 6W LED
3. COLOUR: WHITE
4. ACCEPTABLE UNITS AMILITE RM1B-2-12-246W-LA-WHT (FOR NON-BLACK WALLS), AMILITE RM1B-2-12-246W-LA-BLK (FOR BLACK WALLS)

DATA CABLING SPECIFICATIONS

CONTRACTOR QUALIFICATIONS

THE CONTRACTOR PERFORMING THE DATA CABLING INSTALLATION SHALL HAVE A STRUCTURED CABLING INDUSTRY AFFILIATION SUCH AS BKSI (BUILDING INDUSTRY CONSULTANTS INTERNATIONAL) MEMBERSHIP, RCDI (REGISTERED COMMUNICATIONS DISTRIBUTOR/DESIGNER) AND/OR A STRUCTURED CABLING VENDOR CERTIFICATION.

ALL DATA CABLING INSTALLERS SHALL BE LICENSED AND INSURED.

THE DATA CABLING CONTRACTOR SHALL PROVIDE REFERENCES OF SIMILAR PROJECTS.

HORIZONTAL CABLING

1.1 TYPES

- 1.1.1. CATEGORY 5e CABLING SHALL BE USED FOR ALL LIGHT LIGHTING NETWORK. CATEGORY 5e CABLE SHALL BE CERTIFIED, TESTED TO A MINIMUM OF 100 MHZ, AND MEET THE MINIMUM TECHNICAL SPECIFICATIONS IN (TELECOMMUNICATIONS INDUSTRY ASSOCIATION) TIA 568A. COLOUR TO BE WHITE. CABLING IN PLENUM SPACES SHALL BE PLENUM-RATED (FT-6).
1.1.2. CATEGORY 6 CABLING SHALL BE USED FOR DESKTOP DATA NETWORK. CATEGORY 6 CABLING SHALL BE CERTIFIED AND TESTED TO A MINIMUM OF 250 MHZ. THE CATEGORY 6 HORIZONTAL CABLING SHALL MEET THE MINIMUM TECHNICAL SPECIFICATIONS IN (TELECOMMUNICATIONS INDUSTRY ASSOCIATION) TIA 568A. COLOUR TO BE BLUE. CABLING IN PLENUM SPACES SHALL BE PLENUM-RATED (FT-6).

- 1.2. ALL DATA TELECOMMUNICATIONS JACKS SHALL BE OF THE CATEGORY OF THE USE. CONNECTORS AND SHALL BE TIA CERTIFIED. JACK AND CONNECTOR COLOUR TO BE MATCH THE CATEGORY.

- 1.3. NO INSTALLED CABLING MAY BE EXPOSED TO VIEW IN FINISH SPACES. IT SHALL BE WITHIN A RACEWAY, CONDUIT, POWER POLE OR IN FINISH CEILING SPACES.

- 1.4. ALL HORIZONTAL CABLING RUNS SHALL RUN FROM EACH WORK AREA IN A STAR TOPOLOGY TO CAB-1 OR AS SHOWN. INSTALL CONDUITS AND CABLE RUNS PARALLEL AND/OR PERPENDICULAR TO BUILDING GRID LINES & COLUMNS IN CEILING SPACES, AGAINST UNDERSIDE OF ROOF DECKS, CHASES & BEHIND FLOORING. THERE SHALL BE NO CONNECTOR IN THE CABLE RUN BETWEEN THE OUTLET IN THE WORK AREA TO THE PATCH PANEL. ALL CABLES IN GALLERY DISPLAY AREAS SHALL BE IN CONDUIT SIZE TO ACCOMMODATE NEW CABLE FILLS PLUS 25% FOR FUTURE. ALL EXPOSED CATEGORY 6 CABLING SHALL BE PLENUM-RATED (FT-6).

- 1.5. NO CABLING RUN MAY EXCEED A LENGTH OF 90 METERS.

1.6. CAB-1

- 1.6.1. PROVIDE EIA COMPLIANT 19" WALL MOUNT RACK, MIDDLE ATLANTIC PRODUCT No: DWR-16-23PD WITH FLEXI FRONT DOOR, ACTIVE COOLING VIA TOP-MOUNT DUAL-FANS, 33" OVERALL HEIGHT, 28" RACKING HEIGHT, 16 RACK SPACES, 2015S CAPACITY.
1.6.2. PROVIDE PATCH PANEL: 1RU 24-PORT FLAT PANEL, (CAT 6) W/FRONT & REAR CABLE MANAGEMENT, ACCEPTABLE LEVITON, HUBBELL, CISCO, SIEMEN
1.6.3. ALL CATEGORY CABLING SHALL BE TERMINATED IN THE CAB-1 ON RACK MOUNT PATCH PANELS (MAXIMUM OF 48 JACKS PER PANEL), SUPPLY PATCH PANELS, COMPONENTS, WIRE MANAGEMENT.

- 1.7. ALL CATEGORY CABLING IN THE RACKS SHALL BE INSTALLED WITH SUFFICIENT AND APPROPRIATE MOUNTING CLIPS, BRACKETS, AND CABLE MANAGEMENT TO PROVIDE A SECURE AND MAINTAINABLE SYSTEM. CARE SHALL BE TAKEN TO NOT CAUSE THE CABLES TO BE OVERLY CRIMPED.

- 1.8. THE UTP CATEGORY CABLE TAIL SHALL BE TERMINATED WITH A MINIMUM OF 14" OF SLACK BUT NOT TO EXCEED 18".

- 1.9. AFTER DRESSING CABLE TO THE FINAL LOCATION, THE SHEATH SHALL BE REMOVED TO A POINT THAT ALLOWS THE CONDUCTORS TO BE SPAYED AND TERMINATED IN A NEAT AND UNIFORM FASHION. EVERY EFFORT MUST BE MADE TO MAINTAIN SHEATH INTEGRITY BY REMOVING ONLY AS MUCH AS IS PRACTICAL TO ACCOMPLISH TERMINATION. CABLE PAIR TWIST SHALL BE MAINTAINED UP TO THE POINT OF TERMINATION, AS STATED IN TIA-568A. THE Pairs IN A CABLE SHOULD NEVER BE UNTWISTED MORE THAN 0.5 INCH FROM THE POINT OF TERMINATION. UNDER NO CIRCUMSTANCES SHALL CABLE Pairs BE UNTWISTED OR OTHERWISE ALTERED PRIOR TO TERMINATION.

- 1.10. ANY UNUSED HORIZONTAL CABLING SHALL BE LABELED AND LOOSELY COILED.

- 1.11. CONTRACTOR SHALL SPECIFY CABLES PROPOSED FOR USE AND SUBMIT DOCUMENTATION PROVING THE PROPOSED CABLES MEET THESE SPECIFICATIONS.

LABELLING

- 2.1. ALL CABLES SHALL BE NEATLY LABELED WITH TAG WRAPS OR SOME OTHER PERMANENT MARKER CAPABLE OF WITHSTANDING MULTIPLE PULLING OF CABLE THROUGH CONDUITS OR RACEWAYS. LABELS SHALL BE LOCATED 4" FROM THE WORK AREA END.

- 2.2. ALL TERMINATIONS SHALL BE CLEARLY IDENTIFIED ON PATCH PANELS IN CAB-1. ALL JACKS IN THE PATCH PANEL MUST BE IN SEQUENTIAL ORDER.

- 2.3. AT EACH WORK AREA, FACEPLATE OUTLET SHALL BE PROFESSIONALLY PRINTED WITH JACK NUMBERS CLEARLY VISIBLE WITHOUT REMOVING OUTLET FACEPLATE. THE LABELING SHALL BE METAL OR VINYL ADHESIVE TAPE WITH EMBOSSED OR INDELIBLE PRINTING FOR EACH OUTLET.

- 2.4. THE ALPHA-NUMERIC NUMBERING SCHEME IS AS SHOWN:

XXX-YY

XXX (ROOM NUMBER)

YY (DATA JACK NUMBER)

EXAMPLE: GALLERY DISPLAY, ROOM 201, 1st DATA JACK, 201-41

FIELD TEST QUALITY

- 3.1. THE CONTRACTOR SHALL VISUALLY INSPECT ALL CABLES, CABLE REELS, AND SHIPPING CARTONS TO DETECT CABLE DAMAGE INCURRED DURING SHIPPING AND TRANSPORT. VISIBLY DAMAGED ITEMS SHALL NOT BE INSTALLED.
3.2. CONDUCT CABLE TESTING ONLY UPON COMPLETION OF INSTALLATION.
3.3. A MINIMUM OF A LEVEL II-E FIELD TESTER SHALL BE USED TO VERIFY CABLING PERFORMANCE.
3.4. IN ADDITION TO HARD COPY TEST RESULTS, ACCEPTABLE ELECTRONIC FORMAT FOR TEST RESULTS ARE MICROSOFT EXCEL FOR EACH LINK.
3.5. THE CONTRACTOR SHALL DESCRIBE IN DETAILS ITS PROPOSED TEST PLAN TO DETECT ANY DEFECTIVE COMPONENTS AND TO DEMONSTRATE THAT THE INSTALLATION COMPLIES WITH THE SPECIFICATION.

RECORD DRAWINGS

- 4.1. THE CONTRACTOR SHALL KEEP A RECORD SET OF DRAWINGS ON THE SITE AT ALL TIMES RECORDING ALL CHANGES THAT MAY OCCUR. AS-BUILT DRAWINGS ARE TO BE SUBMITTED WITH CONTRACTORS NAME, SIGNATURE AND DATE OF AS-BUILT.

Table with 4 columns: No., REVISION/DESCRIPTION, BY, DATE. Row 1: 1 ISSUED FOR ADDENDUM No:1 DTA 2016.12.09. Row 2: 0 ISSUED FOR CONSTRUCTION. DTA 2016.11.28.

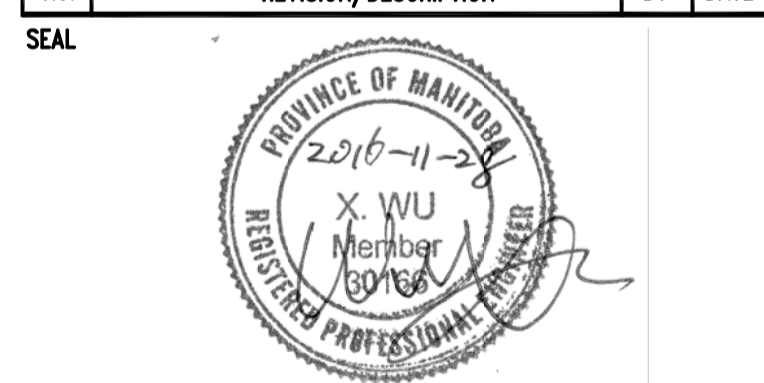


Table with 4 columns: DRAWN, CHECKED, DESIGNED, APPROVED. All fields contain 'DTA'. DATE: 2016.11.18. USER: APPROVAL.

THE CITY OF WINNIPEG PLANNING, PROPERTY AND DEVELOPMENT DEPARTMENT MUNICIPAL ACCOMMODATIONS DIVISION 3-65 GARRY STREET, R3C 4K4

PROJECT AQUATIC HALL OF FAME MUSEUM ROYAL GALLERY SPACE RESTORATION

25 POSEIDON BAY

SHEET TITLE ELECTRICAL SPECIFICATIONS POWER, DATA, COMMUNICATIONS

Table with 3 columns: SCALE, PROJECT No, SHEET No. AS SHOWN, 2014-148, E7R1.