

LAP TABLE	
BAR	LAP
10M	500
15M	700
20M	870

**NOTE:**  
CLEAR COVER TO REINFORCING SHALL BE 50mm ±12mm FOR CAST-IN-PLACE SLABS AND CAST-IN-PLACE BEAMS AND WALLS.

**LOCATION APPROVED UNDERGROUND STRUCTURES**


SUPR. U/G STRUCTURES COMMITTEE DATE

**NOTE:**  
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

NO.	REVISIONS	YY/MM/DD	BY
0	ISSUED FOR CONSTRUCTION	05/05/26	ADL

DESIGNED BY		CHECKED BY	
GEB		An	
DRAWN BY		APPROVED BY	
ADL		Raymond Wilson	
HOR. SCALE		RELEASED FOR CONSTRUCTION	
AS NOTED		W. J. W. W. W.	
VERT. SCALE		DATE	
N/A		05/05/27	

**APEGM**  
Certificate of Authorization  
UMA Engineering Ltd.  
No. 256 Expiry: April 30, 2006

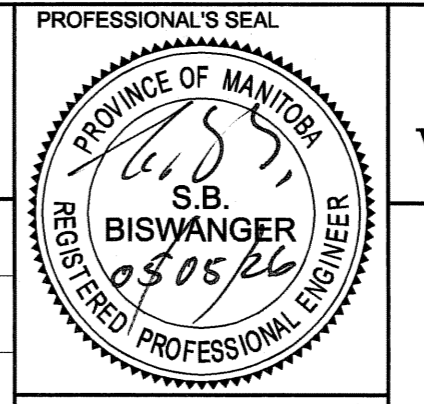

CONSULTANT DRAWING NO. 16  
D265-177-01-02

**THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT**

**ALEXANDER/BANNATYNE COMBINED SEWER RELIEF CONTRACT 1B**

**OVERFLOW STRUCTURE**

STRUCTURAL PLANS & SECTIONS

BID OPPORTUNITY NO. 137-2005

SHEET 16 OF 18

CITY DRAWING NUMBER

REV 0

**LD-3130**

**METRIC**  
WHOLE NUMBERS INDICATE MILLIMETRES  
DECIMALIZED NUMBERS INDICATE METRES

**UMA | AECOM**

2005 UMA ENGINEERING LTD. ALL RIGHTS RESERVED.