


- NOTES:**
1. PROVIDE TWO (2) HOLE LONG BARREL COMPRESSION LUGS FOR CABLE CONNECTION TO SECONDARY TERMINALS ON EXISTING TRANSFORMER. MODIFY CONNECTION TERMINATIONS AS REQUIRED.

**1 PART PLAN - DISTRIBUTION**  
E003 SCALE 1:100

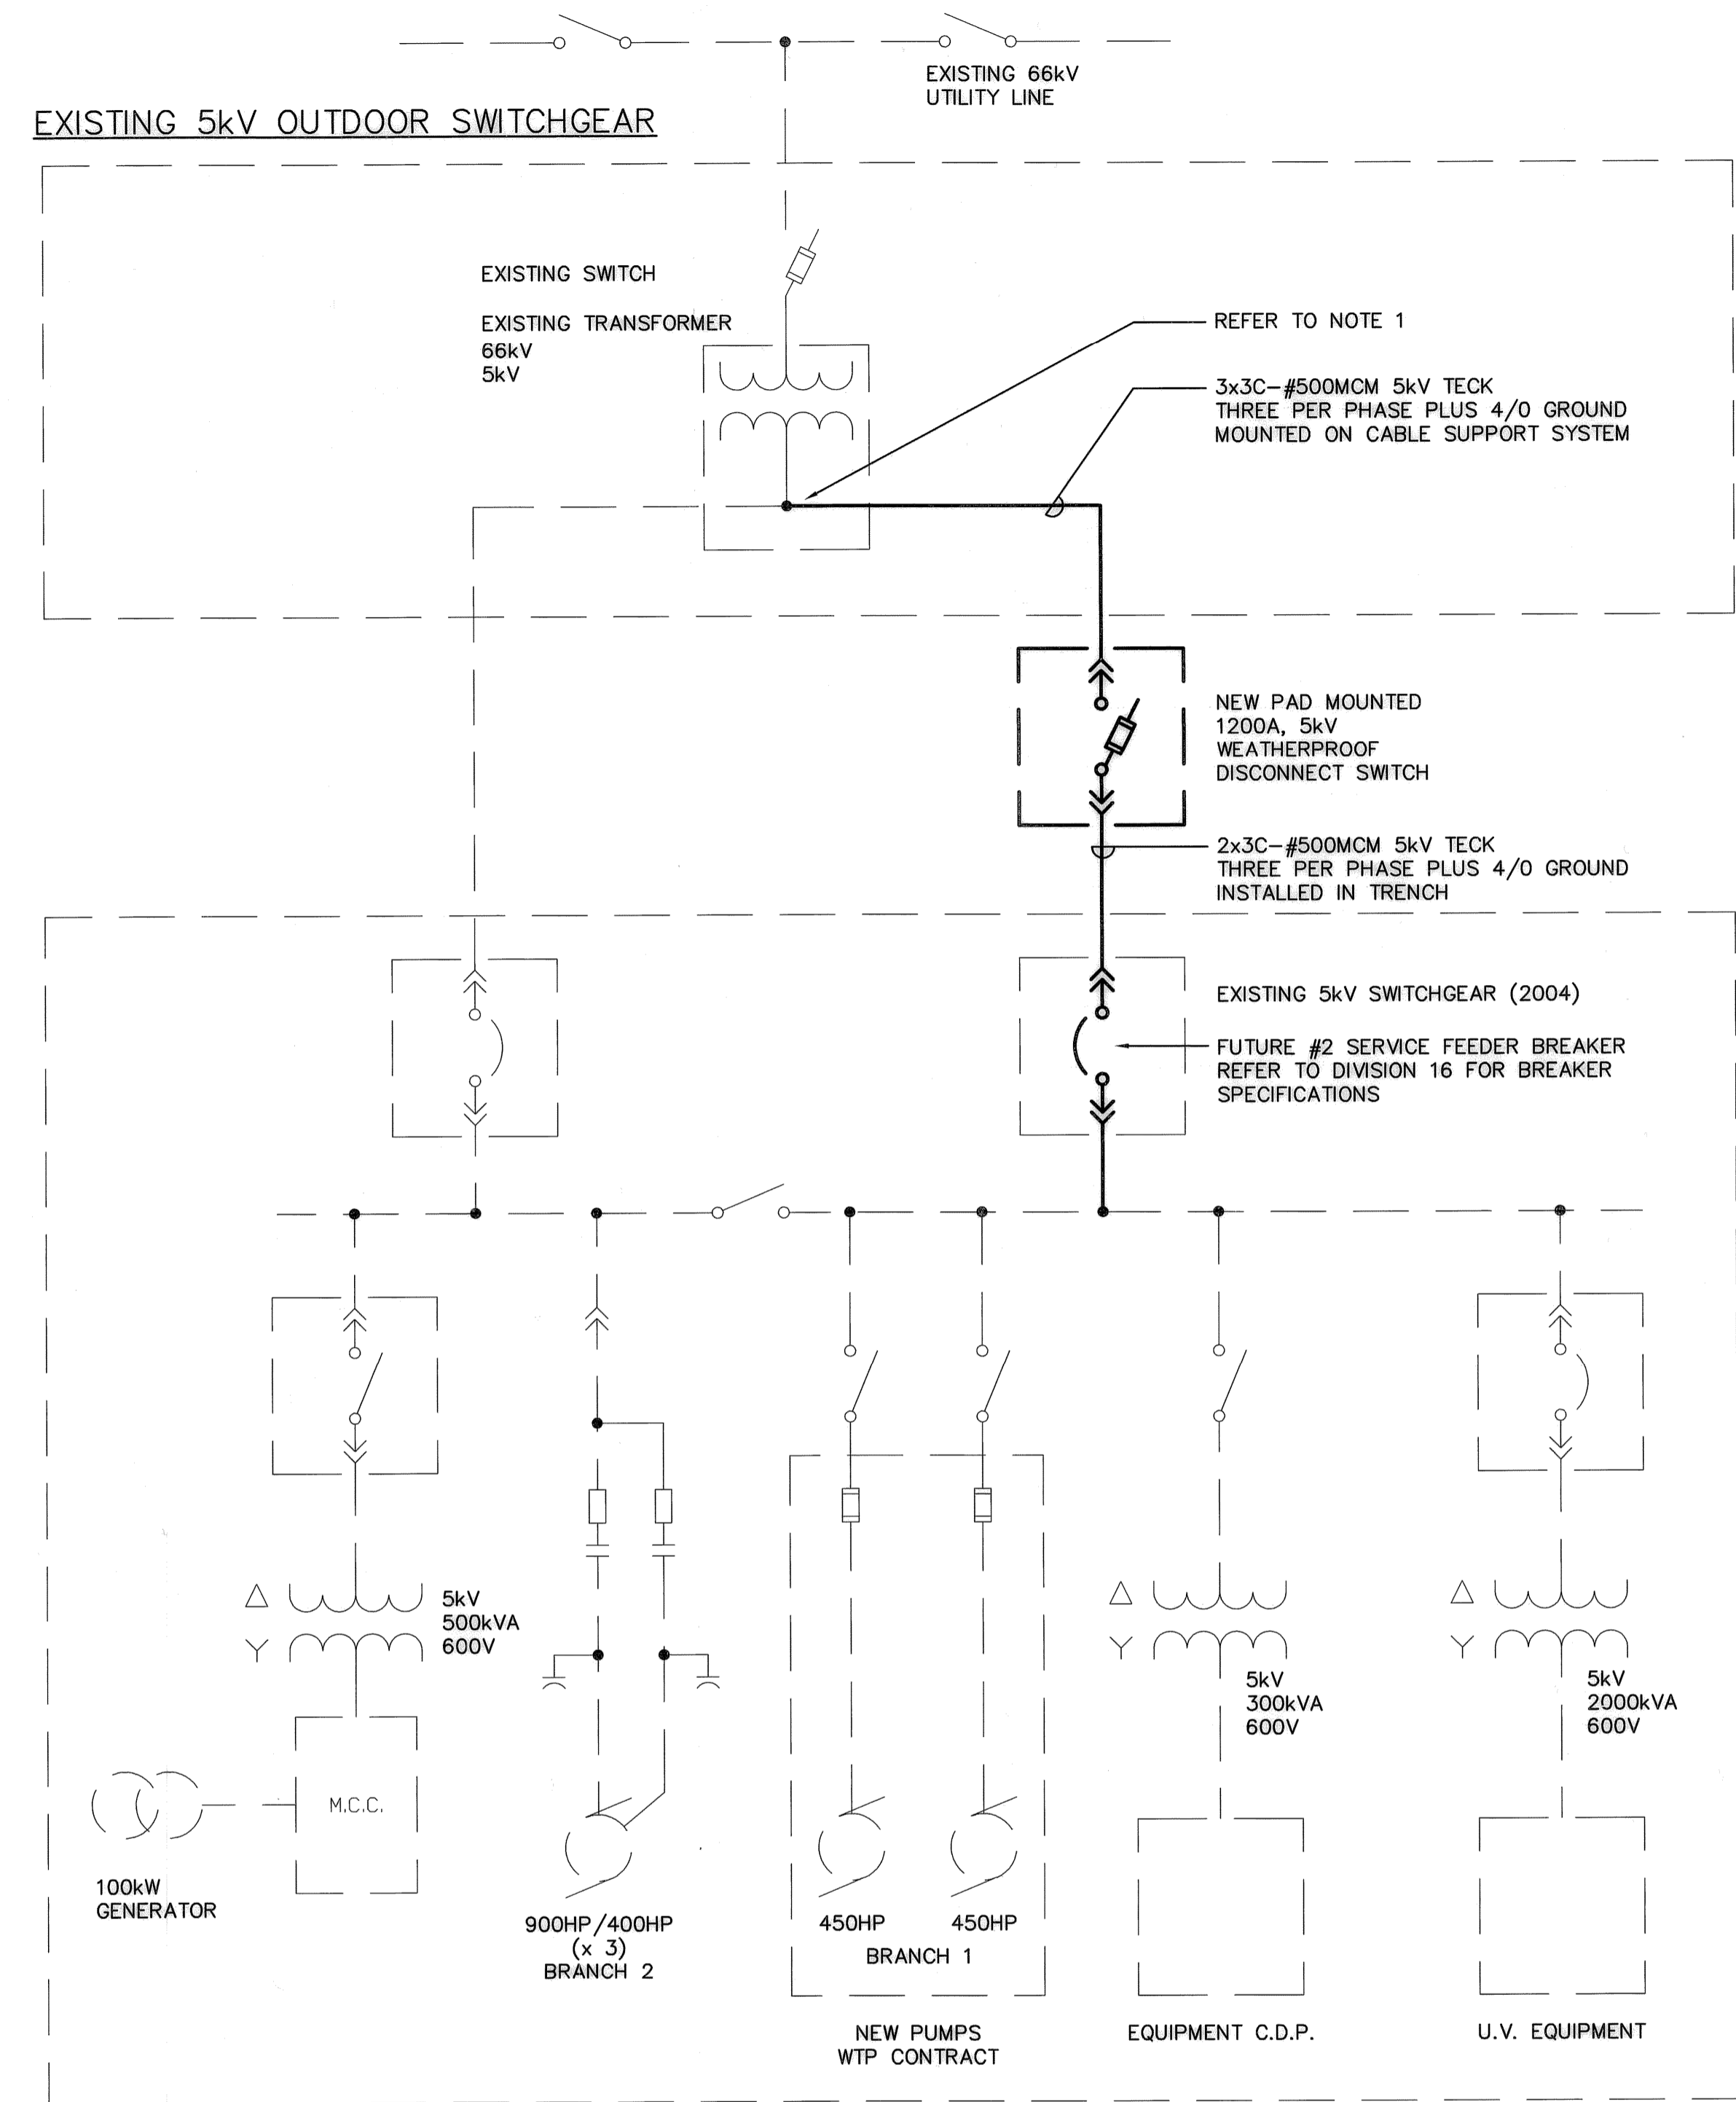

EXISTING DEACON PUMPING STATION

NORTH MEZZANINE FLOOR  
NOT TO SCALE



|            |                   |          |     |
|------------|-------------------|----------|-----|
| B.M. ELEV. |                   |          |     |
|            |                   |          |     |
|            |                   |          |     |
|            |                   |          |     |
|            |                   |          |     |
| 0          | ISSUED FOR TENDER | 05/03/01 | CPG |
|            | REVISIONS         | DATE     | BY  |

**CH2MHILL**  
Frederickson Cooper ARCHITECTS

**EarthTech**  
A Tyco International Ltd. Company  
**uma**

DESIGNED BY PS  
CHECKED BY PS  
DRAWN BY CPG  
APPROVED BY *[Signature]*  
HOR. SCALE: NTS  
VERTICAL SCALE: NTS  
RELEASED FOR CONSTRUCTION  
*[Signature]*  
DATE 2005/02/02

ENGINEER'S SEAL  
PROVINCE OF MANITOBA  
P. STRYK  
REGISTERED PROFESSIONAL ENGINEER  
CONSULTANT DRAWING NO. WM-E004

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT  
ENGINEERING DIVISION

WINNIPEG WATER TREATMENT PROGRAM  
DBPS ELECTRICAL TEMPORARY SERVICE

ELECTRICAL  
TEMPORARY FEED CONNECTION PLAN AND  
SINGLE LINE DIAGRAM

CITY FILE NUMBER  
SHEET 3 OF 3  
CITY DRAWING NUMBER  
1-060M-A-E0004-001-00D