


**APPLICATION NOTES** 1. SEEP RING REQ'D ONLY FOR PENETRATION IN WET AREAS OR BELOW GRADE. 2. LIQUID SIDE MUST PASS LEAKAGE TEST UNDER PRESSURE TO WHICH STRUCTURE IS SUBJECTED 3. FOR PENETRATIONS THROUGH EXISTING STRUCTURES CORE AND INSTALL SEAL PER MANUFACTURER'S SPEC'S (NO SLEEVE 4. SUPPORT PIPE ON BOTH SIDES OF WALL PENETRATION.


5. USE STAINLESS STEEL HARDWARE.

WALL & FLOOR PENETRATION NO. 4

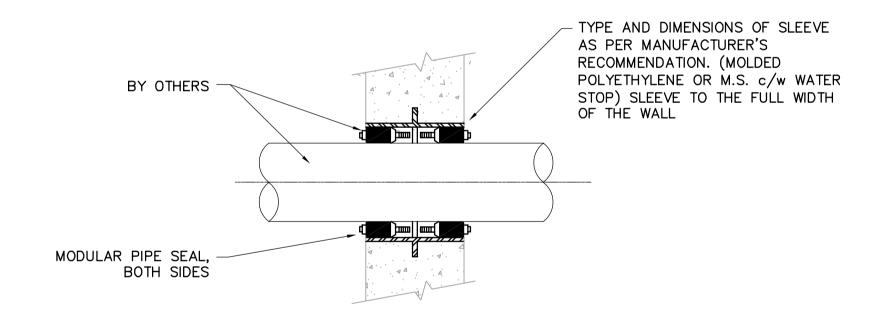

1. SEEP RING REQ'D ONLY FOR PENETRATION IN WET AREAS OR BELOW 2. LIQUID SIDE MUST PASS LEAKAGE TEST UNDER PRESSURE TO WHICH STRUCTURE IS SUBJECTED 3. FOR PENETRATIONS THROUGH EXISTING STRUCTURES CORE AND INSTALL SEAL PER MANUFACTURER'S SPEC'S (NO SLEEVE REQUIRED) 4. SUPPORT PIPE ON BOTH SIDES OF WALL PENETRATION. 5. USE STAINLESS STEEL HARDWARE.



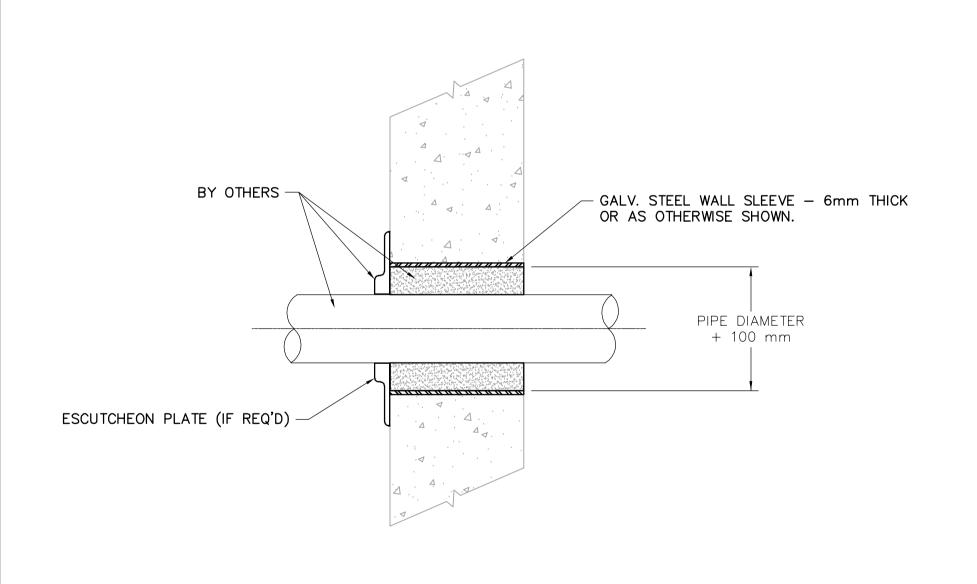

WALL PENETRATION NO. 6

	B.M. ELEV.		Freder	ch2MHILL rickson Cooper	Earth Tech A Tyco International Ltd. Company	ENGINEER'S SEAL  ORIGINAL SIGNED BY	Winnipeg WATER AND WASTE DEF
Certificate of Authorization			DESIGNED BY	DC	CHECKED BY JS	P. WÖBMA	WATER TREATMENT PLANT
CH2M HILL Canada Ltd.			DRAWN BY	EK	APPROVED DJT	2006/02/06	MAIN BUILDING MECHANICAL AND ELECTRICAL
No. 1441 Expiry: April 30, 2007		5 DC 03 DC	SCALE:	NONE	RELEASED FOR CONSTRUCTION BY:  R. SOROKOWSKI	CONSULTANT DRAWING NO.	PROCESS MECHANICAL
	NO. REVISIONS DATE		DATE	2005/09/12	DATE 2006/02/08	WB-M9451	STANDARD DETAILS

THE CITY OF WINNIPEG

CITY FILE NUMBER

OF

1-0601B-A-M9451-001-01D

CITY DRAWING NUMBER

SHEET

WATER AND WASTE DEPARTMENT

Last Save: 2006-05-04 10:58 AM