
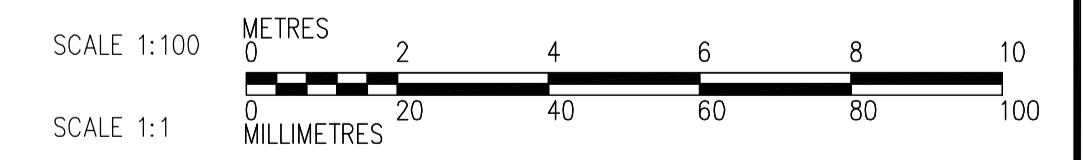


NOTES:
 1. PROVIDE STAIRWELL SMOKE DETECTORS AS SHOWN ON FIRE PROTECTION DRAWINGS

ROOF FACILITY PLAN
 1:100

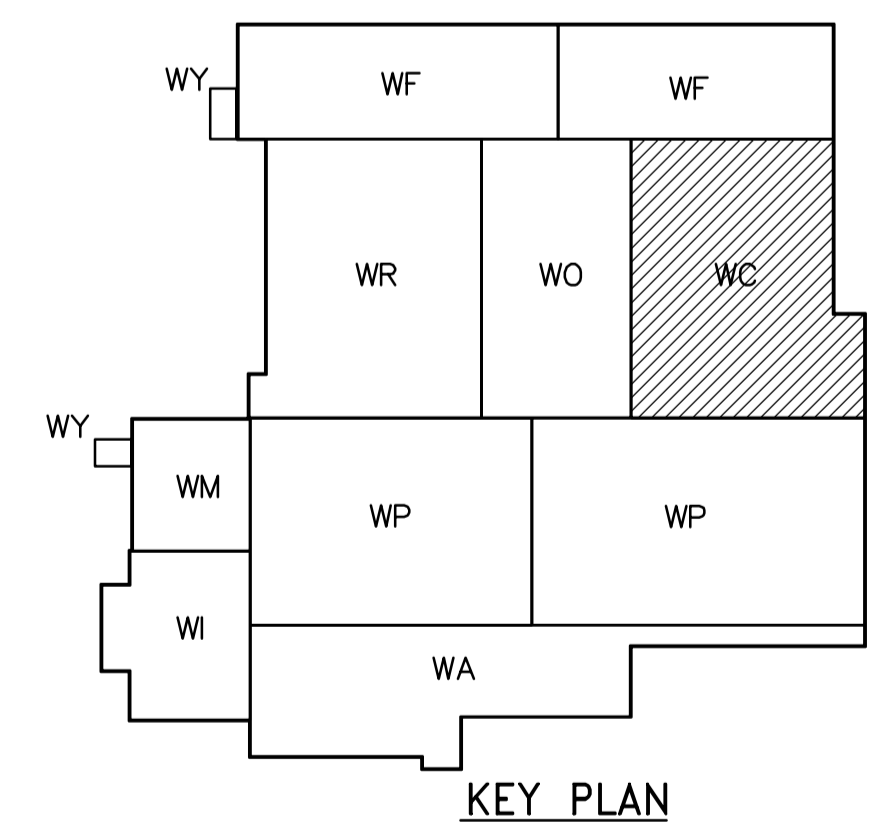

ROOF FACILITY PLAN
 1:100

APEGN
 Certificate of Authorization
 CH2M HILL Canada Ltd.
 No. 1441 Expiry: April 30, 2007

NO.	REVISIONS	DATE	BY
01	742-2005 ADDENDUM 3	06/05/05	LL
00	ISSUED FOR TENDER	06/03/29	LL

DESIGNED BY	LL	CHECKED BY	ND
DRAWN BY	TL	APPROVED BY	AHL
SCALE:	1:100	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2006/02/11	DATE	2006/03/29

ENGINEER'S SEAL
 ORIGINAL SIGNED BY
 L.D. LLEWELLYN
 2006/03/29
 CONSULTANT DRAWING NO.
 WC-E0145

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 ENGINEERING DIVISION

WATER TREATMENT PLANT
 CHEMICAL FEED SYSTEMS
 MECHANICAL AND ELECTRICAL

ELECTICAL
 CHEMICAL AREA
 ROOF FACILITY PLAN

CITY FILE NUMBER
 SHEET OF
 CITY DRAWING NUMBER
 1-0601C-A-E0145-001-01D