

REF. NORTH

NOTES:

- 1. ALL 120V AND 208V LOADS ARE FED FROM LP-R21.
- 2. MOUNT TYPE A LUMINAIRE AT 3.0m ABOVE THE FLOOR.

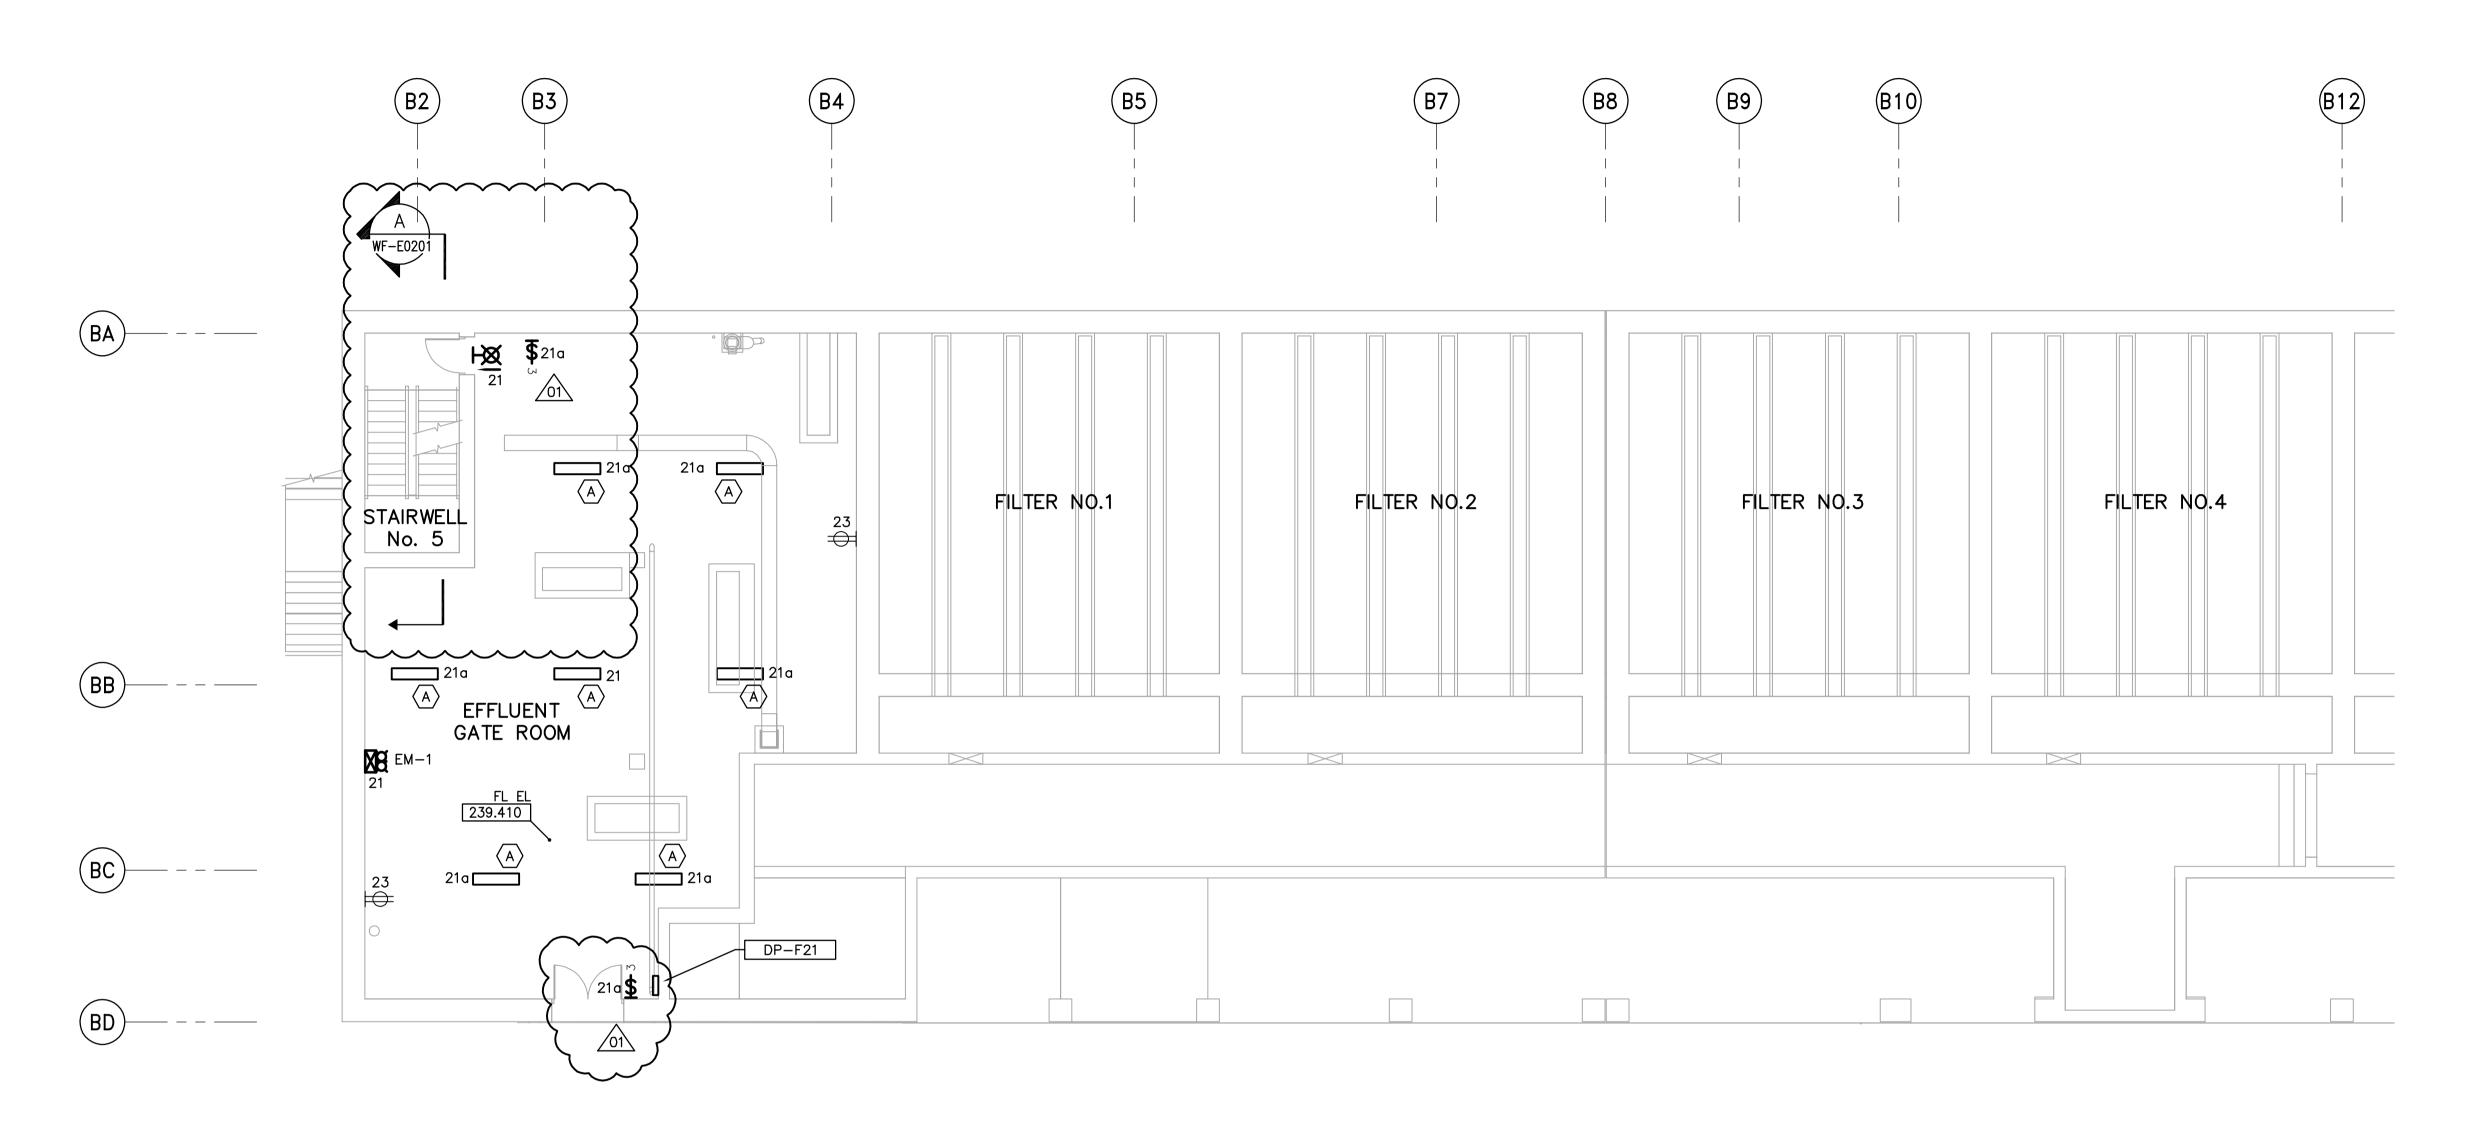

SECOND FLOOR POWER AND LIGHTING PLAN (AREA 1)
1:100

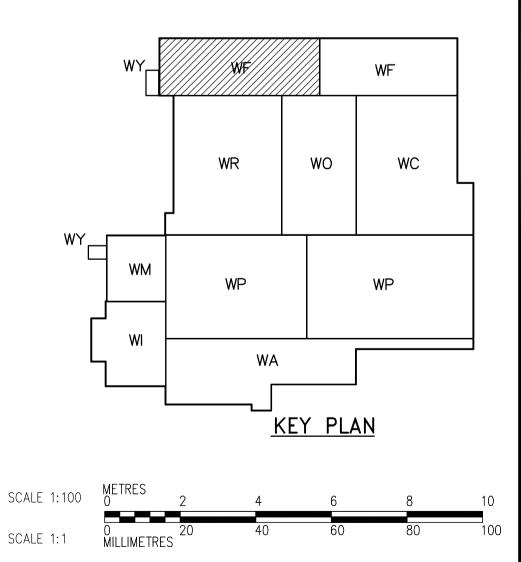

<u> </u>	1	B.M. ELEV.			CH2MHILL rederickson Cooper	EarthTech A Tyco International Ltd. Company	ENGINEER'S SEAL ORIGINAL SIGNED BY	THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT ENGINEERING DIVISION	
Certificate of Authorization CH2M HILL Canada Ltd.				DESIG BY DRAW BY	LL	CHECKED ND APPROVED AHL	L.D. LLÉWELLYN 2006/03/29	WATER TREATMENT PLANT FILTRATION MECHANICAL AND ELECTRICAL	OF
No. 1441 Expiry: April 30, 2007	01 00 NO.	ISSUED FOR TENDER 06	6/05/05 6/03/29 DATE E		2005/07/08	RELEASED FOR CONSTRUCTION BY: R. SOROKOWSKI DATE 2006/03/29	CONSULTANT DRAWING NO. WF-E0125	ELECTRICAL ELECTRICAL	-A-E0125-001-01D