SHEET: COW-A1 (05/2005)

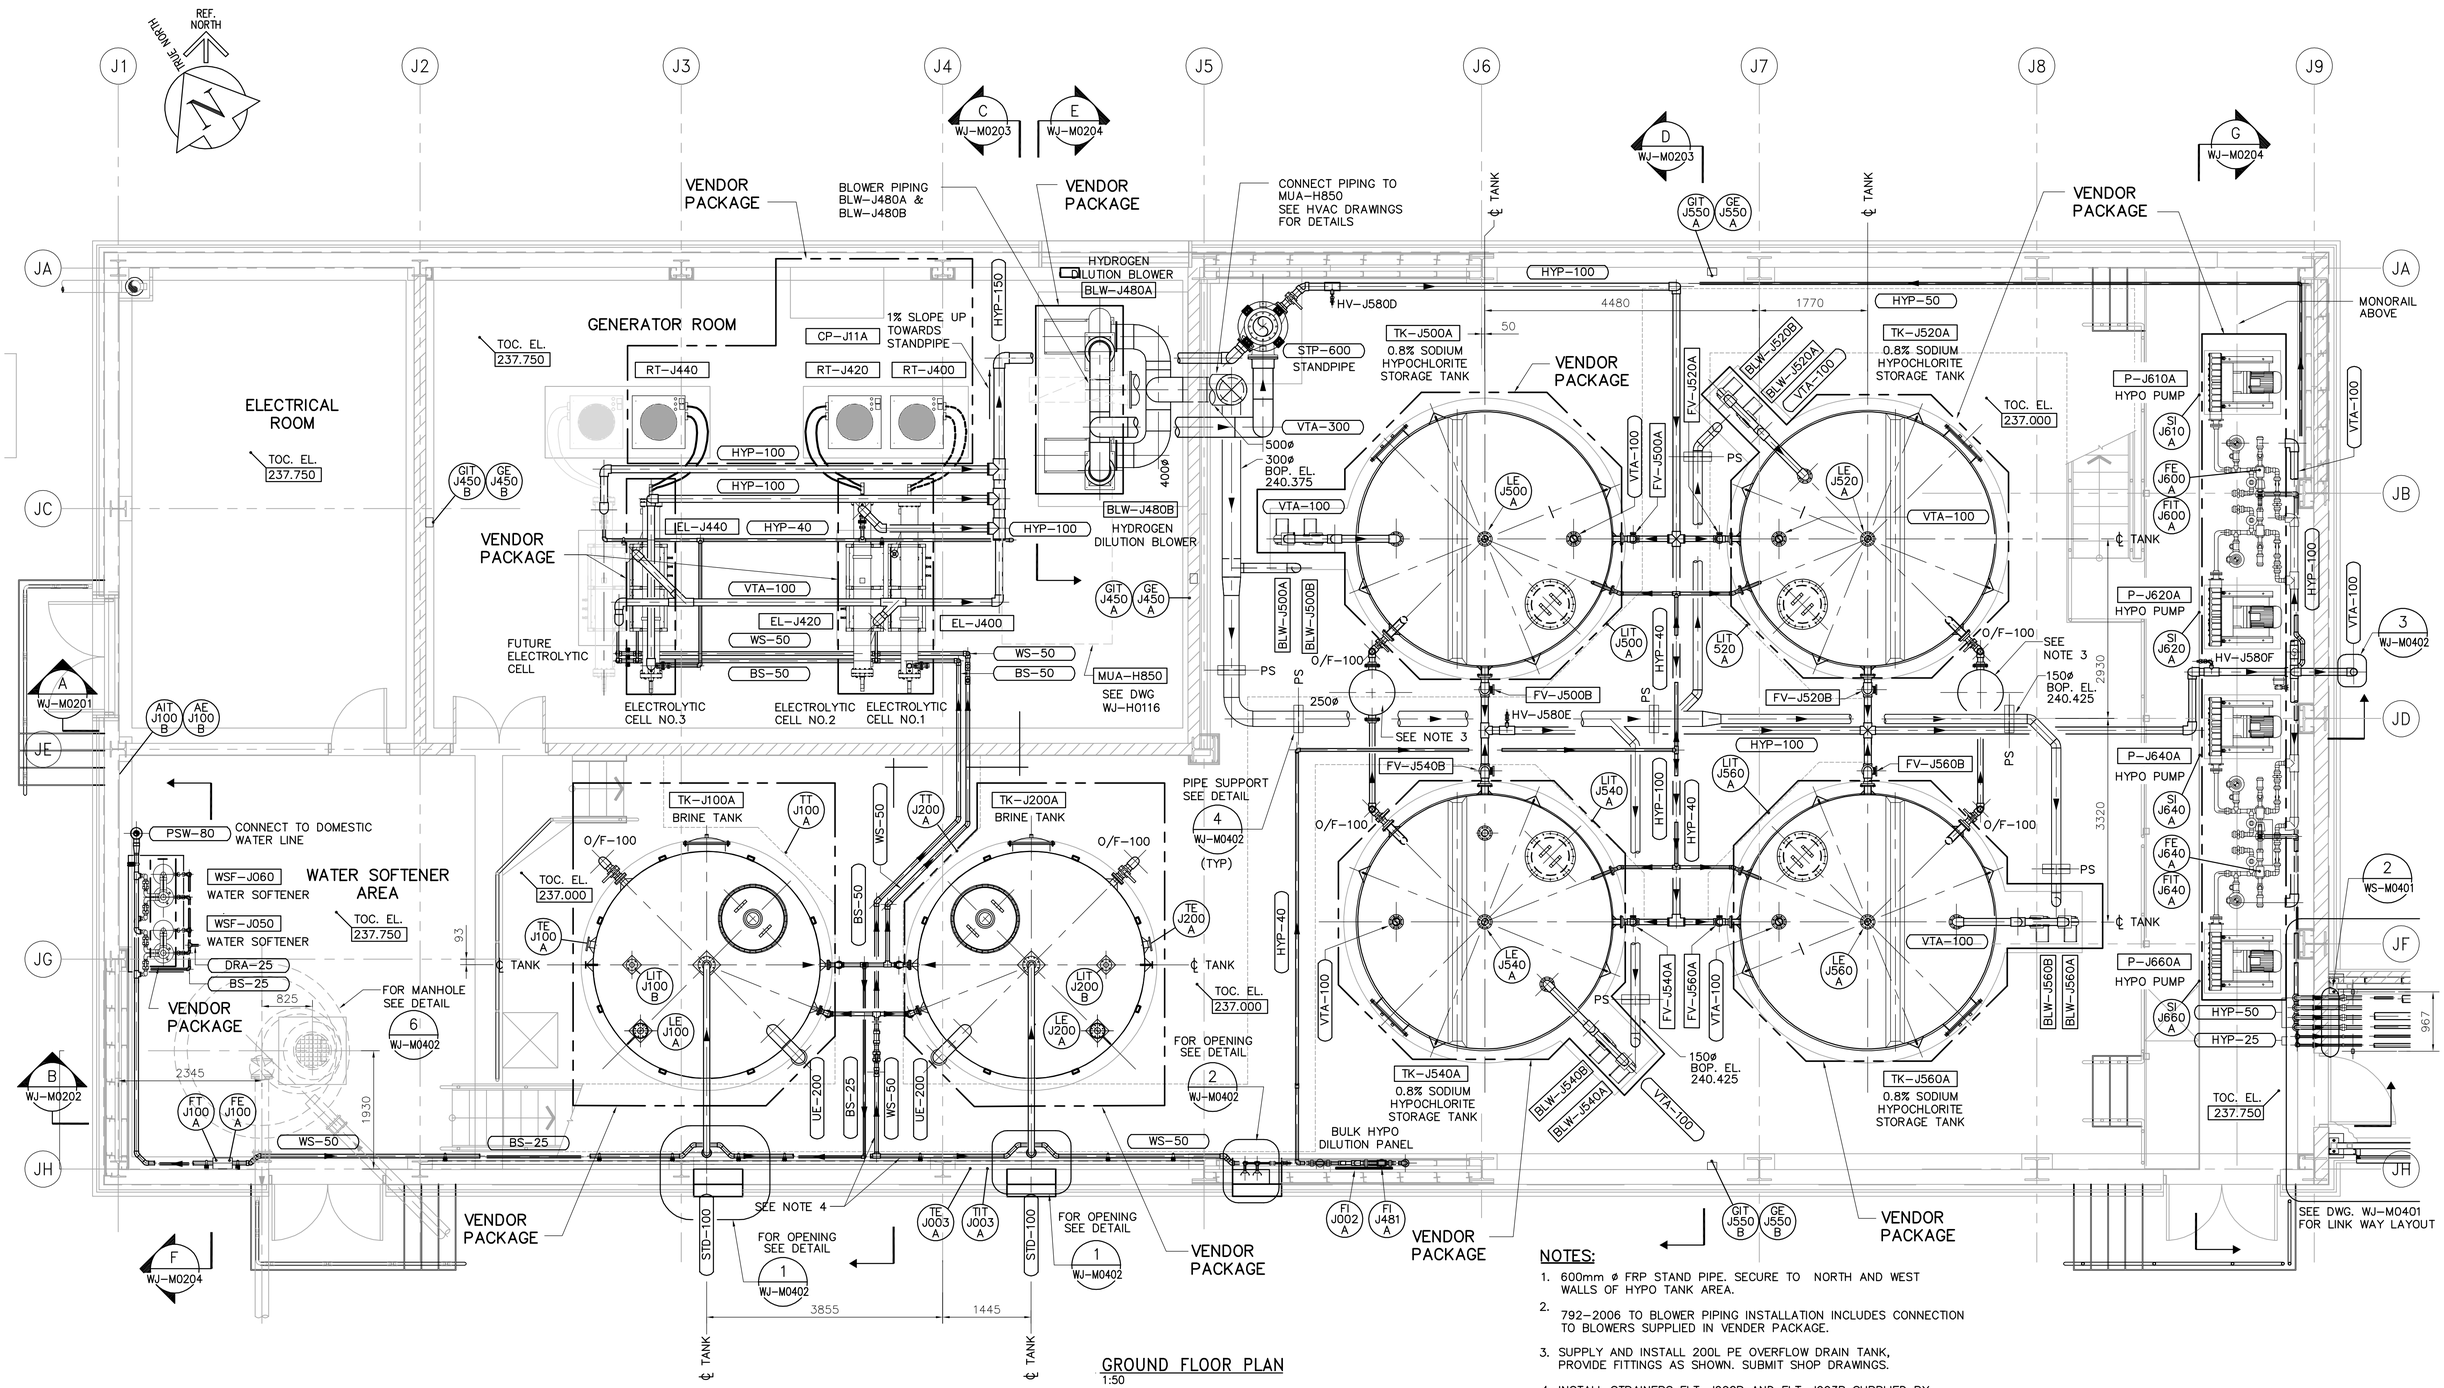

GROUND FLOOR PLAN
1:50

NOTES:

1. 600mm ø FRP STAND PIPE. SECURE TO NORTH AND WEST WALLS OF HYPO TANK AREA.
2. 792-2006 TO BLOWER PIPING INSTALLATION INCLUDES CONNECTION TO BLOWERS SUPPLIED IN VENDER PACKAGE.
3. SUPPLY AND INSTALL 200L PE OVERFLOW DRAIN TANK, PROVIDE FITTINGS AS SHOWN. SUBMIT SHOP DRAWINGS.
4. INSTALL STRAINERS FLT-J002B AND FLT-J003B SUPPLIED BY VENDER PACKAGE. STRAINER BYPASS PIPING AND VALVES TO BE SUPPLIED AND INSTALLED AS SHOWN ON VENDER PACKAGE DRAWING CPG0465-1-01. BYPASS VALVES TO BE INSTALLED INCLUDE HV-J002A, HV-J002D, HV-J003A, HV-J003C AND HV-J003D.
5. ALL PIPING OUTSIDE OF VENDOR PACKAGE TO BE SUPPLIED AND INSTALLED UNDER 792-2006.

SCALE 1:50 METRES 0 1 2 3 4 5
SCALE 1:1 MILLIMETRES 0 20 40 60 80 100

APEGM
Certificate of Authorization
CH2M HILL Canada Ltd.
No. 1441 Expiry: April 30, 2007

NO.	REVISIONS	DATE	BY
00	ISSUED FOR TENDER	07/01/31	KS

B.M. ELEV.

CH2MHILL
Fredericksen Cooper ARCHITECTS
EarthTech A Tyco International Ltd. Company

DESIGNED BY	KS	CHECKED BY	NN
DRAWN BY	PM	APPROVED BY	AHL
SCALE:	1:50	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2006/08/14	DATE	2007/01/31

ENGINEER'S SEAL
ORIGINAL SIGNED BY
P. WOBMA
2007/01/31

CONSULTANT DRAWING NO.
WJ-M0111

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

WATER TREATMENT PLANT
SODIUM HYPOCHLORITE BUILDING
SODIUM HYPOCHLORITE AND CHEMICAL STORAGE BUILDINGS

PROCESS MECHANICAL
SODIUM HYPOCHLORITE BUILDING
GROUND FLOOR PLAN

CITY FILE NUMBER
SHEET OF
CITY DRAWING NUMBER
1-0601J-A-M0111-001-00D

Last Save: 2007-02-22 1:37 PM

C:\DOCUMENTS AND SETTINGS\SEVERITT\MY DOCUMENTS\NDMPROJ\321352 - WINNIPEGWTP\DN_WJ-M0111_CH2M.DWG