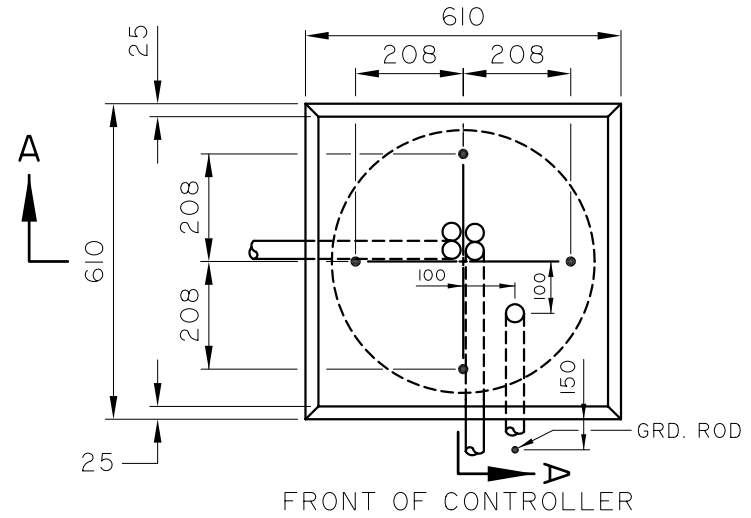

PLAN VIEW

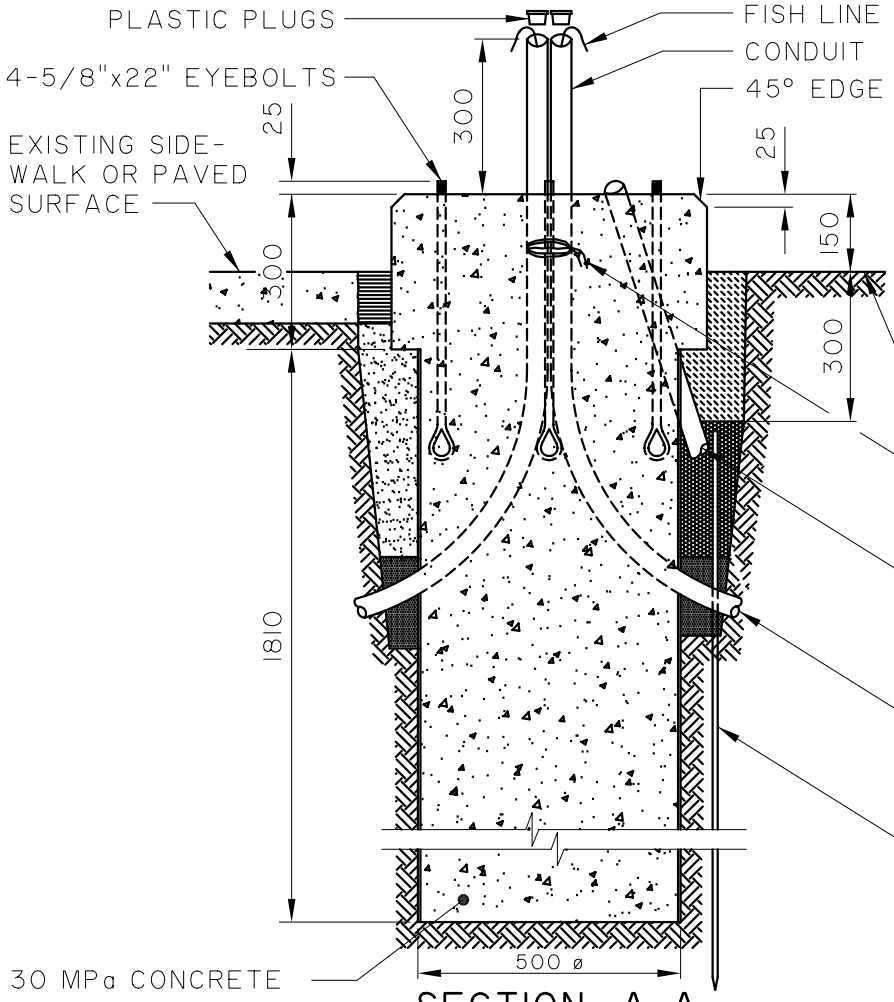

SECTION A-A

NOTES:

1. 500 mm ø forming tubes, metal square top form (supplied by the contractor) and anchor bolt templete shall be used. (Drawing ST-118)
2. Threaded portion of anchor eyebolts shall be coated with oil prior to concrete pour.
3. All conduits shall be bundled into a group in centre of base, and tied together below the top of the base prior to concrete pour.
4. Terminate conduits a minimum of 300 mm above base.
5. Install ground rod in every base.
6. Contractor shall remove plywood top forms, and salvage nuts and anchor eyebolt template following a minimum 24 hour concrete curing period.
7. Backfill shall conform to requirements of drawings No. ST-101, "standard beddings and backfills for Underground Traffic Signals Works".

DIMENSIONS ARE IN MILLIMETRES
(Unless otherwise noted)

Winnipeg

THE CITY OF WINNIPEG

PUBLIC WORKS DEPARTMENT
TRANSPORTATION DIVISION

Reference Spec. No.
CW 3620-R5

Revisions

No.	Date	Description	By
1	92/4/19	RELOCATED GROUND ROD	

CONCRETE CONTROLLER BASE

Designed By: C.K.	Drawn By: A.R.	Scale : N.T.S.
Checked By:	Date: 95 - 03 - 01	Drawing No. ST-20-A
Approved:		