




CONT'D ON DWG. 1-0101M-A-E0009-002

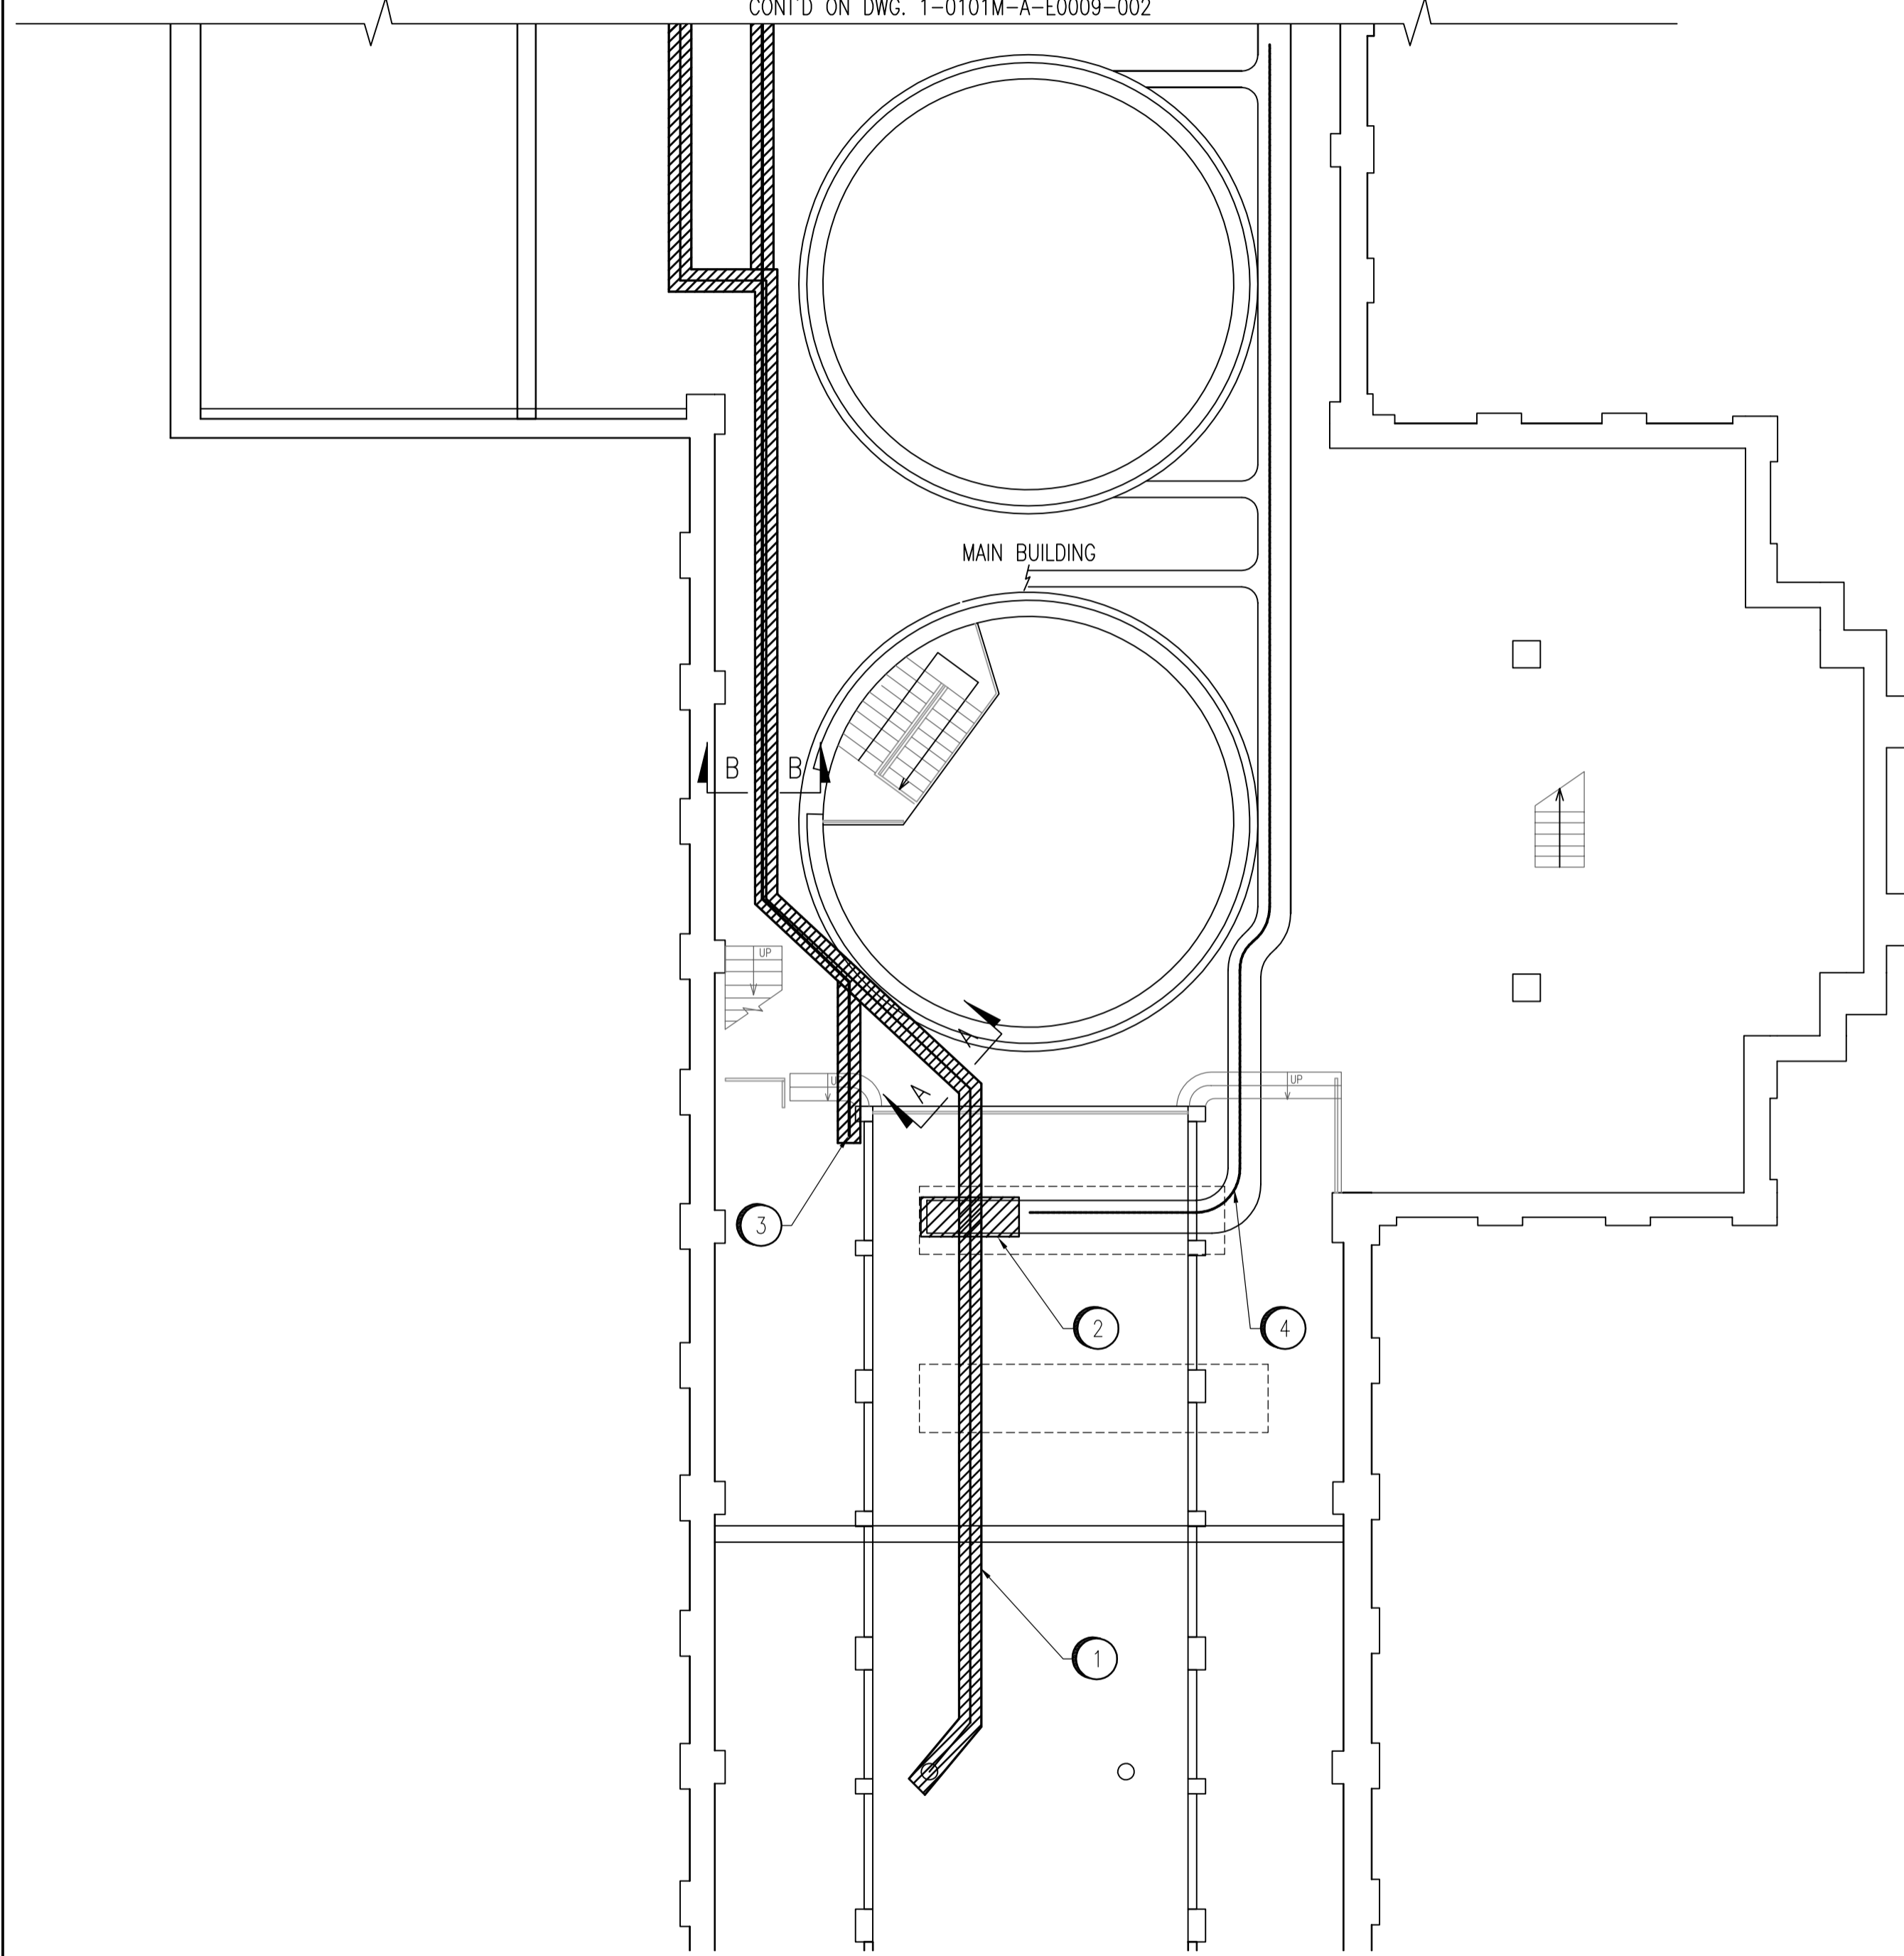

MAIN BUILDING PLAN
1:100

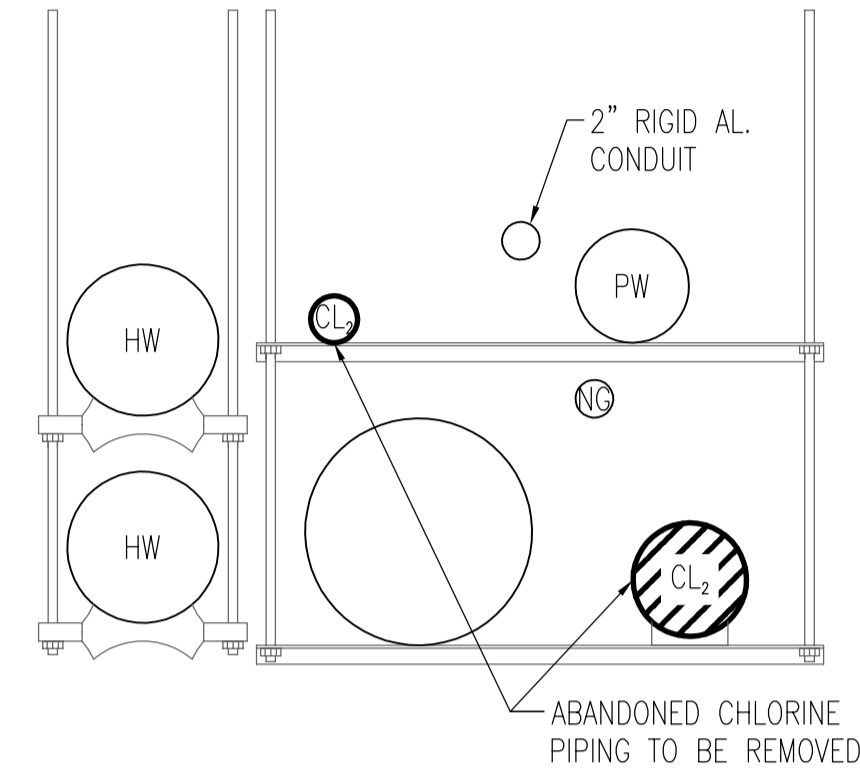



A PIPE RACK SECTION
1:10

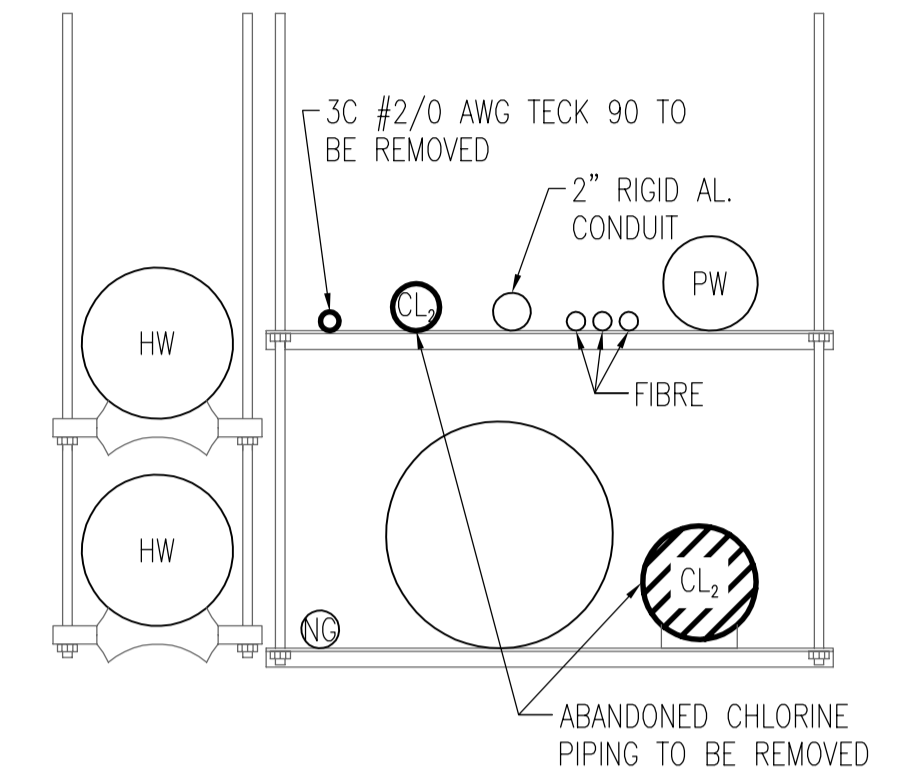

B PIPE RACK SECTION
1:10



NO.	DRAWING NOTES
1	REMOVE ABANDONED 150ø AND 65ø CHLORINE PIPING FROM CHLORINE ROOM TO MAIN BUILDING LABORATORY BASEMENT AREA. PRIOR TO OPENING ANY CLOSED CHLORINE PIPING, TEST FOR RESIDUAL CHLORINE AND VENTILATE OR FLUSH AS REQUIRED TO ENSURE THAT SIGNIFICANT CONCENTRATIONS OF CHLORINE GAS ARE NOT RELEASED INTO THE BUILDING.
2	REMOVE EXISTING 600mm CABLE TRAY BELOW SWITCHGEAR LB3 AS SHOWN.
3	REMOVE 3C #2/0 AWG TECK CABLE FROM MAIN BLDG. ELECTRICAL ROOM MCC-M TO 75kVA XFMR. COORDINATE WITH INSTALLATION OF NEW CABLE TO MINIMIZE POWER DISRUPTION TO THE SERVICED LOAD.
4	REMOVE EXISTING 500 MCM 5 kV BANK 1 AND BANK 2 CABLES AFTER COMMISSIONING OF THE NEW BANK 1 FEEDER IS COMPLETE.

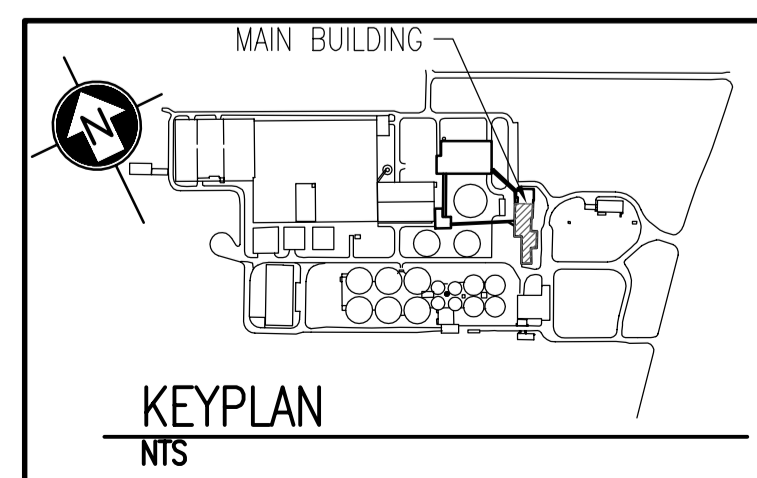

B.M. ELEV.	FIELD BOOK #:		
POSTED TO LBIS		DESIGNED BY C. REIMER	CHECKED BY C. ASMUNDSON
		DRAWN BY A. OLIVER	APPROVED BY C. REIMER
		HOR. SCALE 1:100	RELEASED FOR CONSTRUCTION
01 REVISED DRAWING SCALE	2007/07/11	DATE 2007/03/08	DATE
00 ISSUED FOR TENDER	2007/06/22	FILENAME: 1-0101M-A-E0009-001-00D.dwg	
NO. REVISIONS	DATE	BY	

ENGINEER'S SEAL
PRELIMINARY
NOT TO BE USED FOR CONSTRUCTION

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NORTH END WATER POLLUTION CONTROL CENTRE
MAIN BUILDING FEEDER REPLACEMENTS
DEMOLITION PLAN
MAIN BUILDING BASEMENT

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0101M-A-E0009	001	01	D