




CONT'D ON DWG. 1-0101M-A-E0009-002

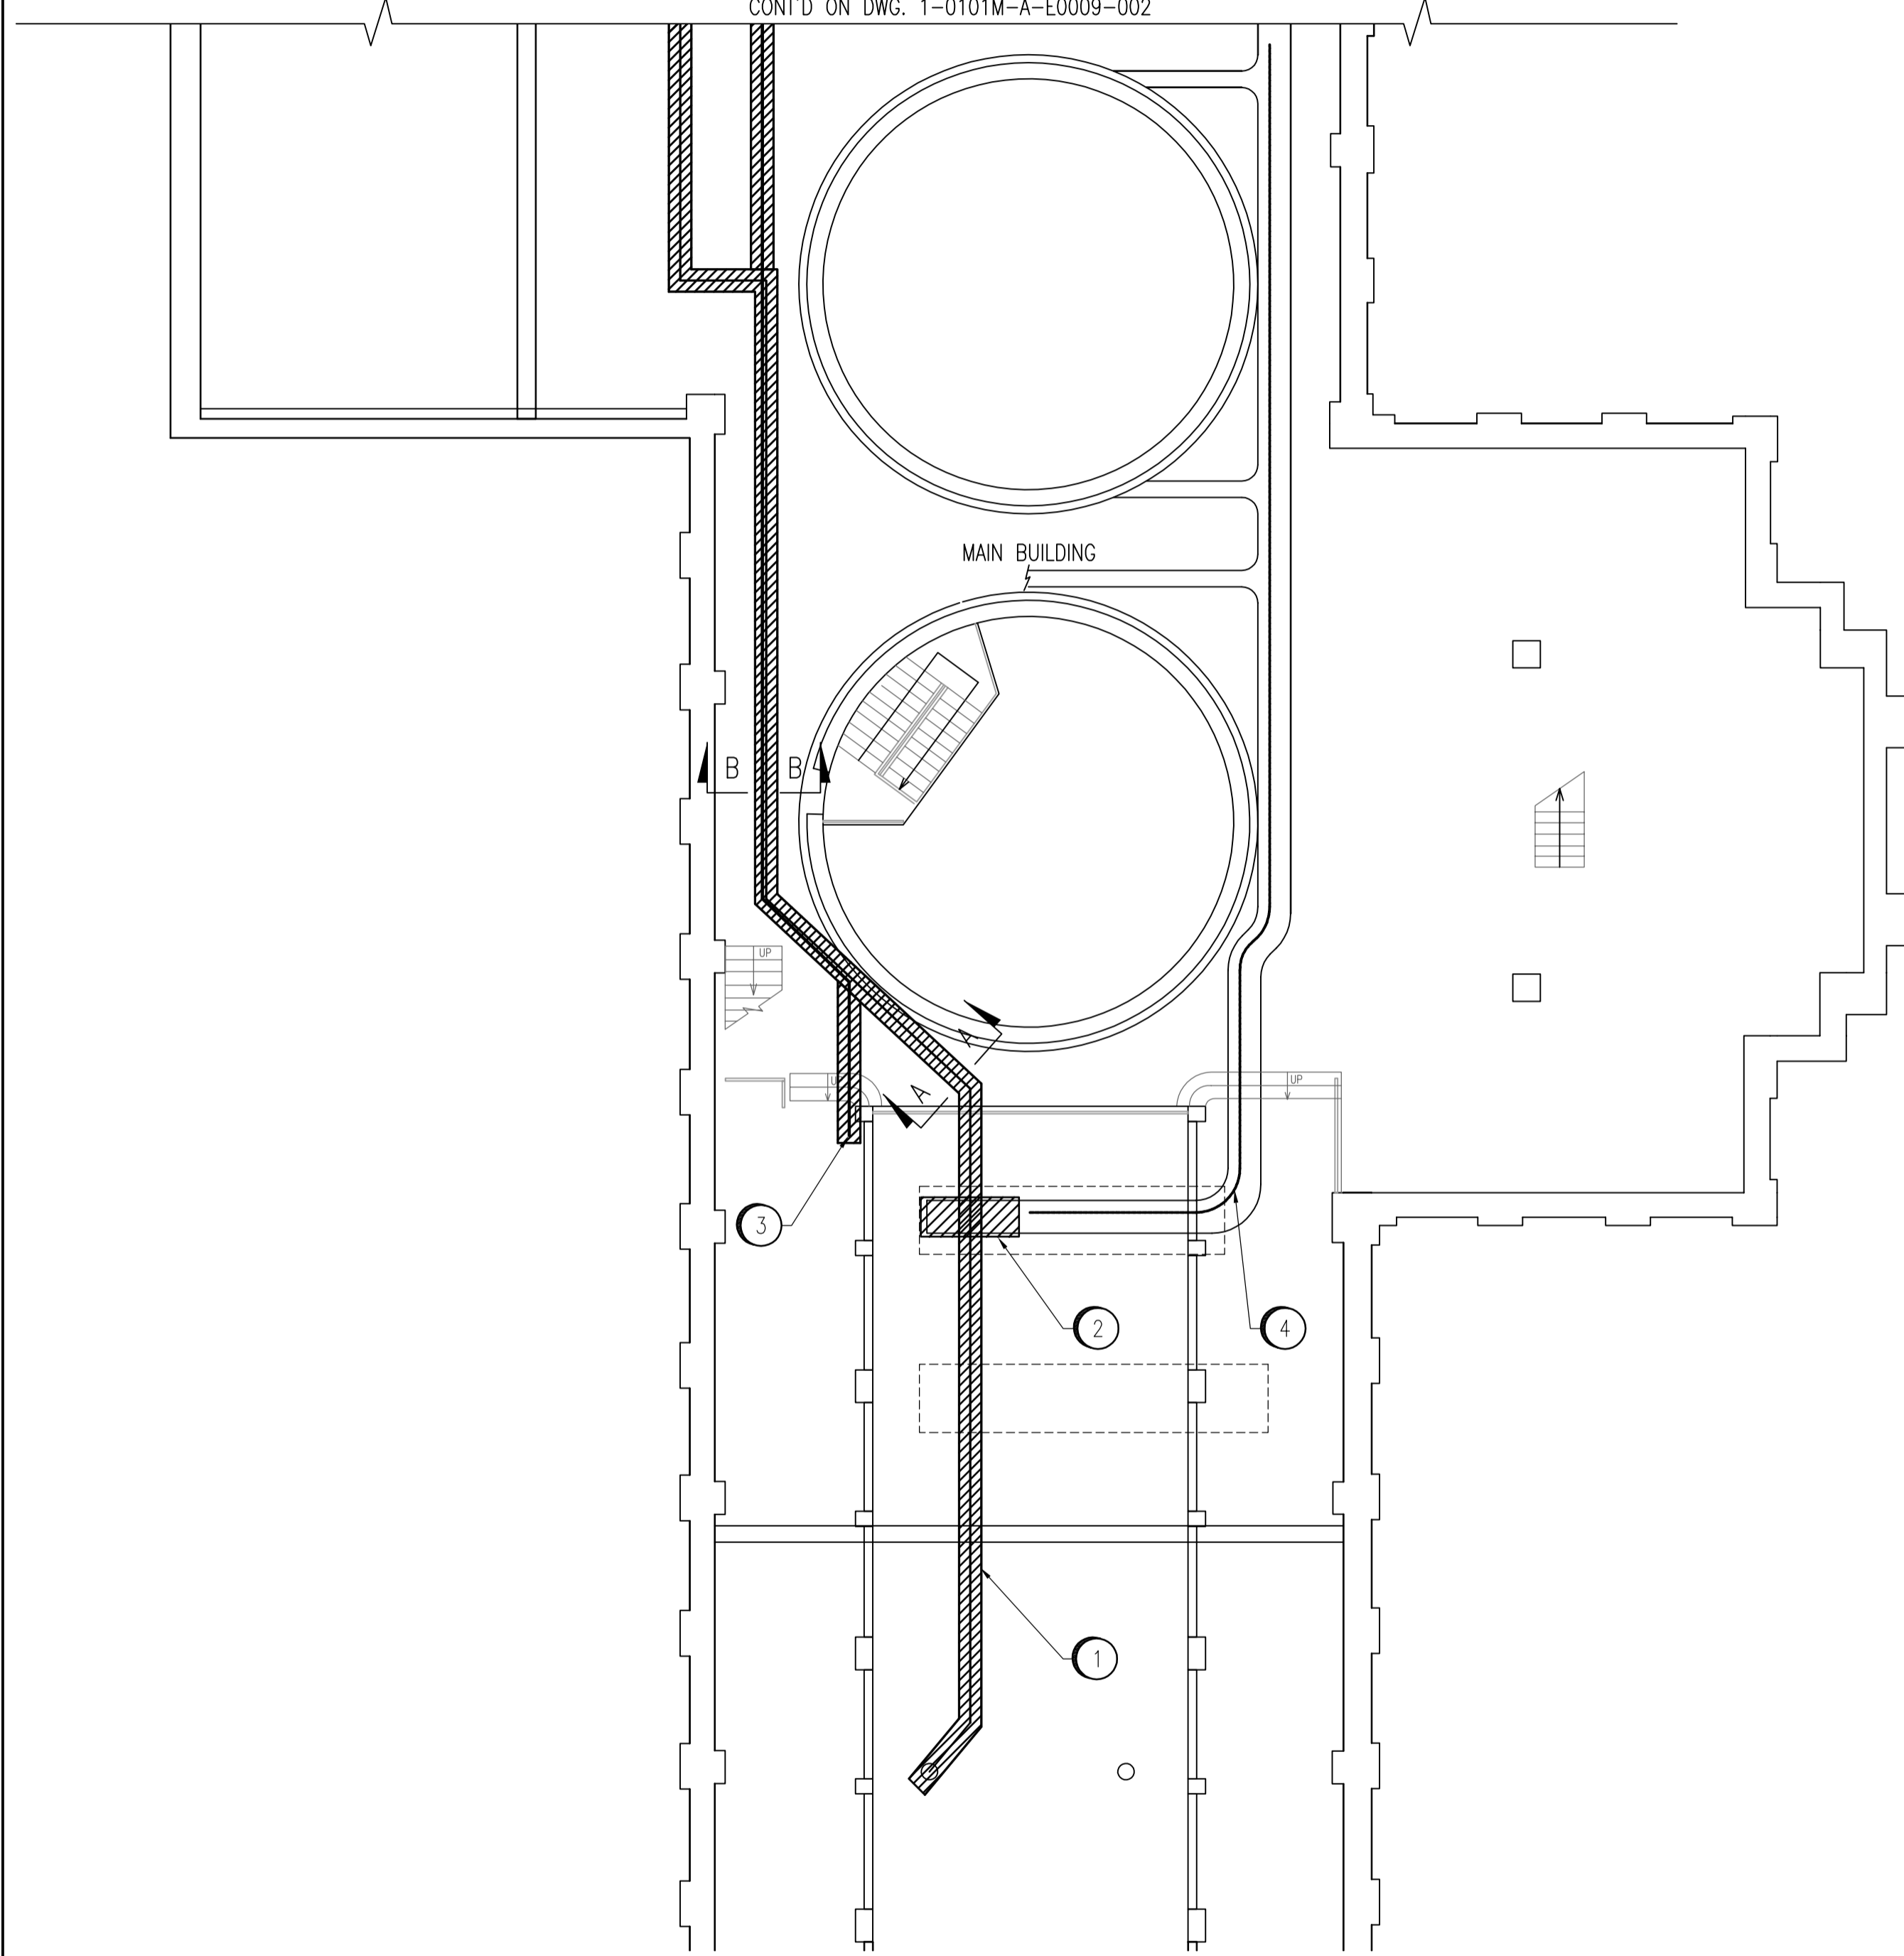


MAIN BUILDING PLAN
1:50

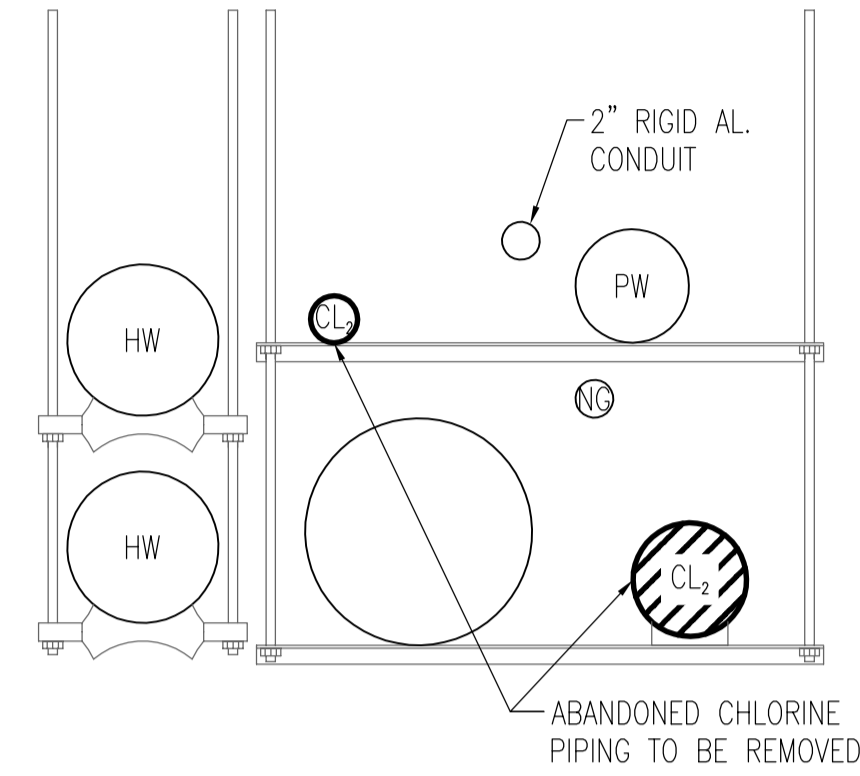

A PIPE RACK SECTION
1:10

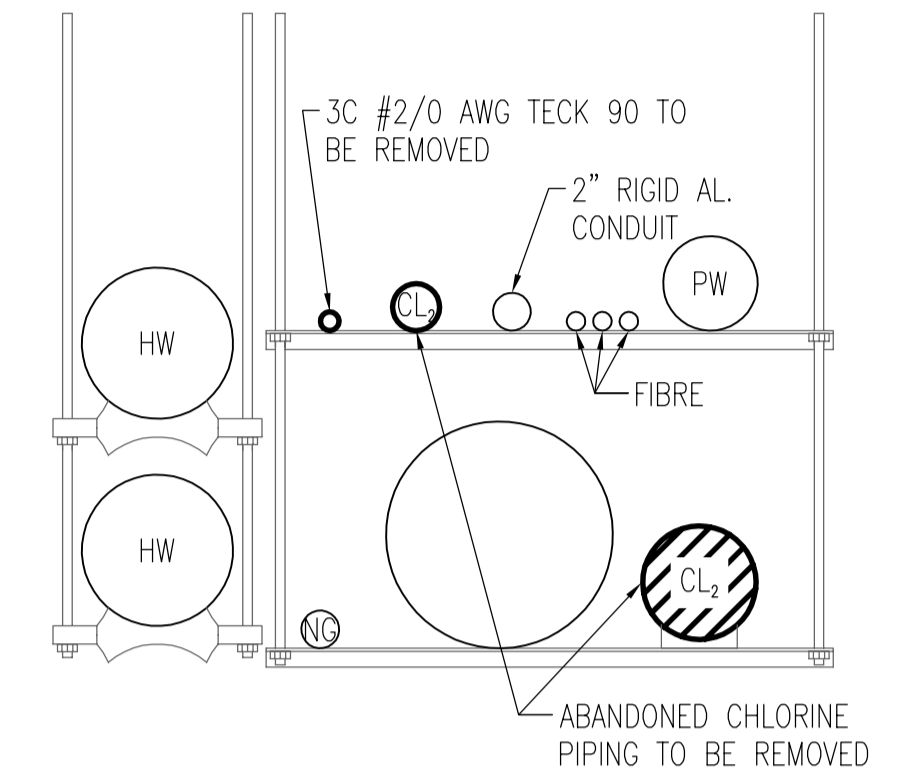

B PIPE RACK SECTION
1:10

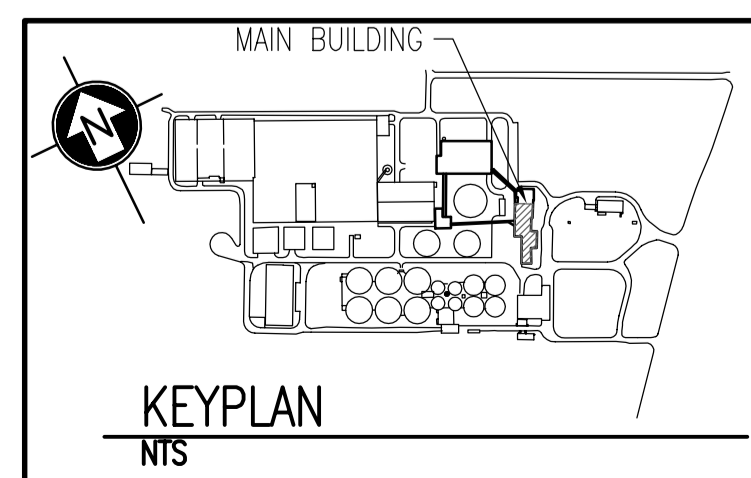

NO.	DRAWING NOTES
1	REMOVE ABANDONED 150Ø AND 65Ø CHLORINE PIPING FROM CHLORINE ROOM TO MAIN BUILDING LABORATORY BASEMENT AREA. PRIOR TO OPENING ANY CLOSED CHLORINE PIPING, TEST FOR RESIDUAL CHLORINE AND VENTILATE OR FLUSH AS REQUIRED TO ENSURE THAT SIGNIFICANT CONCENTRATIONS OF CHLORINE GAS ARE NOT RELEASED INTO THE BUILDING.
2	REMOVE EXISTING 600mm CABLE TRAY BELOW SWITCHGEAR LB3 AS SHOWN.
3	REMOVE 3C #2/0 AWG TECK CABLE FROM MAIN BLDG. ELECTRICAL ROOM MCC-M TO 75kVA XFMR. COORDINATE WITH INSTALLATION OF NEW CABLE TO MINIMIZE POWER DISRUPTION TO THE SERVICED LOAD.
4	REMOVE EXISTING 500 MCM 5 kV BANK 1 AND BANK 2 CABLES AFTER COMMISSIONING OF THE NEW BANK 1 FEEDER IS COMPLETE.

B.M. ELEV.	FIELD BOOK #:
POSTED TO LBIS	
DESIGNED BY C. REIMER	CHECKED BY C. ASMUNDSON
DRAWN BY A. OLIVER	APPROVED BY C. REIMER
HOR. SCALE 1:50	RELEASED FOR CONSTRUCTION
VERTICAL 1:50	
00 ISSUED FOR TENDER	2007/06/22 YOM DATE 2007/03/08 DATE
NO. REVISIONS	DATE BY FILENAME: 1-0101M-A-E0009-001-00D.dwg

SNC-LAVALIN Engineers & Constructors		SNC-LAVALIN 148 Nature Park Way Winnipeg, Manitoba Canada R2P 0X7	
DESIGNED BY	C. REIMER	CHECKED BY	C. ASMUNDSON
DRAWN BY	A. OLIVER	APPROVED BY	C. REIMER
HOR. SCALE	1:50	RELEASED FOR CONSTRUCTION	
VERTICAL	1:50		
00 ISSUED FOR TENDER	2007/06/22	DATE	2007/03/08
NO. REVISIONS	DATE BY	FILENAME:	1-0101M-A-E0009-001-00D.dwg

ENGINEER'S SEAL
PRELIMINARY
NOT TO BE USED FOR CONSTRUCTION

NORTH END WATER POLLUTION CONTROL CENTRE MAIN BUILDING FEEDER REPLACEMENTS DEMOLITION PLAN MAIN BUILDING BASEMENT			
CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0101M-A-E0009	001	00	D