


FILE NAME: 0285-395-02_01-M-0003_RV.dwg
 DATE: 2007.05.05
 DESCRIPTION: DEMOLITION - MAIN FLOOR OFFICE
 PROJECT No: 0285-395-02
 ADDRESS: 1539 Waverley Street, Winnipeg, MB.

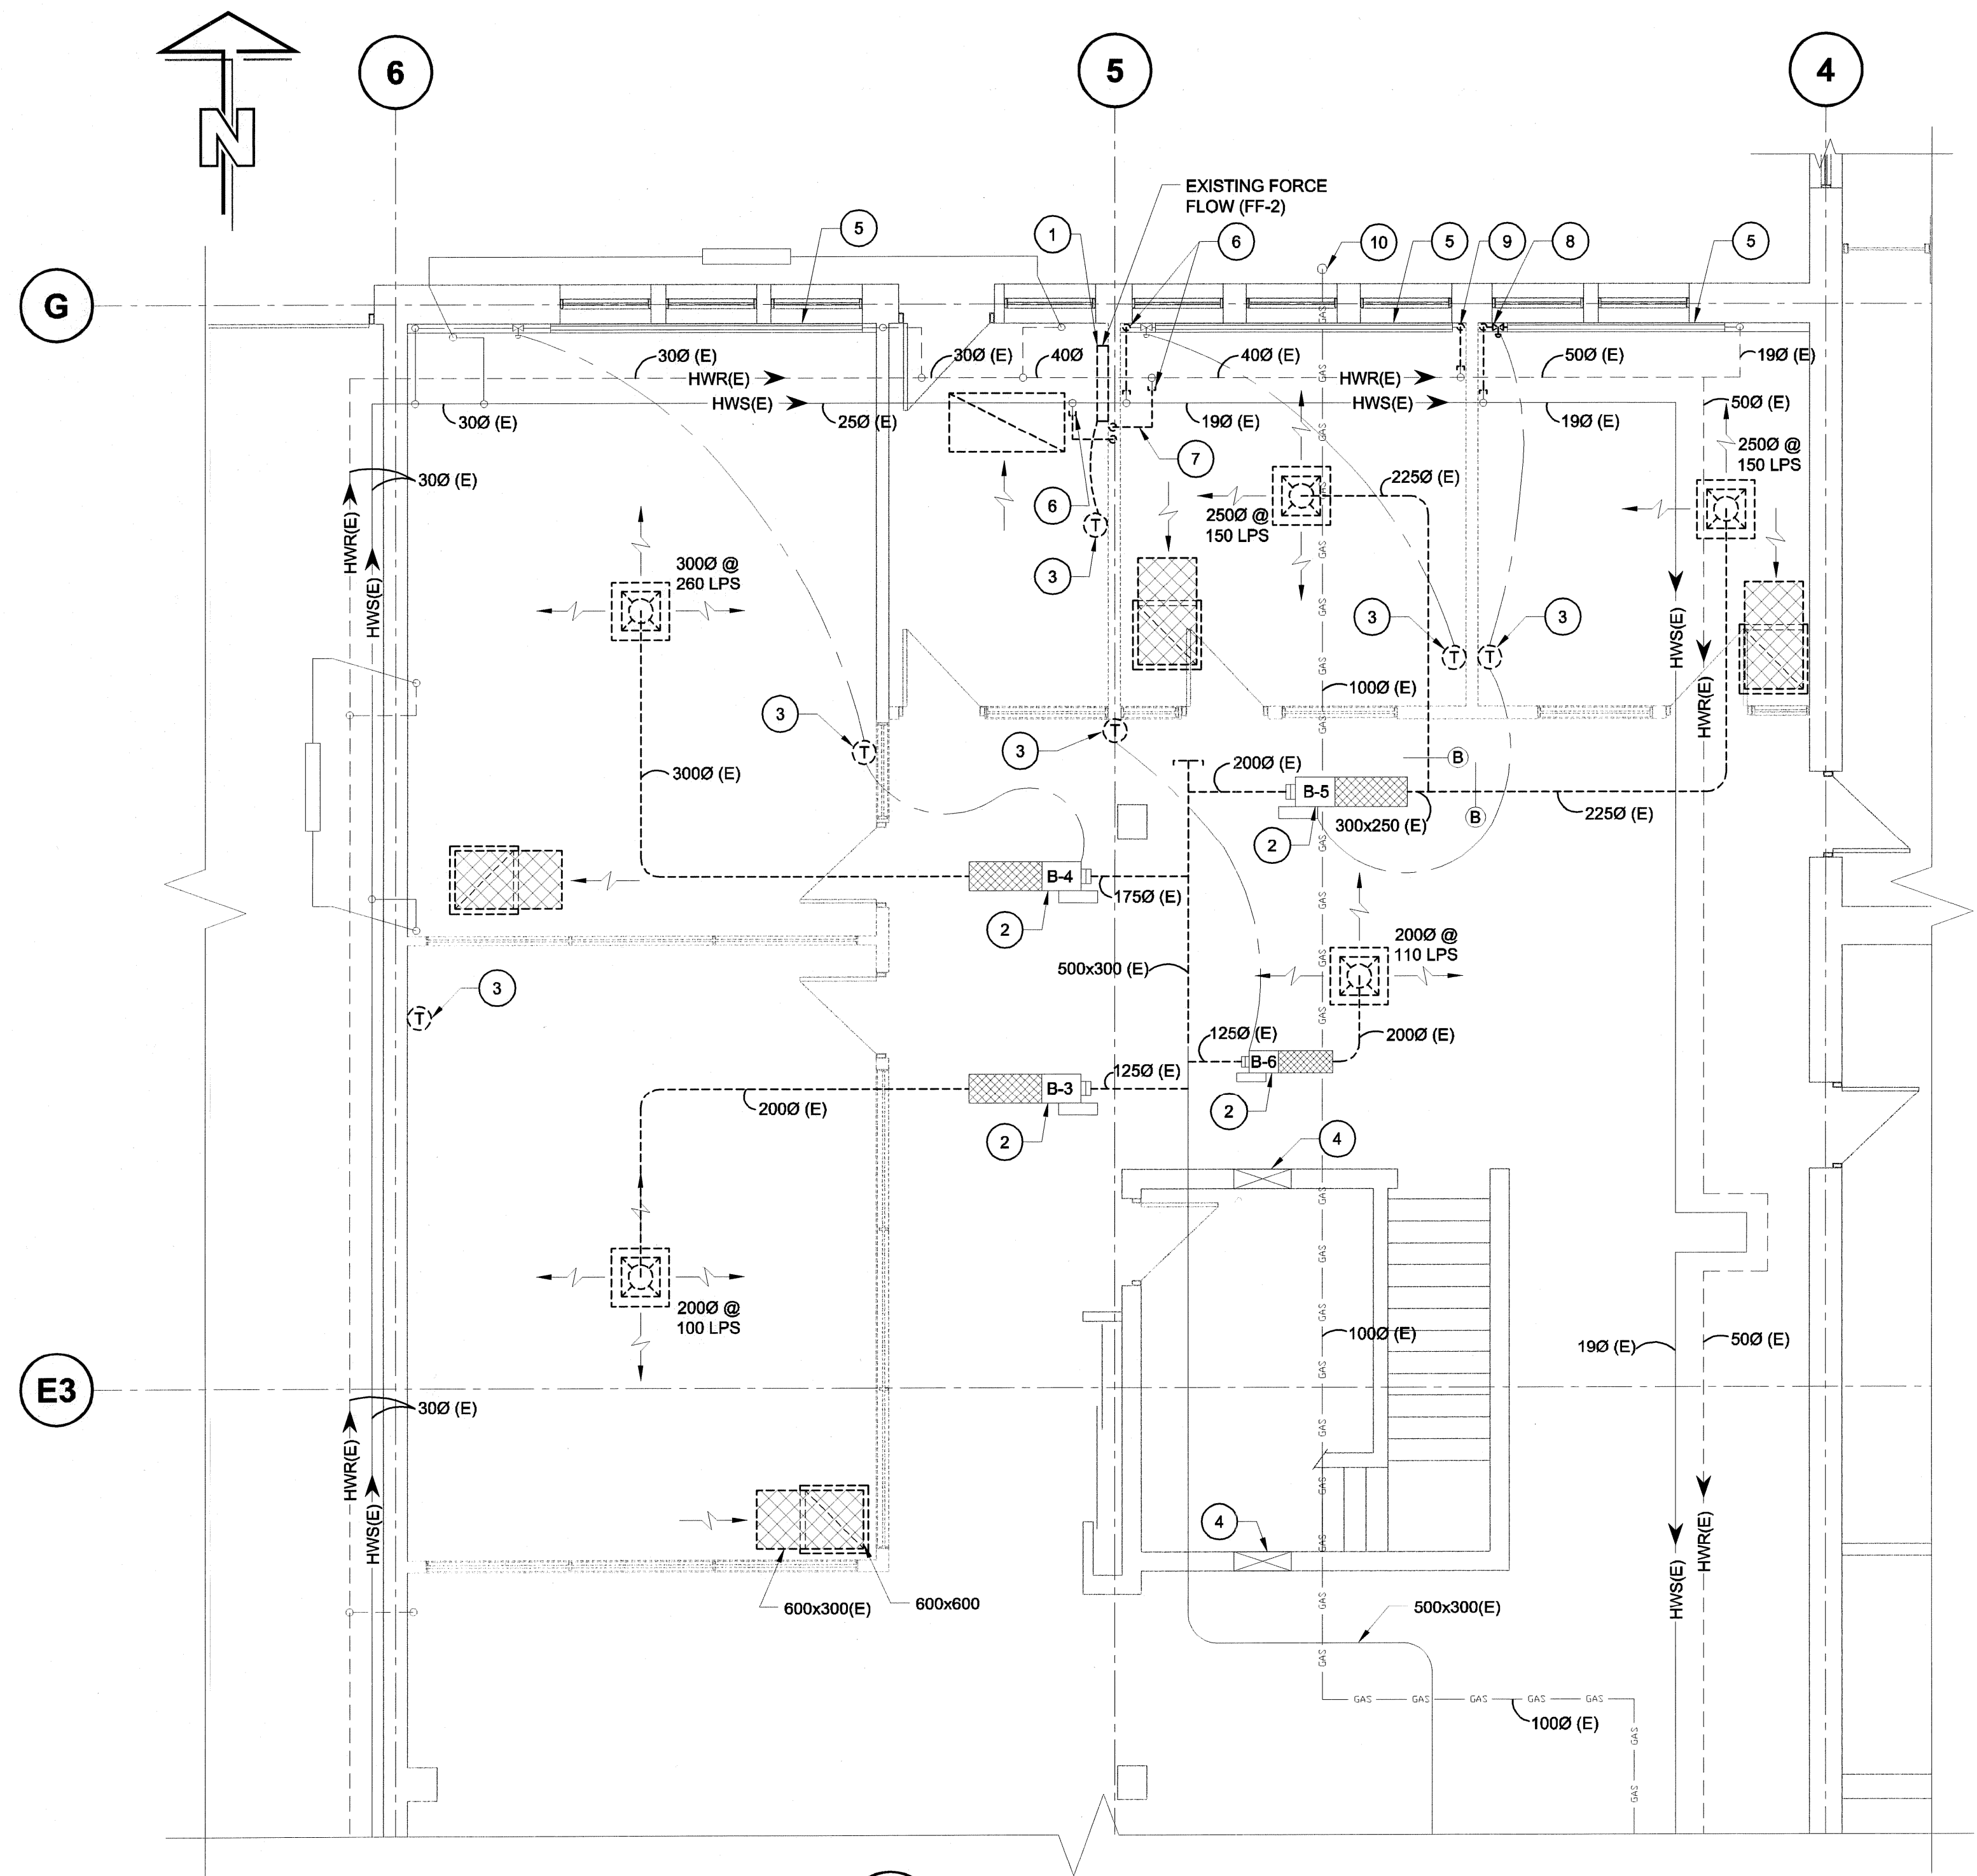


PLAN
 1
 01-M-0003
 SCALE 1:50
 MAIN FLOOR PLAN DEMOLITION

- NOTES :
- 1 REMOVE EXISTING FAN COIL UNIT TO ALLOW FOR DEMOLITION OF WALL. CAP SERVICES TO ALLOW FOR DEMOLITION. CLEAN AND REFRUBISH FAN COIL UNIT.
 - 2 REMOVE EXISTING TERMINAL UNITS TO ALLOW FOR DEMOLITION.
 - 3 REMOVE EXISTING THERMOSTAT AND CONTROL TUBING TO TERMINAL UNIT OR WALL FIN.
 - 4 EXISTING 600x450 OPENING ABOVE CEILING.
 - 5 EXISTING WALL FIN TO REMAIN.
 - 6 REMOVE EXISTING HWS, PIPED TO DEVICE, AND CAP IN CEILING SPACE TO ALLOW FOR DEMOLITION OF WALL.
 - 7 REMOVE EXISTING HWR, PIPED TO DEVICE, AND CAP IN CEILING SPACE TO ALLOW FOR DEMOLITION OF WALL.
 - 8 REMOVE EXISTING HWS TO WALL FIN AND ALL ASSOCIATED VALVING UPSTREAM OF THE WALL FIN. BRANCH TO BE REMOVED BACK TO MAIN IN CEILING SPACE AND CAPPED.
 - 9 REMOVE EXISTING HWR FROM WALL FIN AND ALL ASSOCIATED VALVING DOWNSTREAM OF THE WALL FIN. BRANCH TO BE REMOVED BACK TO MAIN IN CEILING SPACE AND CAPPED.
 - 10 EXISTING GAS SERVICE UP FROM METER.

UMA | AECOM

© 2007 UMA ENGINEERING LTD. ALL RIGHTS RESERVED.

D	ISSUED FOR TENDER	ALS	07/11/02
C	ISSUED FOR FINAL REVIEW	ALS	07/10/02
B	ISSUED FOR 100% REVIEW	ALS	07/09/02
A	ISSUED FOR CLIENT REVIEW	ALS	07/08/02
NO.	REVISION/DESCRIPTION	BY	DATE

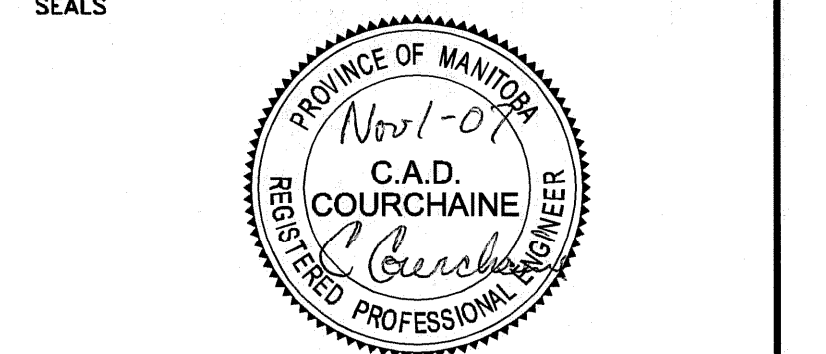

DRAWN BY	RP	CHECKED BY	-	APPROVED	-
DATE	2007.05.09	USER APPROVAL			

Winnipeg CITY OF WINNIPEG
 PLANNING, PROPERTY &
 DEVELOPMENT DEPARTMENT
 CIVIC ACCOMMODATIONS DIVISION
 300 - 65 GARRY ST. R3C 4K4

PROJECT
 CONSTRUCTION OF OFFICE/GARAGE
 RENOVATIONS AND STORAGE BUILDING
 AT 1539 WAVERLEY STREET
 1539 Waverley Street, Winnipeg, MB.

SHEET TITLE
 MECHANICAL
 DEMOLITION - HVAC
 MAIN FLOOR OFFICE

SCALE	PROJECT NO.	SHEET NO.
AS NOTED	0285-395-02	OFF - M1.1

AECOM
 Certificate of Authorization
 UMA Engineering Ltd. (MB)
 No. 256 Date: Nov 1-07

ISSUED FOR
TENDER
 Date: 2007/11/02

DRN	CHK	DES	ENG	IDR
UMA AECOM REVIEW				