

IMPORTANT: ASBESTOS NOTIFICATION AND ACKNOWLEDGMENT

Every effort has been made to identify known asbestos containing materials within the areas of the proposed work and where in direct conflict or where posing a hazard, to remove it by proper controlled means before construction. As a precautionary measure, where material is encountered by trades and contractors that is suspected or suspicious, the Trade/Contractor/Subcontractor is to contact the Water and Waste Department who will have samples taken and tested to confirm its composition.


Mt. Reg. 53-88 (Workplace Health Hazard Regulation), Mt. Reg. 100-88R (Fibrous and Silica Regulation) and associated Guidelines apply to all maintenance and renovation work that may disturb asbestos or suspect asbestos-containing materials in the Workplace. Such regulations and guidelines state that any disturbance of asbestos-containing materials may only be performed by workers or by an outside contractor who have first received the required training in asbestos-related precautions.

WORKING WITH ASBESTOS CAN BE DANGEROUS. INHALING ASBESTOS FIBERS CAN CAUSE VARIOUS TYPES OF LUNG DISEASE INCLUDING CANCER. SMOKING INCREASES THE RISK OF LUNG CANCER FROM ASBESTOS EXPOSURE.

ACKNOWLEDGMENT:

In undertaking the work of this project, we the trade or contractor agree to perform our work in such a manner so as NOT to disturb any asbestos-containing materials without:

- giving notice to the appropriate supervisor, individual manager and/or project coordinator at the Water And Waste Department that known or suspected asbestos-containing material(s) will be disturbed, or
- halting work and giving notice to the appropriate individual manager and/or project coordinator at the Water And Waste Department when unforeseen suspected asbestos-containing materials are uncovered during the provisions of services/materials.

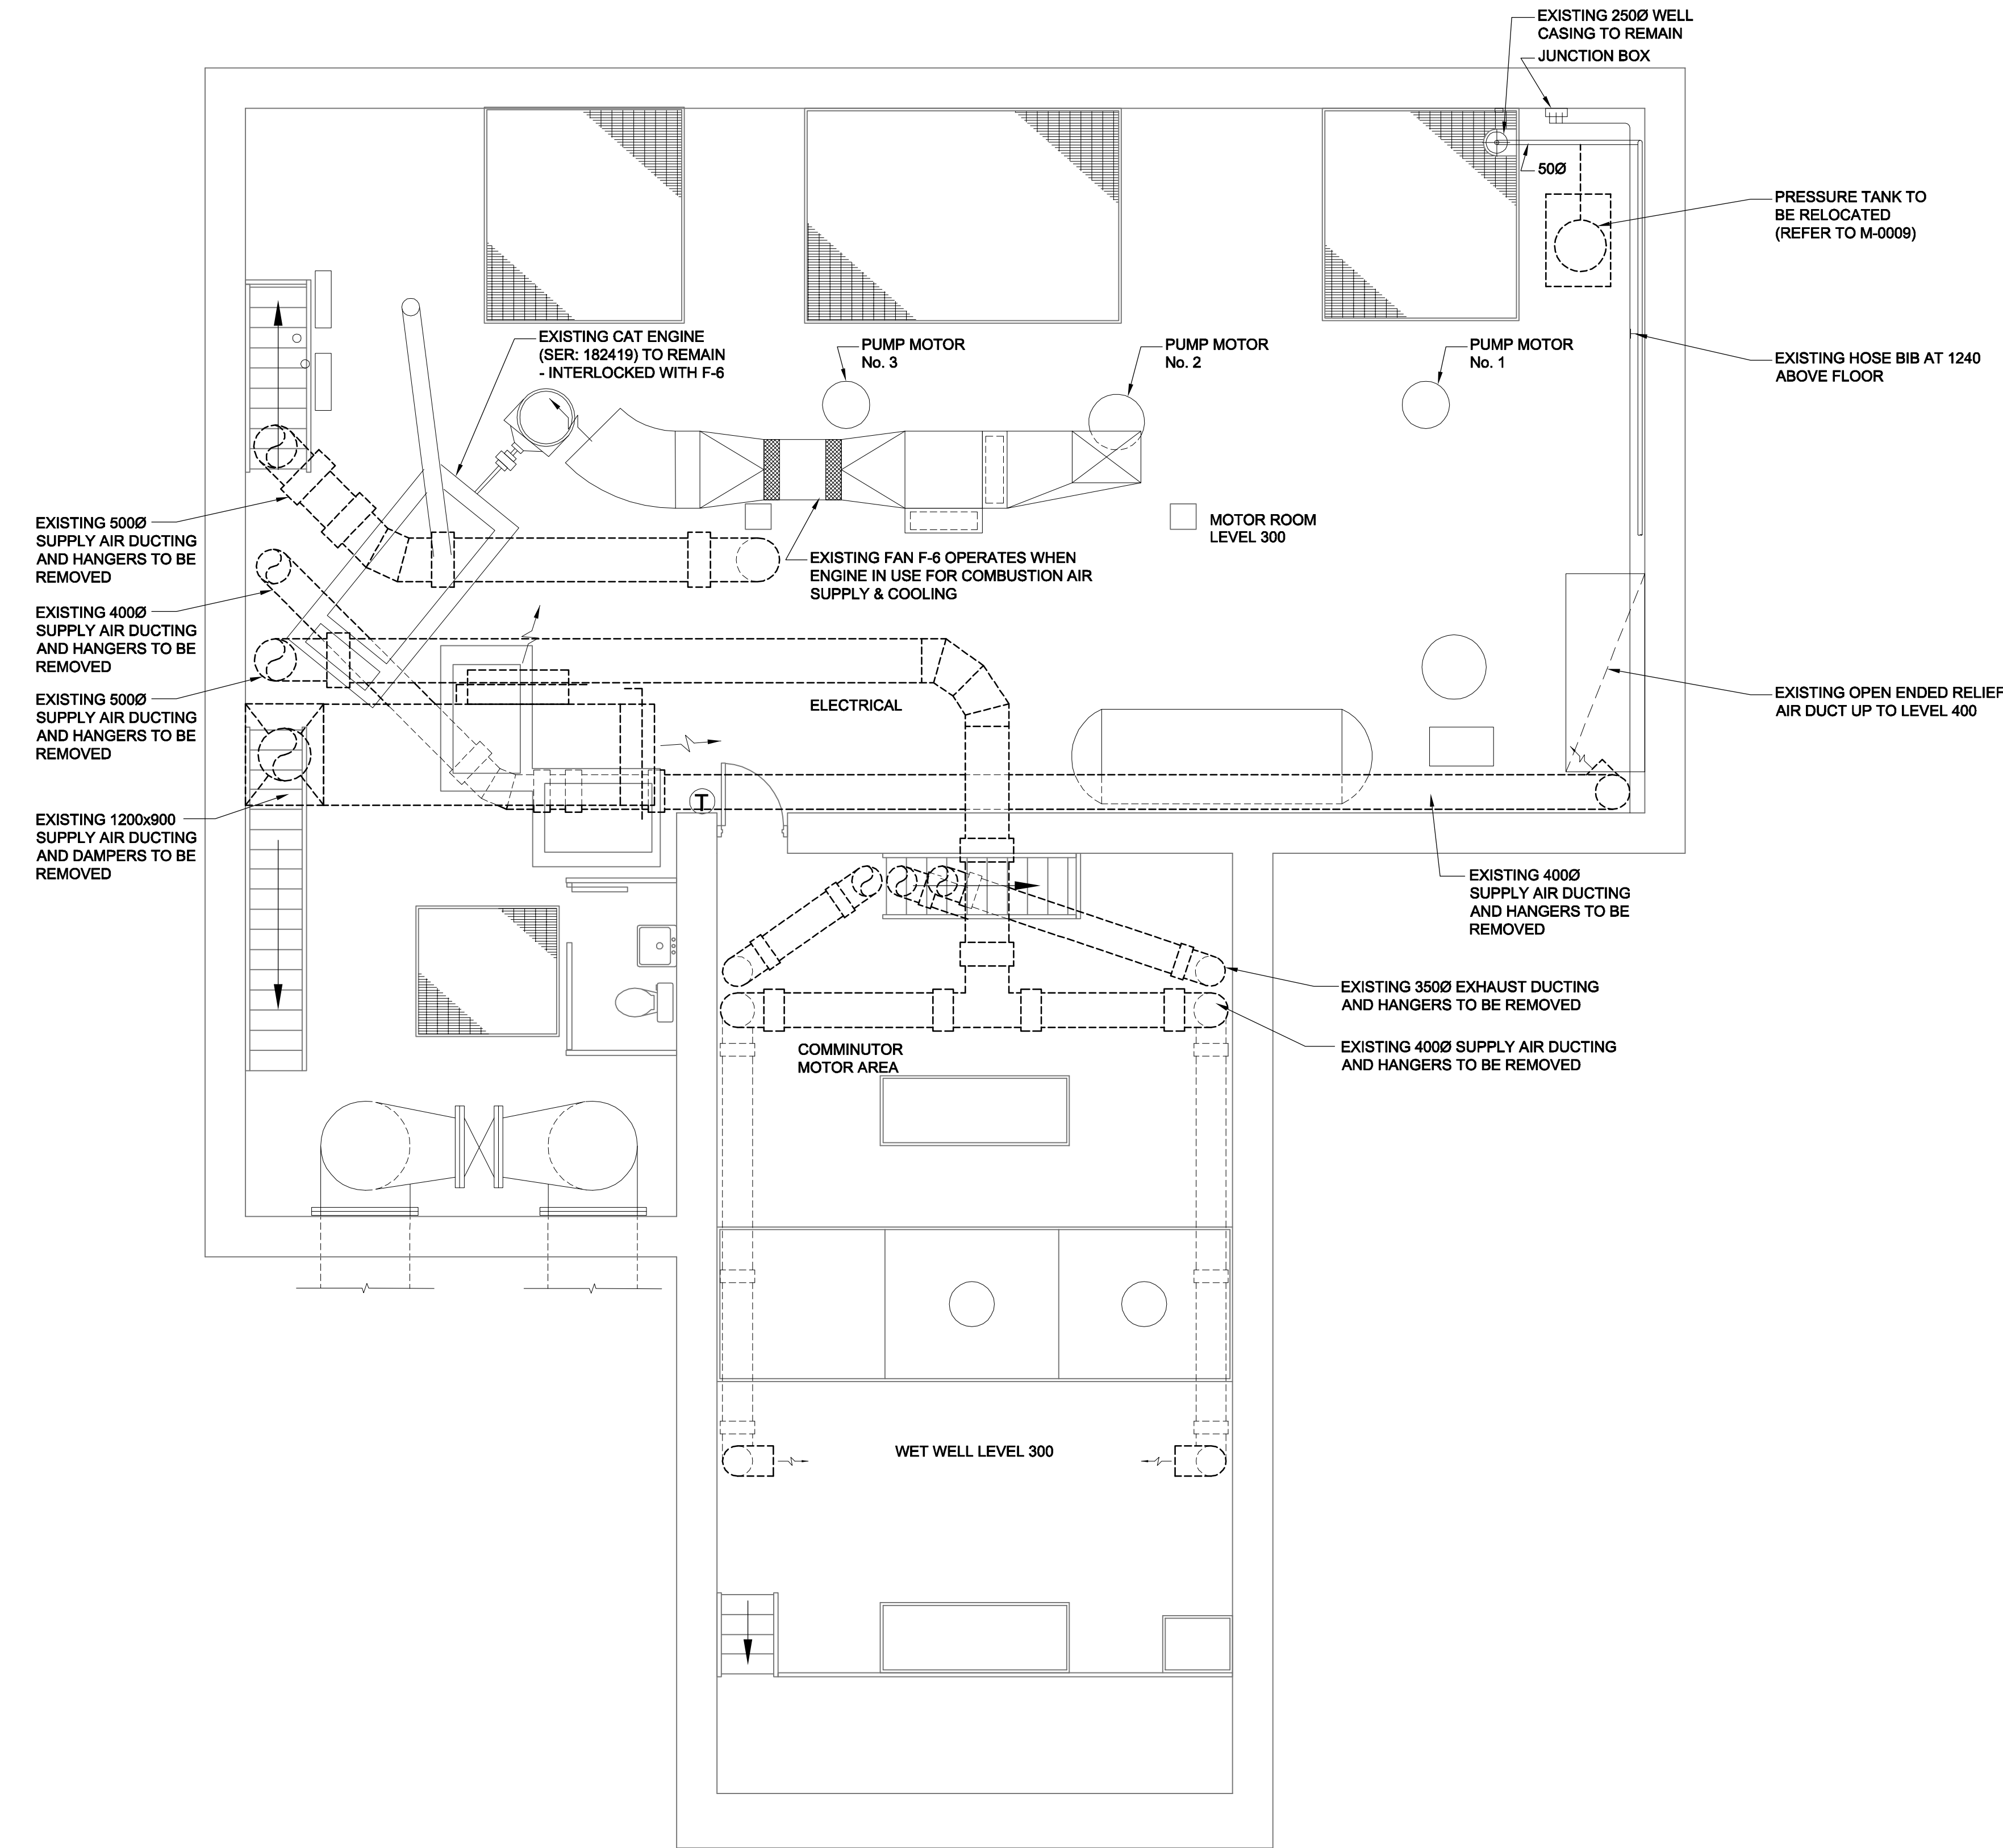

EXISTING 5000 SUPPLY AIR DUCTING AND HANGERS TO BE REMOVED

EXISTING 4000 SUPPLY AIR DUCTING AND HANGERS TO BE REMOVED

EXISTING 5000 SUPPLY AIR DUCTING AND HANGERS TO BE REMOVED

EXISTING 1200x800 SUPPLY AIR DUCTING AND DAMPERS TO BE REMOVED

EXISTING CAT ENGINE (SER: 182419) TO REMAIN - INTERLOCKED WITH F-6

PUMP MOTOR No. 3

PUMP MOTOR No. 2

PUMP MOTOR No. 1

EXISTING FAN F-6 OPERATES WHEN ENGINE IN USE FOR COMBUSTION AIR SUPPLY & COOLING

MOTOR ROOM LEVEL 300

ELECTRICAL

COMMINUTOR MOTOR AREA

WET WELL LEVEL 300

EXISTING 2500 WELL CASING TO REMAIN JUNCTION BOX

500

PRESSURE TANK TO BE RELOCATED (REFER TO M-0009)

EXISTING HOSE BIB AT 1240 ABOVE FLOOR

EXISTING OPEN ENDED RELIEF AIR DUCT UP TO LEVEL 400

EXISTING 4000 SUPPLY AIR DUCTING AND HANGERS TO BE REMOVED

EXISTING 3500 EXHAUST DUCTING AND HANGERS TO BE REMOVED

EXISTING 4000 SUPPLY AIR DUCTING AND HANGERS TO BE REMOVED

PLAN LEVEL 300



NOTE: CAUTION: EXISTING DUCTING CONTAINS ASBESTOS, WET WELL AREAS ARE CONSIDERED CONFINED SPACES AND SUITABLE PROCEDURES MUST BE FOLLOWED.

1
M0004

APEGM
Certificate of Authorization
UMA Engineering Ltd. (MB)
No. 256 Date: 07/12/14

RS	ALS	CC	CC	BP
DRN	CHK	DES	ENG	IDR
UMA REVIEW				

B.M. ELEV.	FIELD BOOK #:	UMA AECOM	
POSTED TO LBIS		DESIGNED BY: CAC	CHECKED BY: -----
		DRAWN BY: RJP	APPROVED BY: -
D ISSUED FOR BID	07/12/14	RS	
C ISSUED FOR 100% REVIEW	07/11/09	RS	
B ISSUED FOR ZONING	07/08/21	ALS	
A ISSUED FOR 80% REVIEW	07/06/18	RJP	
NO. REVISIONS	DATE	BY	FILENAME: D265-202-02_01-M-0004_RX.dwg

© 2008 UMA ENGINEERING LTD. ALL RIGHTS RESERVED.	
HOR. SCALE AS NOTED	RELEASED FOR CONSTRUCTION
DATE 07/05/09	DATE

ENGINEER'S SEAL

ISSUE / REVISION ISSUED FOR BID WAS SEALED BY CLAUDE COURCHAIINE AND DATED 07/12/14

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

PERIMETER ROAD PUMPING STATION UPGRADES
Contract B - Building Upgrades

Mechanical - Demolition
LEVEL 300 FLOOR PLAN

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0111L-M0004	001	D	D