

FOUNDATION

1. CAST-IN-PLACE PILES TO BE A CLASS S-2 EXPOSURE (32 MPa @56d). (SEE TABLE 1, A23.1-04)
2. A GEOTECHNICAL ENGINEER IN EMPLOY OF THE CITY SHALL INSPECT THE PILE INSTALLATIONS.
3. ASSUMED DESIGN SKIN FRICTION VALUE: 250 PSF.

CONCRETE

1. ALL CONCRETE CONSTRUCTION, COLD WEATHER CONSTRUCTION & CONCRETE TESTING TO BE IN ACCORDANCE WITH THE LATEST EDITION OF CSA STANDARDS A23.1 AND A23.2.
2. ALL CONCRETE TO BE NORMAL WEIGHT HARD ROCK CONCRETE WITH A MINIMUM 28 DAY, OR 56 DAY COMPRESSIVE STRENGTH AS NOTED IN TABLE 2, A23.1-04.
3. CONCRETE CLASSES OF EXPOSURE (REFER TO TABLE 1, A23.1-04):
 - A. GRADE BEAMS CLASS F-2 EXPOSURE (25 MPa @28d)
 - B. INTERIOR SLABS ON GRADE (INCLUDING TOPPING)CLASS N EXPOSURE (25 MPa @28d)
 - C. INTERIOR STRUCTURAL SLABSCLASS N EXPOSURE (25 MPa @28d)
 - D. EXTERIOR SLABS ON GRADE (SIDEWALKS, CURBS, TOPPING, PADS).....CLASS C-2 EXPOSURE (32 MPa @28d)
 - E. EXTERIOR STRUCTURAL SLABS.....CLASS C-1 EXPOSURE (35 MPa @28d)
 - F. PILE CAPS.....CLASS N EXPOSURE (25 MPa @28d)
4. CONCRETE SLUMP TO BE COORDINATED BETWEEN CONTRACTOR AND CONCRETE SUPPLIER CONSIDERING THE PERFORMANCE CRITERIA AND THE CONTRACTOR'S CRITERIA FOR CONSTRUCTION AND PLACEMENT.
5. MISCELLANEOUS CONCRETE ELEMENTS (PITS, TRENCHES, ETC.) TO BE MINIMUM 6" (150mm) THICK REINFORCED WITH 10M @ 12" (300mm) O/C EACH WAY UNLESS NOTED OTHERWISE.

REINFORCING

1. REINFORCING STEEL SHALL BE GRADE 400 DEFORMED NEW BILLET STOCK CONFORMING TO LATEST CSA SPECIFICATION G30.18-M92. WELDED WIRE MESH SHALL CONFORM TO CSA G30.5-M1983, (R1991). GRADE 300 STEEL MAY BE USED FOR ALL STIRRUPS AND TEMPERATURE STEEL.
2. CONCRETE COVER TO BE AS FOLLOWS:
 - A. CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 75mm (3").
 - B. EXPOSED TO EARTH OR WEATHER 50mm (2").
 - C. NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND:
 - i) SLABS 20mm (3/4")
 - ii) BEAMS 40mm (1 1/2")
 - iii) CONCRETE COLUMNS 50mm (2")
3. TOP STEEL IN GRADE BEAMS TO BE SPLICED AT CENTER SPAN AND BOTTOM STEEL TO BE SPLICED OVER SUPPORTS. SPLICE LENGTHS:
 - A. TENSION ZONE SPLICE TO BE AVOIDED WHEREVER POSSIBLE, BUT IF REQUIRED, LENGTH SHOULD BE SPECIFIED BY THE DESIGN ENGINEER.
 - B. COMPRESSION ZONE SPLICE SHOULD NOT BE LESS THAN 30 BAR DIAMETERS.

MASONRY

1. CONCRETE BLOCKS TO CONFORM TO CSA A165.1-M94 TO SPECIFICATIONS FOR, BLOCK TYPE, WATERPROOFING ADMIXTURES, ETC.
2. MASONRY WALLS TO BE BUILT WITH TYPE "S" MORTAR HAVING A MINIMUM STRENGTH OF 13 MPA 28 DAYS. MORTAR TO BE IN ACCORDANCE WITH CAN3-S304-M84. ALL MORTAR JOINTS SHALL BE FLUSH, FULL BED JOINTS.
3. USE DUR-O-WALL (OR EQUAL) SPACED VERTICALLY AT 400mm O/C.
4. COLD WEATHER CONSTRUCTION OF MASONRY SHALL CONFORM TO THE NATIONAL BUILDING CODE, WITH ADEQUATE PREHEATING OF MATERIALS, HOARDING AND HEATING DURING CONSTRUCTION AND THEREAFTER AS SPECIFIED. THE "TORCHING TECHNIQUE" WILL NOT BE PERMITTED UNDER ANY CIRCUMSTANCES.
5. MASONRY SUBCONTRACTOR SHALL BE RESPONSIBLE FOR TEMPORARY BRACING OF ALL MASONRY COMPONENTS UNTIL ALL RELATED STRUCTURAL FRAMING HAS BEEN ERRECTED AND COMPLETELY INSTALLED.
6. PROVIDE EXPANSION JOINTS @ MAXIMUM OF 6.5m O/C UNO.
7. PROVIDE CONTINUOUS BOND BEAMS WITH 2-15M BARS BOTTOM IN CONCRETE FILL AT TOP OF ALL EXTERIOR WALLS, BEARING WALLS OR AS INDICATED ON DRAWINGS. PROVIDE 2-15M VERTICAL BARS AT ALL OPENINGS EXCEEDING 1200mm IN WIDTH AND AT END OF WALLS. FILL WITH CONCRETE.
8. INSPECTION HOLES SHALL BE LEFT AT THE BASE OF CONCRETE FILLED WALLS.
9. MASONRY CORES SHALL BE FILLED IN LIFTS NOT EXCEEDING 3m.
10. CONCRETE BLOCKS TO HAVE COMPRESSIVE STRENGTH OF 15 MPA OR BETTER.
11. ENSURE MASONRY CORES FILLED WITH CONCRETE AT EXPANSION ANCHOR LOCATIONS. MINIMUM 4" CONCRETE ON ALL SIDES.
12. TYPICAL MASONRY LINTELS UNLESS NOTED ON DRAWINGS:

SPANS UP TO 1200mm	-200 U-BLOCK	2-15M CONT. BOTTOM
SPANS UP TO 2000mm	-400 U-BLOCK	2-15M CONT. BOTTOM

 PROVIDE MINIMUM 200mm BEARING AT EACH END.
13. BRICK TIES TO BE "FERRO" SLOTTED BLOCK OR STUD TIES OR APPROVED EQUAL CONNECTORS SPACED AS FOLLOWS:

HORIZONTAL:	450mm O/C
VERTICAL:	1ST ROW @ 200mm FROM TOP AND BOTTOM.
	2ND ROW @ 400mm FROM TOP AND BOTTOM.
	BALANCE @ 600mm O/C.
14. INTERIOR 6" WIDE MASONRY BLOCK TO BE 15MPA UNITS, TYPE N MORTAR . INSTALL BOND BEAM AT TOP OF WALL REINFORCED WITH 1-15M BAR. INSTALL 1-15M VERTICAL BAR AT ALL CORNERS AND DOORWAYS, FILL CORES WITH CONCRETE. PROVIDE 10M DOWELS FROM CONCRETE CURB TO MASONRY WALL EVERY 4th CORE, FILL BOTTOM 2 CORES WITH CONCRETE.

STRUCTURAL STEEL

1. ALL STRUCTURAL STEEL ROLLED SECTIONS AND STRUCTURAL PLATES SHALL CONFORM TO THE LATEST EDITION OF CSA STANDARDS G40.21-M 350W. ALL HOLLOW STRUCTURAL SECTION SHALL CONFORM TO THE LATEST EDITION OF CSA STANDARD G40.21-M 350W.
2. ALL ANCHOR BOLTS SHALL CONFORM TO THE LATEST EDITION OF ASTM A307 UNLESS OTHERWISE NOTED. BOLTED CONNECTION SHALL BE TORQUE-TESTED IN ACCORDANCE WITH THE LATEST EDITION OF CSA S16.1. ANCHOR BOLTS TO BE 3/4" x 18" C/W 3" HOOK.
3. ALL WELDERS AND WELDING PROCEDURES TO BE CERTIFIED BY CANADIAN WELDING BUREAU.
4. PROVIDE STIFFENER PLATES TO BOTH SIDES AT WEBS OF BEAMS BEARING OVER COLUMNS. THE PLATES ARE TO BE OF THE SAME THICKNESS AS COLUMN FLANGES FOR W-SHAPES, COLUMN WALL FOR HSS SHAPES OR 9mm WHICHEVER IS GREATER.

ITEMS EMBEDDED IN CONCRETE

SEE ALSO CSA-A23.1 - CLAUSE 12.5
EXCEPT WHEN APPROVED BY THE CONTRACT ADMINISTRATOR, PIPES, CONDUITS, AND SLEEVES EMBEDDED IN CONCRETE SHALL BE INSTALLED IN ACCORDANCE WITH THE FOLLOWING GUIDELINES:

1. GENERAL
 - A. NOT WITHSTANDING THE SATISFYING OF THESE GUIDELINES, THE CONDUIT, SLEEVES, PIPES ETC. SHALL NOT IMPAIR THE STRUCTURAL STRENGTH AND SHALL BE MOVED IF SO DIRECTED BY THE CONTRACT ADMINISTRATOR.
 - B. CENTERLINE SPACING TO BE NOT LESS THAN 3 DIAMETERS.
 - C. CENTERLINE SPACING BETWEEN PARALLEL CONDUIT AND REINFORCING BARS TO BE 3 DIAMETERS.
 - D. ADD REINFORCING AT POINTS OF CONGESTION AS DIRECTED BY THE CONTRACT ADMINISTRATOR.
2. FOR SLABS - CONDUITS IN THE PLANE OF THE SLAB:
 - A. LOCATE BETWEEN TOP AND BOTTOM REINFORCING. (WHERE APPLICABLE)
 - B. MAXIMUM SIZE IN ONE LAYER TO BE NOT MORE THAN 1/4 OF CONCRETE THICKNESS.
 - C. THREE LAYERS OR MORE CROSSING WILL NOT BE PERMITTED.
3. FOR WALLS - CONDUIT/ PIPES NOT ALLOWED WITHOUT THE WRITTEN APPROVAL OF THE CONTRACT ADMINISTRATOR.

NON-STRUCTURAL ELEMENTS

1. "NON-STRUCTURAL" OR "SECONDARY STRUCTURAL" ELEMENTS ARE NOT THE RESPONSIBILITY OF TOWER ENGINEERING GROUP. THEY ARE DESIGNED, DETAILED AND REVIEWED IN THE FIELD BY OTHERS. THEY APPEAR ON DRAWINGS OTHER THAN THOSE OF TOWER ENGINEERING GROUP WHERE STRUCTURAL ENGINEERING RESPONSIBILITY IS REQUIRED FOR THESE ELEMENTS, THIS SHALL BE PROVIDED BY SPECIALTY STRUCTURAL ENGINEERS, WHO SHALL ALSO PROVIDE ANY LETTERS REQUIRED BY BUILDING PERMIT AUTHORITIES.
2. EXAMPLES OF NON-STRUCTURAL ELEMENTS INCLUDE, BUT ARE NOT LIMITED TO:
 - A. ARCHITECTURAL COMPONENTS SUCH AS GUARDRAILS, HANDRAILS, CEILINGS, MILLWORK ETC.
 - B. LANDSCAPE ELEMENTS SUCH AS BENCHES, LIGHT POSTS, PLANTERS, ETC.
 - C. CLADDING, GLAZING, WINDOW MULLIONS, INTERIOR STUD WALLS AND EXTERIOR STUD WALLS.
 - D. ARCHITECTURAL PRECAST, PRECAST CLADDING.
 - E. MECHANICAL AND ELECTRICAL EQUIPMENT, COMPONENTS, AND THEIR ATTACHMENT DETAILS.
 - F. ELEVATORS AND CONVEYING SYSTEMS.
 - G. BRICK OR BLOCK VENEERS AND THEIR ATTACHMENTS.
 - H. NON-LOAD BEARING MASONRY.
 - I. NON-STRUCTURAL CONCRETE TOPPING
 - J. ALUMINUM SKYLIGHTS.
3. SHOP DRAWINGS FOR NON-STRUCTURAL ELEMENTS WHICH MAY AFFECT THE PRIMARY STRUCTURAL SYSTEM SHALL BE SUBMITTED TO TOWER ENGINEERING GROUP THESE DRAWINGS WILL BE REVIEWED ONLY FOR THE EFFECT ON THE PRIMARY STRUCTURAL SYSTEM.

STRUCTURAL MOVEMENTS/ TOLERANCES

THIS STRUCTURE WILL UNDERGO NORMAL TYPES OF MOVEMENT AND DEFLECTION AND THE NON-STRUCTURAL COMPONENTS MUST BE DETAILED TO ACCOMMODATE THIS. DRYWALL PARTITIONS, MECHANICAL EQUIPMENT, ELECTRICAL EQUIPMENT AND BUILDING FIXTURES MUST BE DETAILED AND INSTALLED TO ACCOMMODATE SLAB MOVEMENT. ALL STRUCTURES ARE SUBJECT TO CONSTRUCTION TOLERANCES. THIS SHOULD BE ALLOWED FOR IN DETAILING NON-STRUCTURAL COMPONENTS.

LUMBER

1. FRAMING LUMBER SHALL CONFORM TO THE LATEST EDITION OF CSA 0141 AND SHALL BE OF THE FOLLOWING MINIMUM GRADES:

LINTELS, JOISTS, AND BEAMS: S-P-F NO. 2
STUD WALLS: S-P-F NO. 2
2. ALL SHEATHING MATERIAL TO BE 1/2" STD. SPRUCE PLYWOOD IN ACCORDANCE WITH CSA 0325 UNLESS NOTED OTHERWISE. ALL SHEETS TO BE STAGGERED. FASTEN SHEETS WITH 3" COMMON NAILS AT 12" O/C ALONG ALL STUDS AND AT 6" O/C ALONG EDGES OF SHEET, UNLESS NOTED OTHERWISE.
3. ALL FLOOR AND ROOF JOISTS TO HAVE CONTINUOUS CROSS BRIDGING AT 6'-0" MAX. SPACING UNLESS NOTED OTHERWISE.

DESIGN LOADS

SNOW LOAD	Ss = 39.7 PSF	Sr = 4.2 PSF
WIND LOAD	9.4 PSF (q50)	7.3 PSF (q10)
FLOOR LOADS	REFER TO PLAN	

CONTRACTOR TO ENSURE THAT CONSTRUCTION LOADS DO NOT EXCEED DESIGN LOADS.

ABBREVIATIONS

ALT.----- ALTERNATE	N.T.S.----- NOT TO SCALE
BOT.----- BOTTOM	O/C----- ON CENTER
B.W.----- BOTH WAYS	R/W----- REINFORCED WITH
C/W----- COMPLETE WITH	S.D.L.----- SUPERIMPOSED DEAD LOAD
DL----- DEAD LOAD	SIM.----- SIMILAR
E.E.----- EACH END	S.O.G.----- SLAB ON GRADE
E.F.----- EACH FACE	STAG.----- STAGGER
E.S.----- EACH SIDE	S.J.----- STRUT JOIST
E.W.----- EACH WAY	TYP.----- TYPICAL
H.1E.----- HOOK ONE END	T/O----- TOP OF
H.2E.----- HOOK TWO ENDS	TIE----- TIE ONE END
H & V----- HORIZONTAL AND VERTICAL	T & B----- TOP AND BOTTOM
HORIZ.----- HORIZONTAL	T & C----- TENSION AND COMPRESSION
L.L.----- LIVE LOAD	U.N.O.----- UNLESS NOTED OTHERWISE
MAX.----- MAXIMUM	VERT.----- VERTICAL
MIN.----- MINIMUM	

OWNERSHIP AND COPYRIGHT RESERVED

ALL DRAWINGS, PLANS, MODELS, DESIGNS, SPECIFICATIONS AND OTHER DOCUMENTS PREPARED BY TOWER ENGINEERING GROUP AND USED IN CONNECTION WITH THE PROJECT ARE INSTRUMENTS OF SERVICE FOR THE EXECUTION OF THE PROJECT, AND ARE AND REMAN THE PROPERTY OF TOWER ENGINEERING GROUP. WHETHER THE PROJECT IS EXECUTED OR NOT, AND TOWER ENGINEERING GROUP RESERVES THE COPYRIGHT THEREIN AND IN THE WORK EXECUTED THEREFROM: SHALL NOT BE USED FOR ANY OTHER PROJECT. EXCEPT ONLY FOR GENERAL REFERENCE PURPOSES FOR ADDITION OF ALTERATION TO THE WORK SHOWN IN THEM, AND SINCE SUCH DOCUMENTS ARE "DESIGN" DOCUMENTS ONLY AND MAY NOT REPRESENT THE ACTUAL PROJECT "AS CONSTRUCTED", USE OF THESE DOCUMENTS FOR GENERAL REFERENCE PURPOSES IS AT THE SOLE RISK OF THE PARTY USING THEM: SHALL NOT BE COPIED WITHOUT THE WRITTEN CONSENT OF AN AUTHORIZED REPRESENTATIVE OF TOWER ENGINEERING GROUP.

FIELD REVIEW BY CONTRACT ADMINISTRATOR

THE CONTRACT ADMINISTRATOR PROVIDES FIELD REVIEW ONLY FOR THE WORK SHOWN ON THESE STRUCTURAL DRAWINGS. THIS REVIEW IS NOT A "FULL TIME" REVIEW BUT IS A PERIODIC REVIEW AT THE SOLE DISCRETION OF THE CONTRACT ADMINISTRATOR IN ORDER TO ASCERTAIN THAT THE WORK IS IN GENERAL CONFORMANCE WITH THE PLANS AND SUPPORTING DOCUMENTS PREPARED BY TOWER ENGINEERING GROUP. FIELD REVIEW BY CONTRACT ADMINISTRATOR IS NOT CARRIED OUT FOR THE CONTRACTOR'S BENEFIT, NOR DOES IT MAKE CONTRACT ADMINISTRATOR GUARANTORS OF THE CONTRACTORS WORK. IT REMAINS THE CONTRACTOR'S RESPONSIBILITY TO BUILD THE WORK IN CONFORMANCE WITH THE CONTRACT DOCUMENTS. THE CONTRACT ADMINISTRATOR SHALL NOT BE RESPONSIBLE FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, SUBCONTRACTOR, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK OF FOR THE FAILURE OF ANY OF THEM TO CARRY OUT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

THE CONTRACT ADMINISTRATOR WILL REVIEW SHOP DRAWINGS PERTAINING TO WORK SHOWN ON CONTRACT ADMINISTRATOR'S DRAWINGS. THE EXTENT OF THIS REVIEW IS AT THE SOLE DISCRETION OF THE CONTRACT ADMINISTRATOR AND IS FOR THE SOLE PURPOSE OF ASCERTAINING GENERAL CONFORMANCE WITH THE STRUCTURAL DESIGN CONCEPT. THE REVIEW IS NOT AN APPROVAL OF THE DESIGN, DETAILS AND DIMENSIONS INHERENT IN THE SHOP DRAWINGS. RESPONSIBILITY FOR WHICH SHALL REMAIN WITH THE CONTRACTOR SUBMITTING THEM. SUCH REVIEW SHALL NOT RELIEVE THE CONTRACTOR OF HIS RESPONSIBILITY FOR ERRORS AND OMISSIONS IN THE SHOP DRAWINGS OF FOR MEETING ALL REQUIREMENTS OF THE CONTRACT DOCUMENTS.

GENERAL NOTES

1. THIS SET OF DRAWINGS SHOWS THE COMPLETED PROJECT. THEY DO NOT INCLUDE COMPONENTS THAT MAY BE NECESSARY FOR CONSTRUCTION SAFETY. THE CONTRACTOR IS RESPONSIBLE FOR SAFETY IN AND ABOUT THE JOB SITE DURING CONSTRUCTION, AND THE DESIGN AND ERECTION OF ALL TEMPORARY STRUCTURES. FORM WORK, FALSE WORK, SHORING, ETC. REQUIRED TO COMPLETE THE WORK.

2. THE USE OF THESE DRAWINGS IS LIMITED TO THAT IDENTIFIED IN THE REVISIONS COLUMN. DO NOT CONSTRUCT FROM THESE DRAWINGS UNLESS MARKED "ISSUED FOR CONSTRUCTION" OR "OUT TO BID" IN THE REVISION'S COLUMN.

3. THE INFORMATION ON THIS DRAWING SHALL NOT BE USED FOR ANY OTHER THAN THE SPECIFIED WORKS OR PART OF THE WORKS FOR WHICH IT HAS BEEN AUTHORIZED BY THE CONTRACT ADMINISTRATOR.

4. SECTION MARKER SHOWN THUS  MEANS SECTION # SHOWN ON DRAWING SHEET S-#.

5. SEE ARCHITECTURAL DRAWINGS FOR FLOOR AND ROOF ELEVATIONS, RECESSED, DRAINAGE SLOPES, DETAILED DIMENSIONS FOR DOORS, WINDOWS AND OTHER OPENINGS ETC.

6. SEE ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS FOR SLEEVES, NAILERS, INSERTS, ETC. TO BE ENCASED IN CONCRETE.

7. THE CONTRACTOR SHALL REVIEW ALL THE DRAWINGS AND CHECK DIMENSIONS BEFORE CONSTRUCTION. REPORT DISCREPANCIES BETWEEN STRUCTURAL AND OTHER DISCIPLINES DRAWINGS FOR CLARIFICATION.

8. DO NOT CUT OR DRILL ANY OPENINGS IN STRUCTURAL MEMBERS WITHOUT THE WRITTEN PERMISSION OF THE CONTRACT ADMINISTRATOR. CONTRACTOR TO PROVIDE APPROPRIATE ATTACHMENTS AND CONNECTIONS FOR MECHANICAL, ELECTRICAL, AND OTHER SERVICES WITHOUT CUTTING OR DRILLING.

9. REFER TO ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND LANDSCAPE DRAWINGS FOR LOCATIONS, CONFIGURATIONS, EXTENT, AND SIZES OF ALL CURBS, UPSTANDS, DOWNTURNS: AND FOR OPENINGS THROUGH FLOORS AND WALLS FOR DUCTS.

10. FIRE RESISTANCE RATINGS:
SEE ARCHITECTURAL DRAWINGS AND SPECIFICATION FOR PRECISE LOCATION OF REQUIRED FIRE RESISTANCE RATINGS.


11. THE CONTRACTOR SHALL PROVIDE REASONABLE NOTICE TO THE CONTRACT ADMINISTRATOR PRIOR TO POURING CONCRETE OR CONCEALING ANY STRUCTURAL COMPONENTS. THE PURPOSE OF THIS NOTICE IS TO ENABLE THE CONTRACT ADMINISTRATOR TO CONDUCT ANY REQUIRED FIELD REVIEWS.

12. THE CONTRACTOR SHALL FAMILIARIZE HIMSELF WITH THE CONTENT AND RECOMMENDATIONS OF THE GEOTECHNICAL REPORTS.

13. THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR ALL STRUCTURAL COMPONENTS TO THE CONTRACT ADMINISTRATOR FOR REVIEW PRIOR TO FABRICATION. SHOP DRAWINGS TO INCLUDE SEAL AND SIGNATURE OF A PROFESSIONAL ENGINEER FOR DESIGN OF COMPONENTS AND/ OR CONNECTIONS AS REQUIRED.

LIST OF STRUCTURAL DRAWINGS

S-1.0	GENERAL NOTES
S-2.0	FOUNDATION PLAN, SECTIONS AND DETAILS
S-2.1	PLAN DETAILS AND SECTIONS
S-3.0	ROOF FRAMING PLAN AND SECTIONS

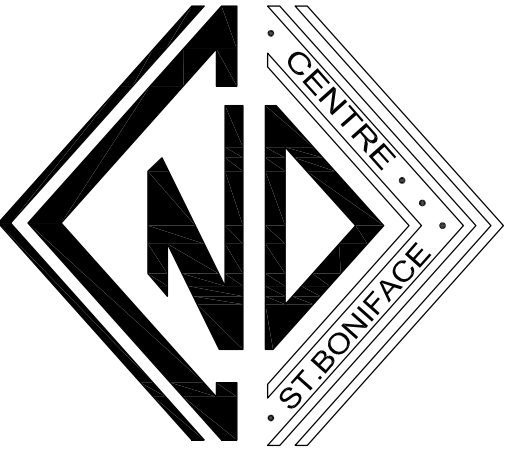

NO.	REVISION	DATE	BY
3.	RE-ISSUED FOR BID OPPORTUNITY	12/05/07	NM
2.	ISSUED FOR BID OPPORTUNITY	11/27/07	NM
1.	ISSUED FOR FINAL REVIEW	10/12/07	NM
0.	ISSUED FOR REVIEW	05/23/07	DH

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE CONTRACT ADMINISTRATOR AND CAN BE REPRODUCED ONLY WITH THE PERMISSION OF THE CONTRACT ADMINISTRATOR IN WHICH CASE THE REPRODUCTION MUST BEAR THE NAME OF THE CONTRACT ADMINISTRATOR.

THIS DRAWING SHALL NOT BE SCALED. FOLLOW GIVEN DIMENSIONS ONLY.

THE CONTRACTOR SHALL SATISFY HIMSELF THAT ALL DIMENSIONS AND INFORMATION SHOWN ARE CORRECT.

PRIOR TO COMMENCEMENT OF WORK REPORT ANY DISCREPANCIES TO THE CONTRACT ADMINISTRATOR.

VARIATIONS AND MODIFICATIONS TO WORK SHOWN WILL NOT BE ALLOWED WITHOUT WRITTEN PERMISSION OF THE CONTRACT ADMINISTRATOR.

CONSULTANT


TOWER PROJECT NO. : 6184



TOWER ENGINEERING GROUP
208 - 897 CORDON AVE. WINNIPEG, MB R3M 0W7
TEL: (204) 925-1150 FAX: (204) 925-1155
EMAIL: towereng@towereng.ca WEB: www.towereng.ca

SEAL

ORIGINAL AS SEALED ON
12/05/07
BY N.N. MARTINEZ, P. ENG.
MEMBER # 23109

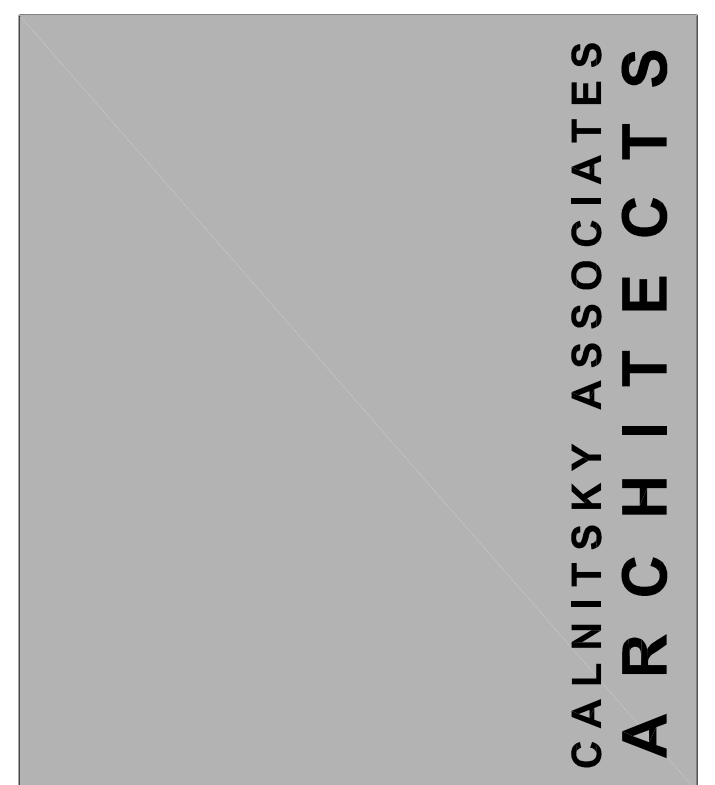

ARCHITECTURE 124 Nassau Street North Tel: (204) 453-6441	INTERIOR DESIGN Winnipeg, Manitoba R3L 2H1 Fax: (204) 453-3932 E-mail: caa@escape.ca
---	--

PROJECT TITLE

**NOTRE DAME
COMMUNITY CENTRE**

**271 DE LA CATHEDRALE AVE.
WINNIPEG, MANITOBA**

SHEET TITLE

GENERAL NOTES

DRAWN BY	SCALE	SHEET NUMBER
NB	AS NOTED	S-10
CHECKED BY	DATE	
DH/NM	MAY 2007	
PROJECT NUMBER	REVISION	
06-012	2.	