



**MAIN FLOOR PLAN**  
1:30

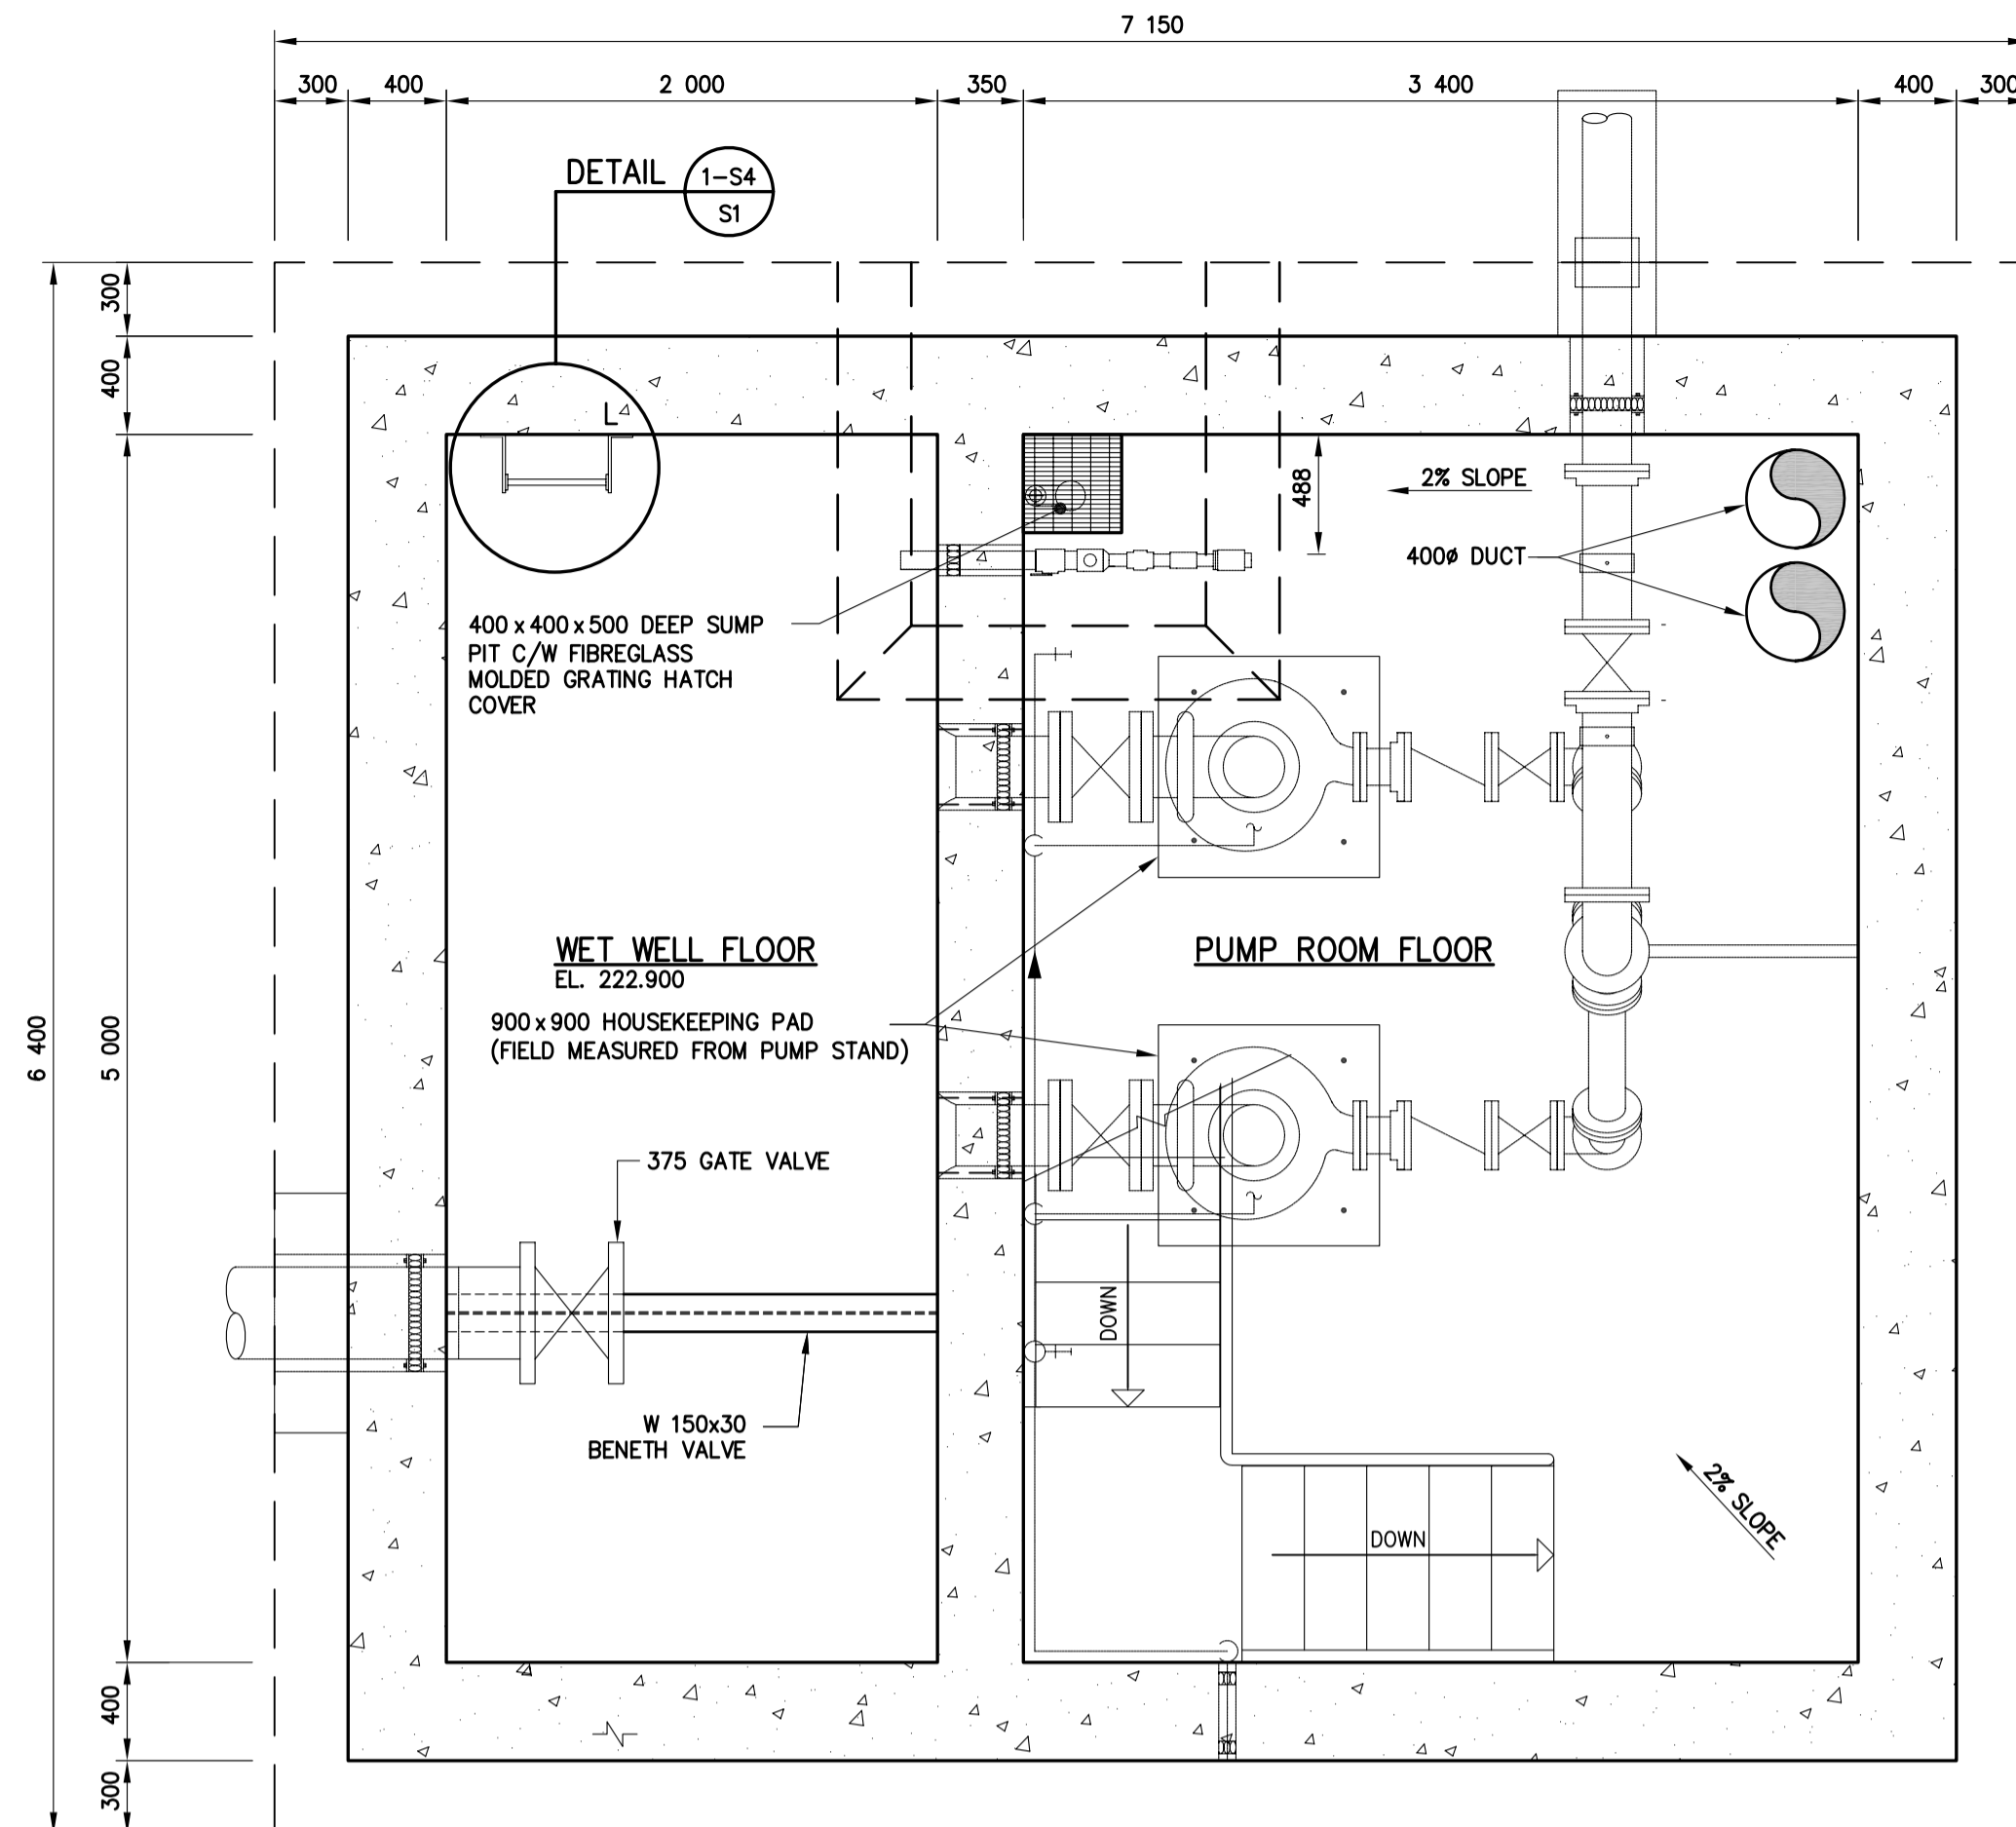

**PUMP FLOOR PLAN**  
1:30

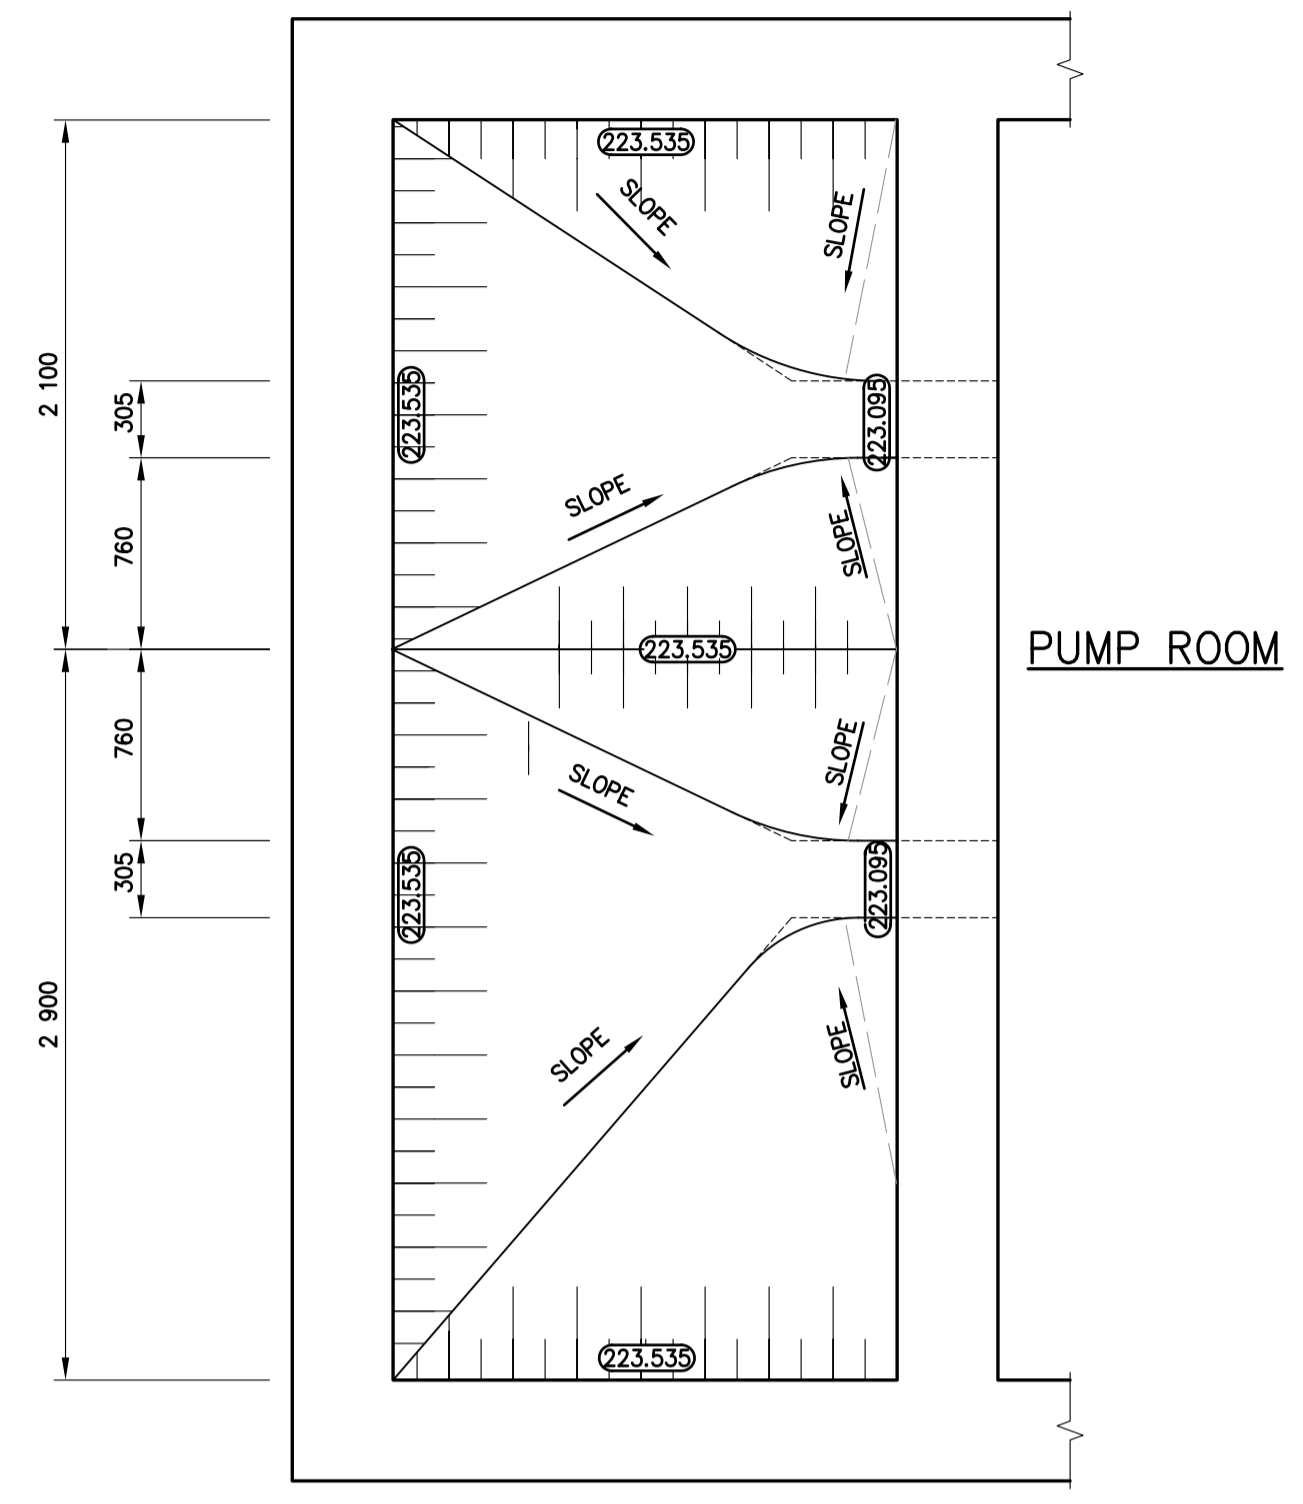

**WET WELL CONCRETE BENCHING PLAN**  
1:30

**GENERAL NOTES:**

- DESIGN IS IN ACCORDANCE WITH THE NATIONAL BUILDING CODE OF CANADA 1995 EDITION PLUS 1998 MANITOBA AMENDMENTS. CONCRETE WALLS ARE DESIGNED IN ACCORDANCE WITH THE RECOMMENDATIONS CONTAINED IN ACI 350R FOR WATERTIGHT STRUCTURES
- EXCAVATE ALL TOP SOIL, ORGANIC MATERIAL AND LOOSE OR UNSUITABLE FILL TO THE APPROVAL OF THE CONTRACT ADMINISTRATOR
- WATERSTOPS SHALL BE PROVIDED AT ALL CONSTRUCTION JOINTS. CONSTRUCTION JOINT LOCATIONS ARE TO BE APPROVED BY THE CONTRACT ADMINISTRATOR
- DO NOT SCALE THE DRAWINGS
- VERIFY ALL DIMENSIONS, ELEVATIONS AND SCOPE OF WORK PRIOR TO COMMENCEMENT OF CONSTRUCTION
- VERIFY ALL ELECTRICAL AND MECHANICAL OPENINGS WITH THE CONTRACT ADMINISTRATOR
- VERIFY ANY MAJOR OPENINGS THAT ARE REQUIRED BUT NOT SHOWN ON THE DRAWINGS WITH THE CONTRACT ADMINISTRATOR
- STRUCTURAL DRAWINGS SHOW THE COMPLETED STRUCTURE. THEY DO NOT SHOW THE COMPONENTS WHICH MAY BE NECESSARY FOR SAFETY DURING CONSTRUCTION
- THE CONTRACTOR IS RESPONSIBLE FOR SAFETY IN AND ABOUT THE JOB SITE DURING CONSTRUCTION
- IF ANY UNSOUND STRUCTURAL CONDITIONS ARE OBSERVED OR CREATED DURING CONSTRUCTION REPORT THEM IMMEDIATELY TO THE CONTRACT ADMINISTRATOR
- STRUCTURAL DRAWINGS MAY NOT SHOW ALL ELECTRICAL AND MECHANICAL OPENINGS. REFER TO ELECTRICAL AND MECHANICAL DRAWINGS FOR ACTUAL LOCATIONS AND ELEVATIONS OF OPENINGS. NOTIFY THE CONTRACT ADMINISTRATOR OF ANY ADDITIONAL OPENING REQUIREMENTS
- DESIGN LOADS ARE AS NOTED BELOW:
  - FLOOR LIVE LOADS: 4.8 kPa
  - STAIRS: 3.6 kPa
  - HATCHES: 3.6 kPa
  - ALL OTHER AREAS: 3.6 kPa
  - ROOF LOADS: 1.6 kPa PLUS APPLICABLE NBC MODIFICATIONS
  - SNOW LOAD: 1.6 kPa PLUS APPLICABLE NBC MODIFICATIONS
  - WIND LOAD:  $q(30)$  0.42 kPa
  - FOUNDATION WALL LOADS: 6.0 kPa ADDITIONAL CONSTRUCTION LOAD
  - LIVE LOAD:  $P = K(\gamma \times H + q)$
  - LATERAL FORCE: WHERE  $K = 0.7$ ,  $\gamma = 20 \text{ kN/m}^3$ ,  $H = \text{HT. OF FILL (m)}$ ,  $q = 6.0 \text{ kPa}$

**FOUNDATIONS:**

- FOUNDATIONS DESIGNED IN ACCORDANCE WITH RECOMMENDATIONS CONTAINED IN THE AUGUST 15, 2007, GEOTECHNICAL INVESTIGATION BY KGS GROUP

**CAST-IN-PLACE CONCRETE:**

- TO BE READ IN CONJUNCTION WITH CW 2160 AND AS AMENDED IN ACCORDANCE WITH THESE NOTES
- CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF CSA A23.1
- CONCRETE MIX SHALL BE IN ACCORDANCE WITH SPECIFICATION AND SHALL HAVE THE FOLLOWING PROPERTIES:
  - a. CLASS OF EXPOSURE: S-1
  - b. MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS: 35MPa
  - c. MAXIMUM SLUMP: 80mm ± 20mm
  - d. AIR CONTENT: 5 - 8%
  - e. MAXIMUM WATER/CEMENT RATIO: 0.40
- CONCRETE COVER SHALL BE 50mm
- CHAMFER ALL EXTERIOR CORNERS 20mm
- FORMWORK, SHORING AND BRACING SHALL MEET DESIGN CODE AND CSA A23.1 REQUIREMENTS AND BE CONSTRUCTED ACCURATELY SO THAT RESULTANT FINISHED CONCRETE CONFORMS TO THE SHAPES, LINES AND DIMENSIONS INDICATED ON THE DRAWINGS
- FOR COLD WEATHER CONCRETING ALL ICE, SNOW AND FROST SHALL BE REMOVED FROM THE FORMWORK AND THE TEMPERATURE OF ALL CONTACT SURFACES INCLUDING REINFORCING STEEL SHALL BE RAISED ABOVE 10°C FOR AT LEAST 24 HOURS PRIOR TO CASTING CONCRETE. CONCRETE SHALL NOT BE LESS THAN 20°C NOR MORE THAN 30°C WHEN DEPOSITED. CONCRETE SHALL BE ENCLOSED AND THIS AREA SHALL HAVE A TEMPERATURE OF NOT LESS THAN 20°C FOR 3 DAYS AND NOT LESS THAN 5°C FOR AN ADDITIONAL 4 DAYS
- THREE CONCRETE TEST CYLINDERS AND ONE SLUMP/AIR TEST SHALL BE TAKEN EACH DAY THAT CONCRETE IS PLACED, AND SHALL BE REPEATED FOR EVERY 20m³ OF CONCRETE PLACED EACH DAY UNLESS OTHERWISE DIRECTED BY THE CONTRACT ADMINISTRATOR
- NOTIFY THE CONTRACT ADMINISTRATOR OR TESTING AGENCY 48 HOURS PRIOR TO PLACING CONCRETE

**REINFORCING STEEL:**

- TO BE READ IN CONJUNCTION WITH CW 2160 AND AS AMENDED IN ACCORDANCE WITH THESE NOTES
- ALL REINFORCING STEEL SHALL CONFORM TO CSA G30.18M GRADE 400
- PERFORM CONCRETE REINFORCING WORK IN ACCORDANCE WITH CSA A23.1
- LAPS SHALL BE AT LEAST 40 BAR DIAMETERS. LOCATE REINFORCING SPLICES NOT INDICATED IN THE DRAWINGS AT POINTS OF MINIMUM STRESS
- BEFORE PLACING CONCRETE ENSURE REINFORCING IS CLEAN AND FREE OF LOOSE SCALE, DIRT OR OTHER FOREIGN MATTER THAT WOULD REDUCE OR PREVENT BOND TO THE CONCRETE

- SHOP DRAWINGS SHALL BE SUBMITTED WHICH CLEARLY INDICATE BAR SIZES, SPACINGS, LOCATIONS AND QUANTITIES OF REINFORCING STEEL. COPIES OF STRUCTURAL DRAWINGS WILL NOT BE ACCEPTED FOR USE AS SHOP DRAWINGS.

**STRUCTURAL STEEL:**

- ALL STRUCTURAL STEEL SHAPES AND PLATES SHALL BE IN ACCORDANCE WITH CSA G40.21-M GRADE 300W, EXCEPT W, HP AND HSS SECTIONS WHICH SHALL BE GRADE 350W CLASS C
- ALL GALVANIZING SHALL COMPLY WITH THE LATEST EDITION OF CSA G164, WITH MINIMUM ZINC COATING OF 600g/m². TOUCH UPS TO BE MADE WITH GALVALLOY OR GAL-VZ.
- ALL BOLTS TO BE ASTM A316 STAINLESS STEEL UNLESS OTHERWISE INDICATED

**FIBREGLASS GRATING:**

- GRATING SHALL BE: FIBREGRATE COMPOSITE STRUCTURES MOLDED GRATING 1 1/2" (38mm). COLOR SHALL BE GR-10

**CRANE (MONORAIL SYSTEM):**

- DESIGN CAPACITY OF CRANE ASSEMBLY = 19.6 kN (2 TON)
- CHAIN HOIST SHALL BE: ELECTRIC SINGLE PHASE PLUG IN HARRINGTON CB020 OR EQUIVALENT
- TROLLEY SHALL BE: HARRINGTON PTF 2020 OR EQUIVALENT

**PRE ENGINEERED SWING ARM HOIST (MAIN FLOOR):**

- DESIGN CAPACITY OF SWING ARM HOIST = 19.6 kN (2TON)
- DESIGN IN ACCORDANCE WITH DETAILS CONTAINED IN THE SPECIFICATIONS

**OTHER NOTES:**

- LOCATION AND SEWER DETAILS ARE SHOWN ON DRAWING 7500.
- ALL ALUMINUM IN CONTACT WITH CONCRETE SHALL BE PAINTED WITH BITUMINOUS ISOLATION COATING AT THE ALUMINUM/CONCRETE INTERFACE

Feb 13, 2008 - 2:06pm P:\41900 - 41909\18146 Dugald Road Pumping Station\Drawings\18146 Dugald Pumping Station 080211.dwg -18146-PLAN



**METRIC**  
WHOLE NUMBERS INDICATE MILLIMETRES  
DECIMALIZED NUMBERS INDICATE METRES

A-B  
C

A = DETAIL/SECTION No.  
B = DRAWING WHERE SHOWN  
C = DRAWING WHERE TAKEN

DESIGNED BY GK		CHECKED BY JPL	
DRAWN BY TR		APPROVED BY -	
HOR. SCALE AS SHOWN		RELEASED FOR CONSTRUCTION SIGNED BY K. ZUREK	
VERTICAL		DATE 08/02/13	
NO.	REVISIONS	DATE	BY
1	-	-	-
DATE 2008 02 11		DATE 08/02/13	

ENGINEER'S SEAL  
ORIGINAL SIGNED BY G.M. KING 08/02/11  
BID OPPORTUNITY 892-2007  
PLOT DATE: 2008 02 11

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT

**Winnipeg**

**DUGALD ROAD WASTEWATER PUMPING STATION**  
CONCRETE PLAN

CONSULTANT DRAWING NUMBER S1  
SHEET 9 OF 14  
CITY DRAWING NUMBER 7508