

PLAN
 0 1000 2000 3000 mm SCALE 1:100

DRAWING NOTES

GENERAL

- DO NOT SCALE DRAWINGS.
- VERIFY ALL DIMENSIONS SHOWN PRIOR TO COMMENCING CONSTRUCTION.
- VERIFY WEIGHT AND LOCATION OF ALL EQUIPMENT ON STRUCTURE AND REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO CONSTRUCTION.
- LOCATE UNDERGROUND SERVICES AND PROTECT THEM AT ALL TIMES DURING CONSTRUCTION.
- STRUCTURAL DRAWINGS SHOWING THE COMPLETED STRUCTURE DO NOT INDICATE COMPONENTS WHICH MAY BE NECESSARY FOR SAFETY DURING CONSTRUCTION.

SELECTIVE DEMOLITION

- REMOVE ITEMS AND MATERIALS WHERE SHOWN ON DRAWINGS. REMOVE ONLY MATERIALS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION.
- PROTECT WORK TO REMAIN.
- PROVIDE PROTECTION TO PERSONNEL WORKING IN ADJACENT AREAS.
- CAP OFF AND MAKE SAFE MECHANICAL AND ELECTRICAL SERVICES AS REQUIRED.
- STORE AND PROTECT MATERIALS AND ITEMS TO BE INSTALLED IN RENOVATED AREAS.
- REMOVE FROM SITE ALL MATERIALS NOT REQUIRED.

CAST-IN-PLACE CONCRETE

- ALL CONCRETE TO BE MANUFACTURED AND INSTALLED IN ACCORDANCE WITH LATEST EDITION OF CSA A23.1 AND CSA A23.2.
- CONCRETE STRENGTH AT 28 DAYS SHALL BE AS FOLLOWS UNLESS NOTED OTHERWISE ON DRAWINGS.

STRUCTURAL BASES: 30MPa;
 SLUMP MAX. 90mm;
 AGGREGATE MAX. 20mm;
 ENTRAINED AIR 3-5%


REINFORCING STEEL

- ALL REINFORCING STEEL TO BE CSA G30.18M 92 400MPa DEFORMED BARS EXCEPT STIRRUPS WHICH MAY BE 300 MPa GRADE STEEL. ALL REINFORCING TO BE DETAILED IN ACCORDANCE WITH LATEST EDITION OF ACI DETAILING MANUAL, UNLESS OTHERWISE NOTED.
- REINFORCING STEEL COVER TO CONFORM TO LATEST EDITION OF CSA A23.3 AND AS FOLLOWS:

BASES: 1" (25mm)

GROUT

- GROUT SHALL BE DIRECT CONTACT NON SHRINKING, OIL RESISTANT EPOXY TYPE. UNISORB V100 OR EQUIVALENT, MINIMUM 3 DAY COMPRESSIVE STRENGTH OF 11000 PSI (76 MPa).
- PLACE GROUT ACCORDING TO ENGINE MANUFACTURER AND GROUT MANUFACTURER'S RECOMMENDATIONS.

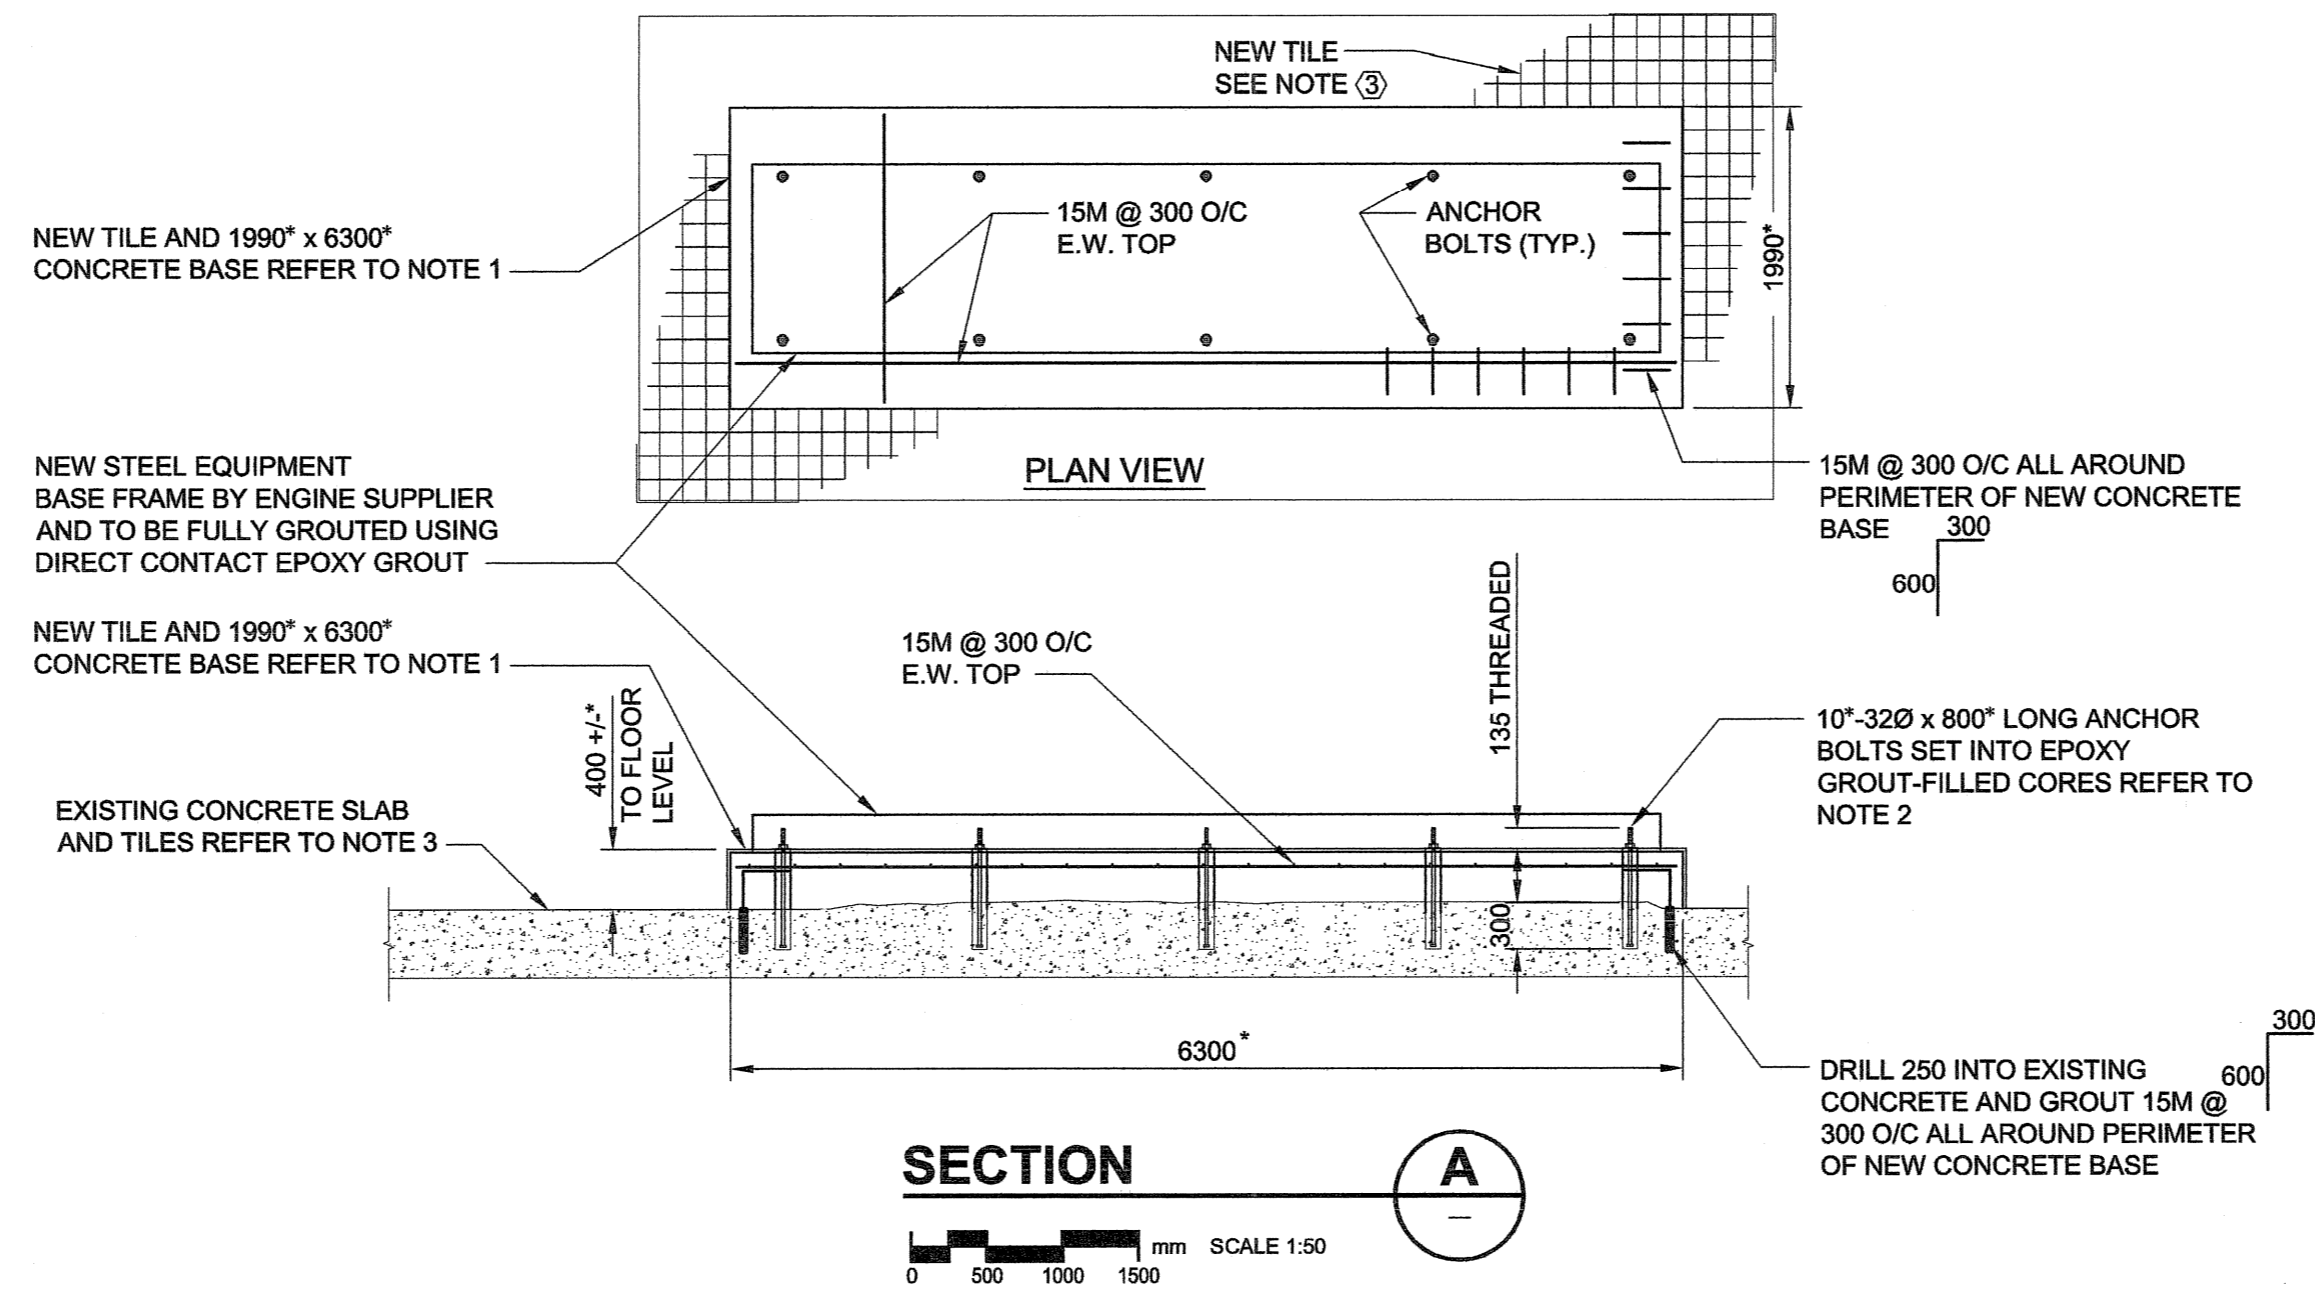

SECTION
 0 500 1000 1500 mm SCALE 1:50

SECTION AND PLAN VIEW NOTES:

- REMOVE EXISTING TILE AND CONCRETE BASE TO FLOOR LEVEL LEAVING SURFACE ROUGH AND CLEAN. REPLACE WITH NEW CONCRETE BASE AND CERAMIC TILE.
- 100Ø SLEEVE THROUGH NEW CONCRETE BASE AND CORE 100Ø HOLE 300 INTO EXISTING CONCRETE SLAB, SLEEVE AND CORE LOCATIONS TO BE DETERMINED ON SITE TO SUIT STEEL BASE FOR NEW ENGINE AND EXISTING PUMP.
- SAWCUT AND REMOVE EXISTING TILE TO GROUT LINE APPROX. 600mm ALL AROUND NEW CONCRETE BASE AND REPLACE WITH NEW TILE, REFER TO SECTION 093013 FOR TILING SPECIFICATION.
- REPAIR/PATCH CERAMIC TILES AS REQUIRED BY OTHER SUPPORT AND EQUIPMENT REMOVALS.
- * FIELD VERIFY OR VERIFY WITH ENGINE MANUFACTURER REGARDING DIMENSIONS AND/OR QUANTITY

DRN	CHK	DES	ENG	IDR
UMA REVIEW				

B	ISSUED FOR BID	08/11/21	RS
A	ISSUED FOR REVIEW	08/10/28	RS
NO.	REVISIONS	YY/MM/DD	BY

DESIGNED BY	SBB	CHECKED BY	
DRAWN BY	RS	APPROVED BY	
HOR. SCALE	AS NOTED	RELEASED FOR CONSTRUCTION	
VERT. SCALE	AS NOTED	DATE	

© 2008 UMA Engineering Ltd. All Rights Reserved. This document is protected by copyright law and may not be used, reproduced or modified in any manner or for any purpose except with the written permission of UMA Engineering Ltd. or a party to which the copyright has been assigned. UMA accepts no responsibility, and denies any liability whatsoever, to any party that uses, reproduces, modifies, or relies on this document without UMA's express written consent.

PROFESSIONAL'S SEAL
 PROVINCE OF MANITOBA
 REGISTERED PROFESSIONAL ENGINEER
 B. SWANGER
 04/11/26
 CONSULTANT DRAWING NO.
 D265-199-00_05-S-0001_RX.dwg

UMA AECOM
 Certificate of Authorization
 UMA Engineering Ltd. (MB)
 No. 256 Date: 04/11/26

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 G. C. MACLEAN PUMPING STATION
 P-26 ENGINE REPLACEMENT
 CONCRETE BASE
 PLAN AND SECTION

SHEET 1 OF 1
 CITY DRAWING NUMBER
 1-0630M-S0001-001
 REV B