


115.0 PARTIALLY DETERIORATED
OVALITY = 3.0%

BANTING DRIVE

PORTAGE AVE

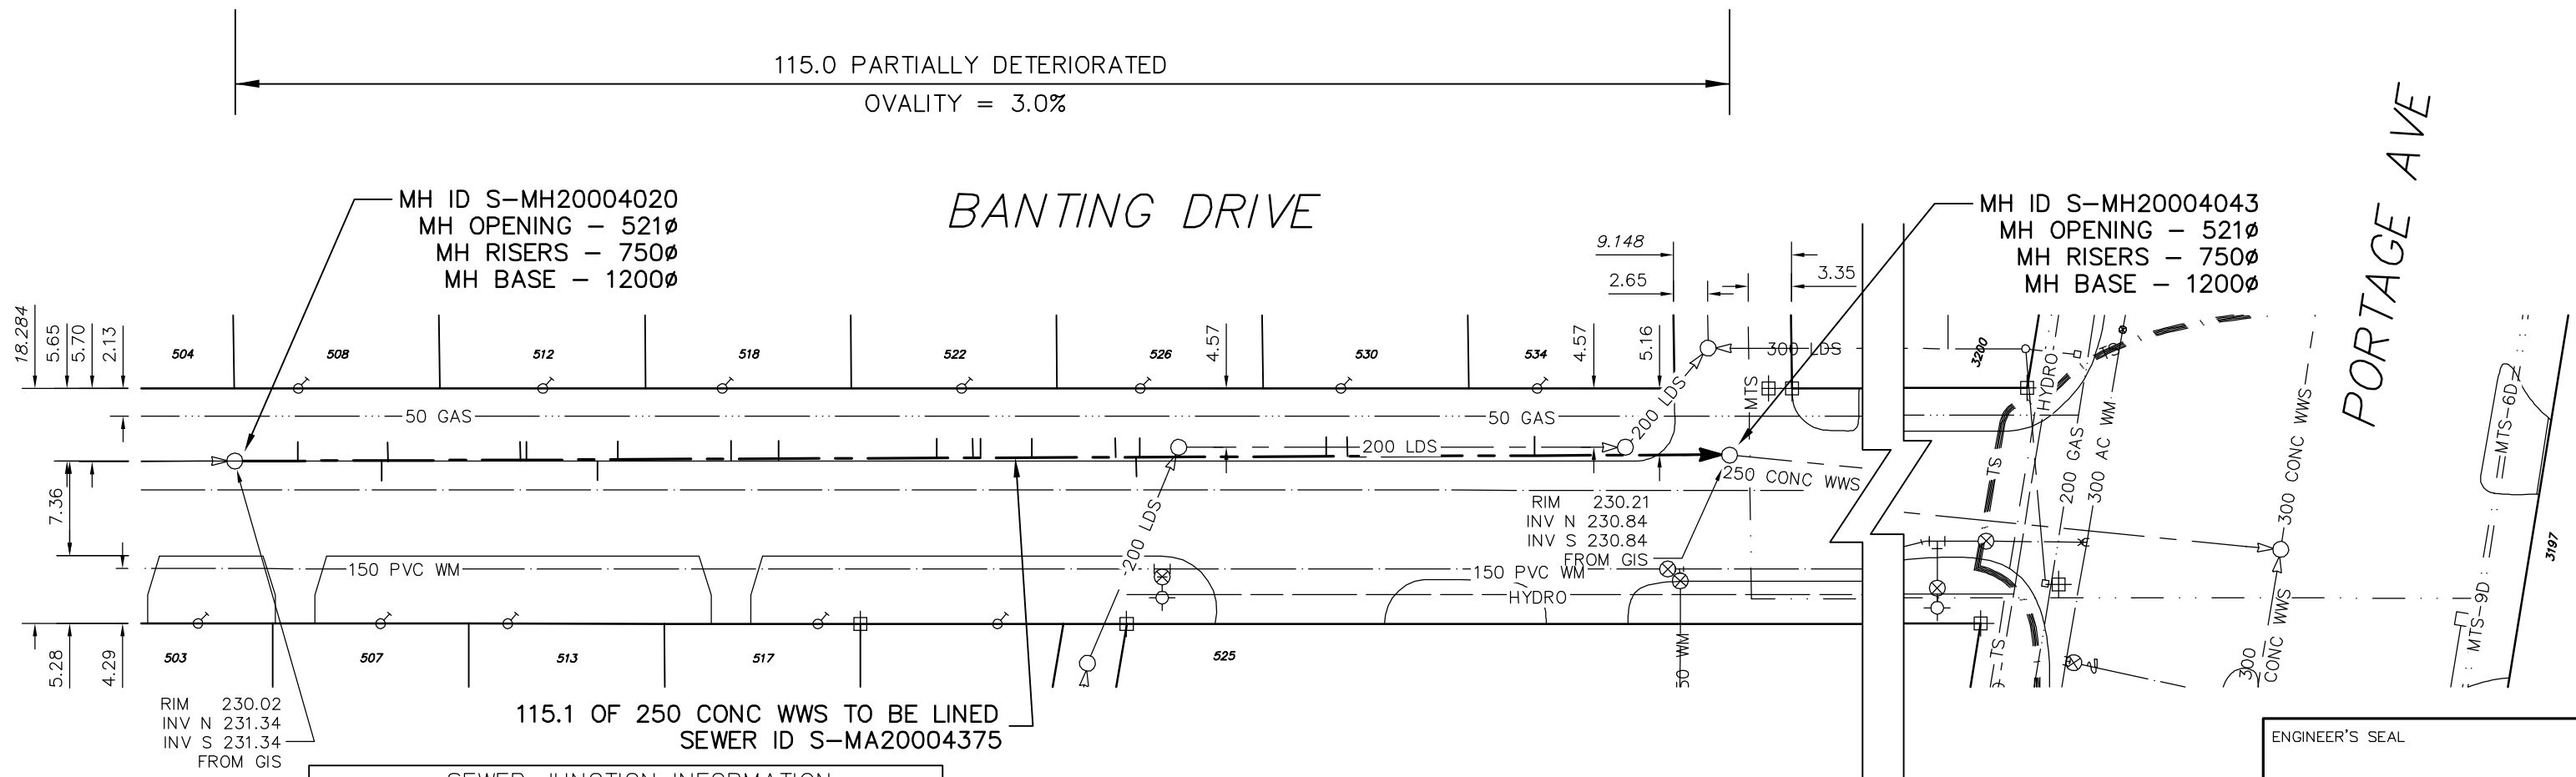

RIM 230.02
INV N 231.34
INV S 231.34
FROM GIS

115.1 OF 250 CONC WWS TO BE LINED
SEWER ID S-MA20004375

SEWER JUNCTION INFORMATION FROM SEWER VIDEO INSPECTION S-MA20004375				
DISTANCE FROM MH S-MH20004020				
4.90	N	100ø	TOP	CN
11.40	N	150ø	EAST	CN
11.90	N	150ø	TOP	CN
22.20	N	100ø	TOP	CN
22.70	N	150ø	TOP	CN
28.20	N	150ø	EAST	CN
29.80	N	150ø	TOP	CN
38.60	N	100ø	TOP	CN
42.30	N	150ø	TOP	CN
54.60	N	100ø	TOP	CN
57.40	N	150ø	WEST	CNI
58.00	N	150ø	TOP	CN
62.00	N	150ø	TOP	CNI
68.50	N	150ø	TOP	CN
70.10	N	150ø	EAST	CNI
70.40	N	150ø	WEST	CNI
84.90	N	150ø	TOP	CNI
86.50	N	100ø	WEST	CN
101.10	N	150ø	TOP	CX

ENGINEER'S SEAL

ORIGINAL
SIGNED BY
S.R.J.
COURNOYER
09/01/08

BID OPPORTUNITY: 924-2008
FILENAME : 8762.dwg
PLOT DATE : 2009 01 08

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

B.M. ELEV.	FIELD BOOK #:	CITY OF WINNIPEG WATER AND WASTE ENGINEERING DIVISION		THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT	
POSTED TO LIS		DESIGNED BY: SC	CHECKED BY: SC	2009 SEWER RENEWALS BY CIPP LININGS BANTING DRIVE	
		DRAWN BY: WKT	APPROVED BY: KZ	SHEET 1 OF 34	
		HOR. SCALE 1:500	RELEASED FOR CONSTRUCTION	CITY DRAWING NUMBER	
		VERTICAL		8762	
NO.	REVISIONS	DATE	BY	2009 01 08	
				2ND MH S OF PORTAGE AVENUE TO 1ST MH S OF PORTAGE AVENUE	