


TLS-065

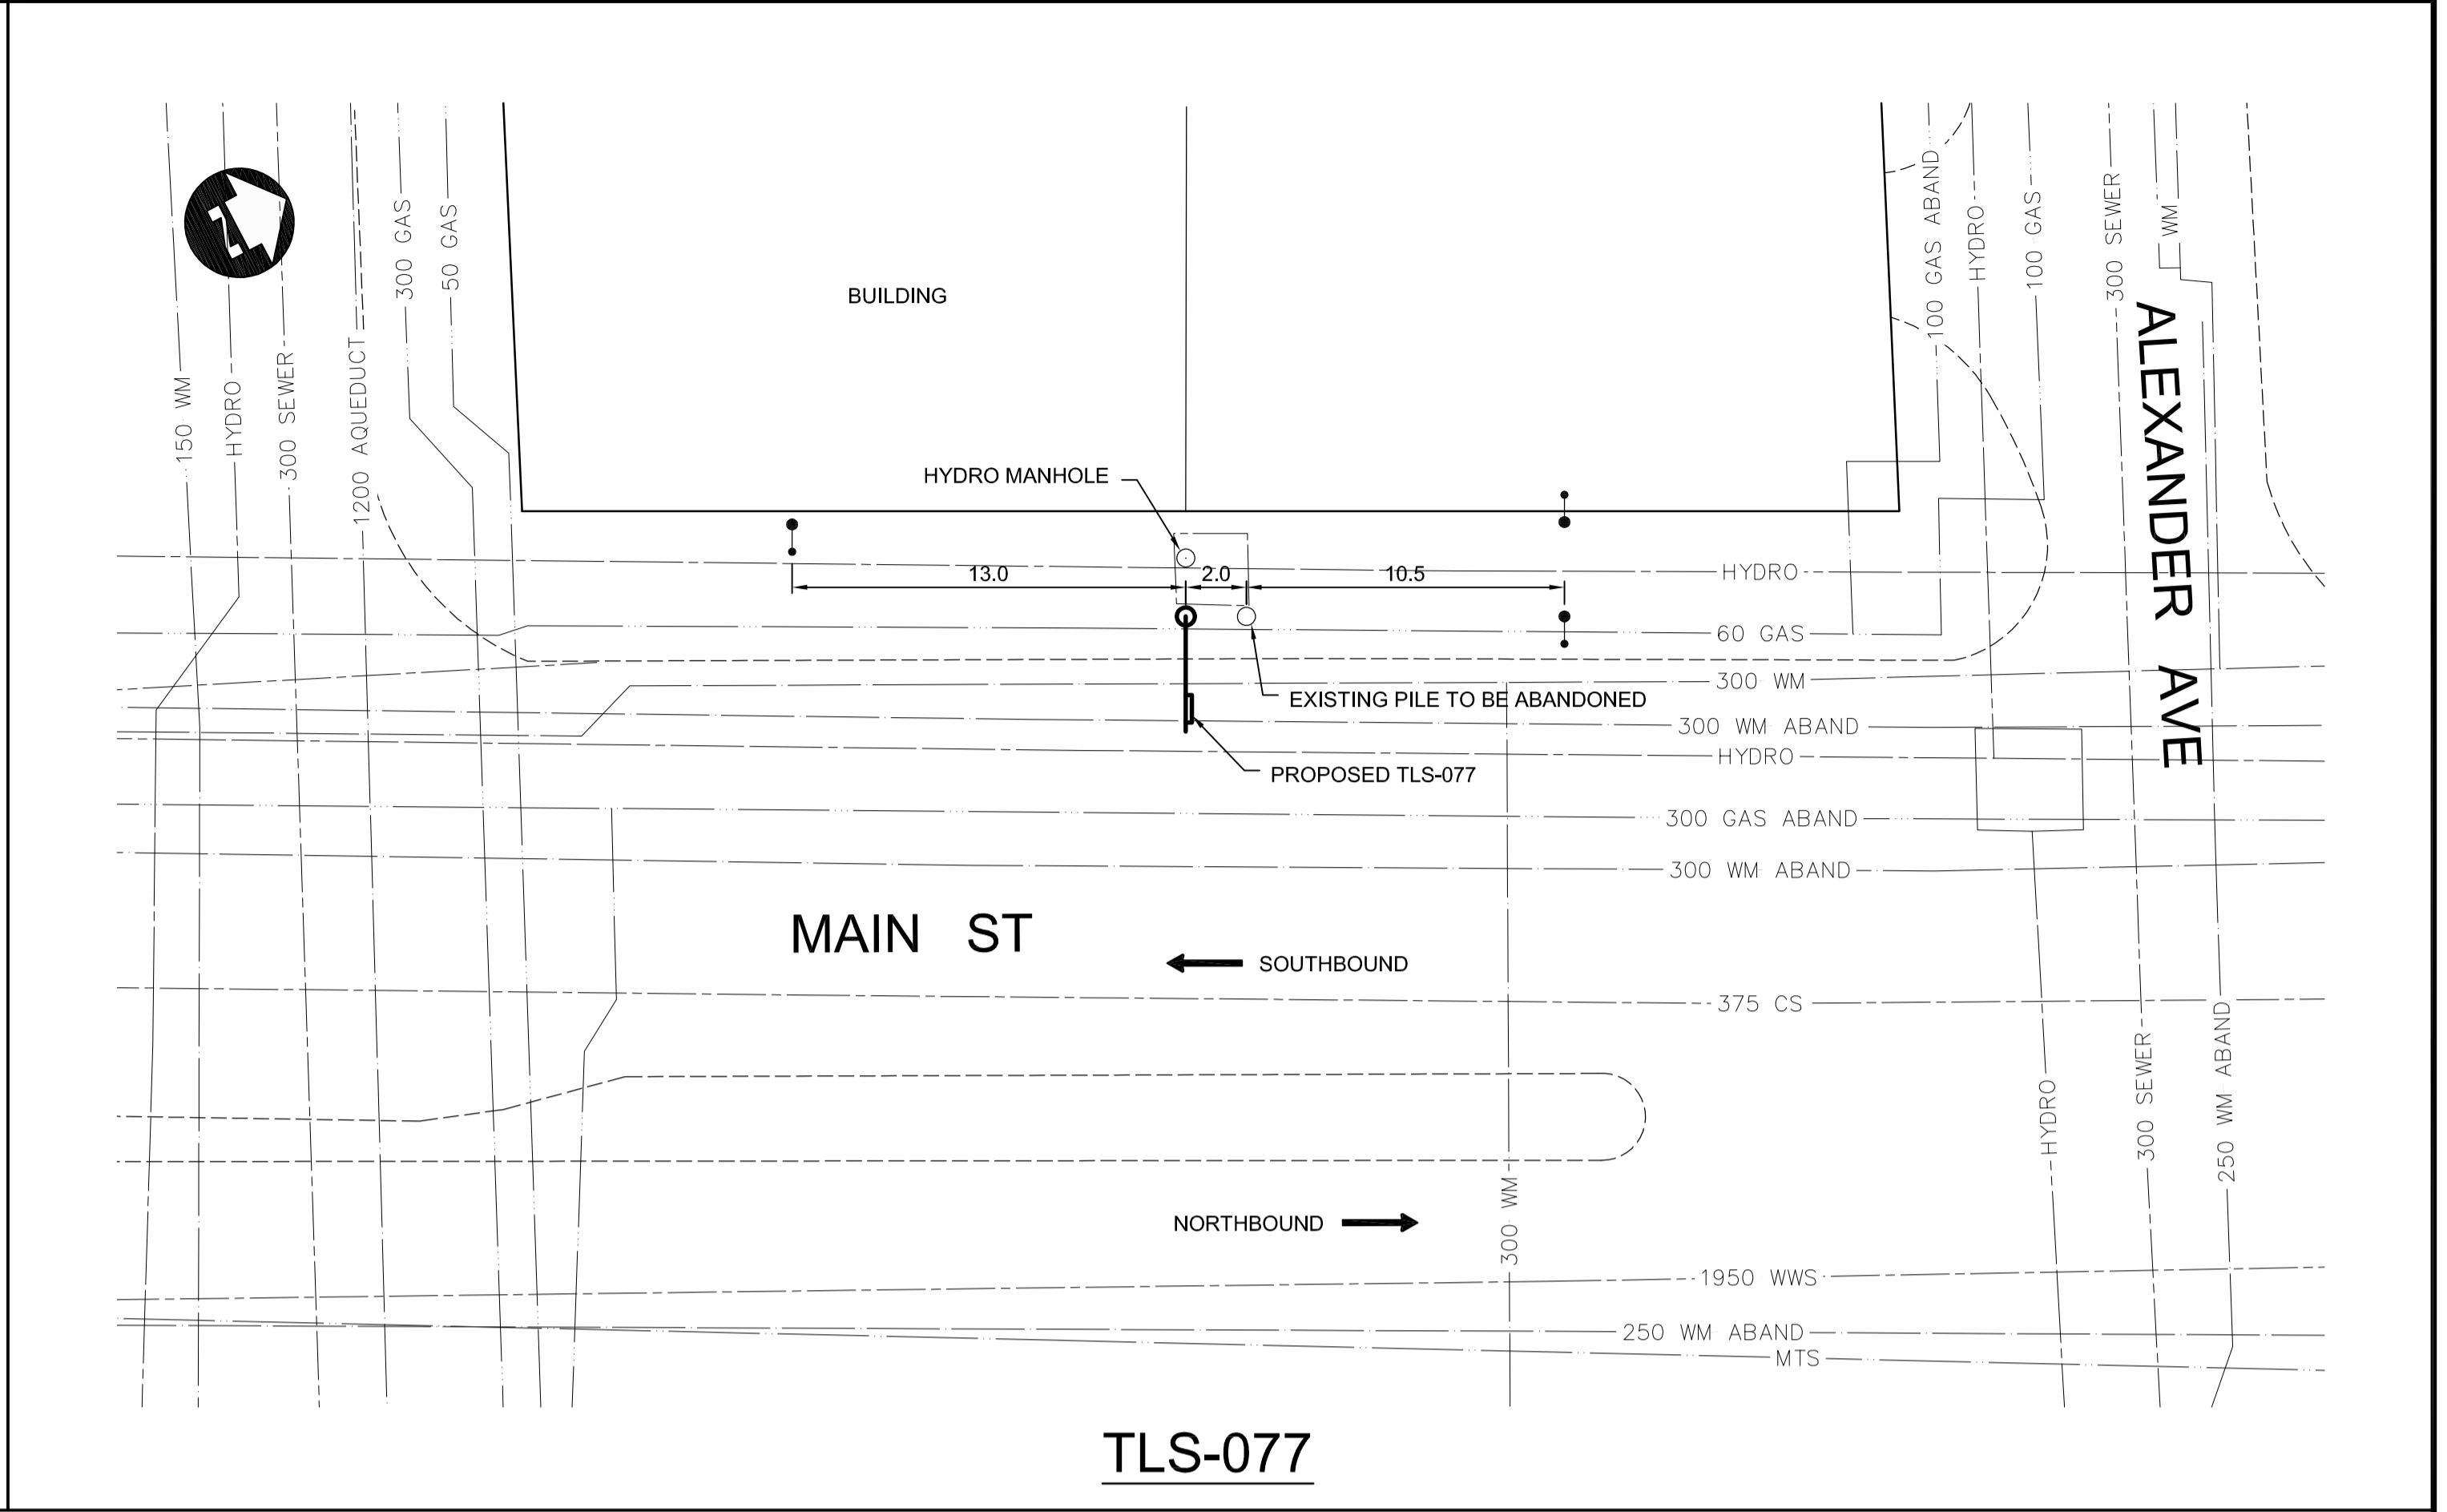

TLS-077

NOTE: DIMENSIONS SHOWN ARE APPROXIMATE ONLY

150 WM	WATERMAIN	150 WM	HYDRO	HYDRO	HYDRO	150 mm W.M.	WATERMAIN	150 mm W.M.	UNDERGROUND STRUCTURES SUPPLY, U/G STRUCTURES COMMITTEE DATE: _____	B.M. ELEV. _____	DESIGNED BY: RJT DRAWN BY: TJH CHECKED BY: DBW APPROVED BY: _____				ON STREET TRANSIT PRIORITY IMPROVEMENTS - PHASE 3	CITY DRAWING NUMBER: TLS-09-13 SHEET 13 OF 23 CONSULTANT DRAWING NUMBER: _____
300 LDS	LAND DRAINAGE SEWER	300 LDS	MTS	MTS	300 mm L.D.S.	LAND DRAINAGE SEWER	300 mm L.D.S.	LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE, BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.								
250 WWS	WASTE WATER SEWER	250 WWS	MTS	MTS	250 mm W.W.S.	WASTE WATER SEWER	250 mm W.W.S.									
○	MANHOLE	●	MTS	MTS	MTS	MTS	MTS	MTS								
□	CATCH BASIN	■	MTS	MTS	MTS	MTS	MTS	MTS								
▽	CURB INLET	▽	MTS	MTS	MTS	MTS	MTS	MTS								
+	JUNCTIONS	+	MTS	MTS	MTS	MTS	MTS	MTS								
—	CULVERT	—	MTS	MTS	MTS	MTS	MTS	MTS								
100 GAS	GAS	100 GAS	MTS	MTS	MTS	MTS	MTS	MTS								
EXISTING	LEGEND—PLAN	PROPOSED	EXISTING	LEGEND—PLAN	PROPOSED	EXISTING	LEGEND—PROFILE	PROPOSED								

G:\CAD\09-1545\Contract\CHSS\CHSS-PLAN.dwg