



**NOTES:**

1. BACKFILL UNDER PAVEMENT, IN SIDEWALKS, & WITHIN 1.0 m OF PAVEMENT TO BE CLASS 3.
2. CONFIRM LIMITS OF REPAIR IN PRESENCE OF THE CONTRACT ADMINISTRATOR BY CCTV.

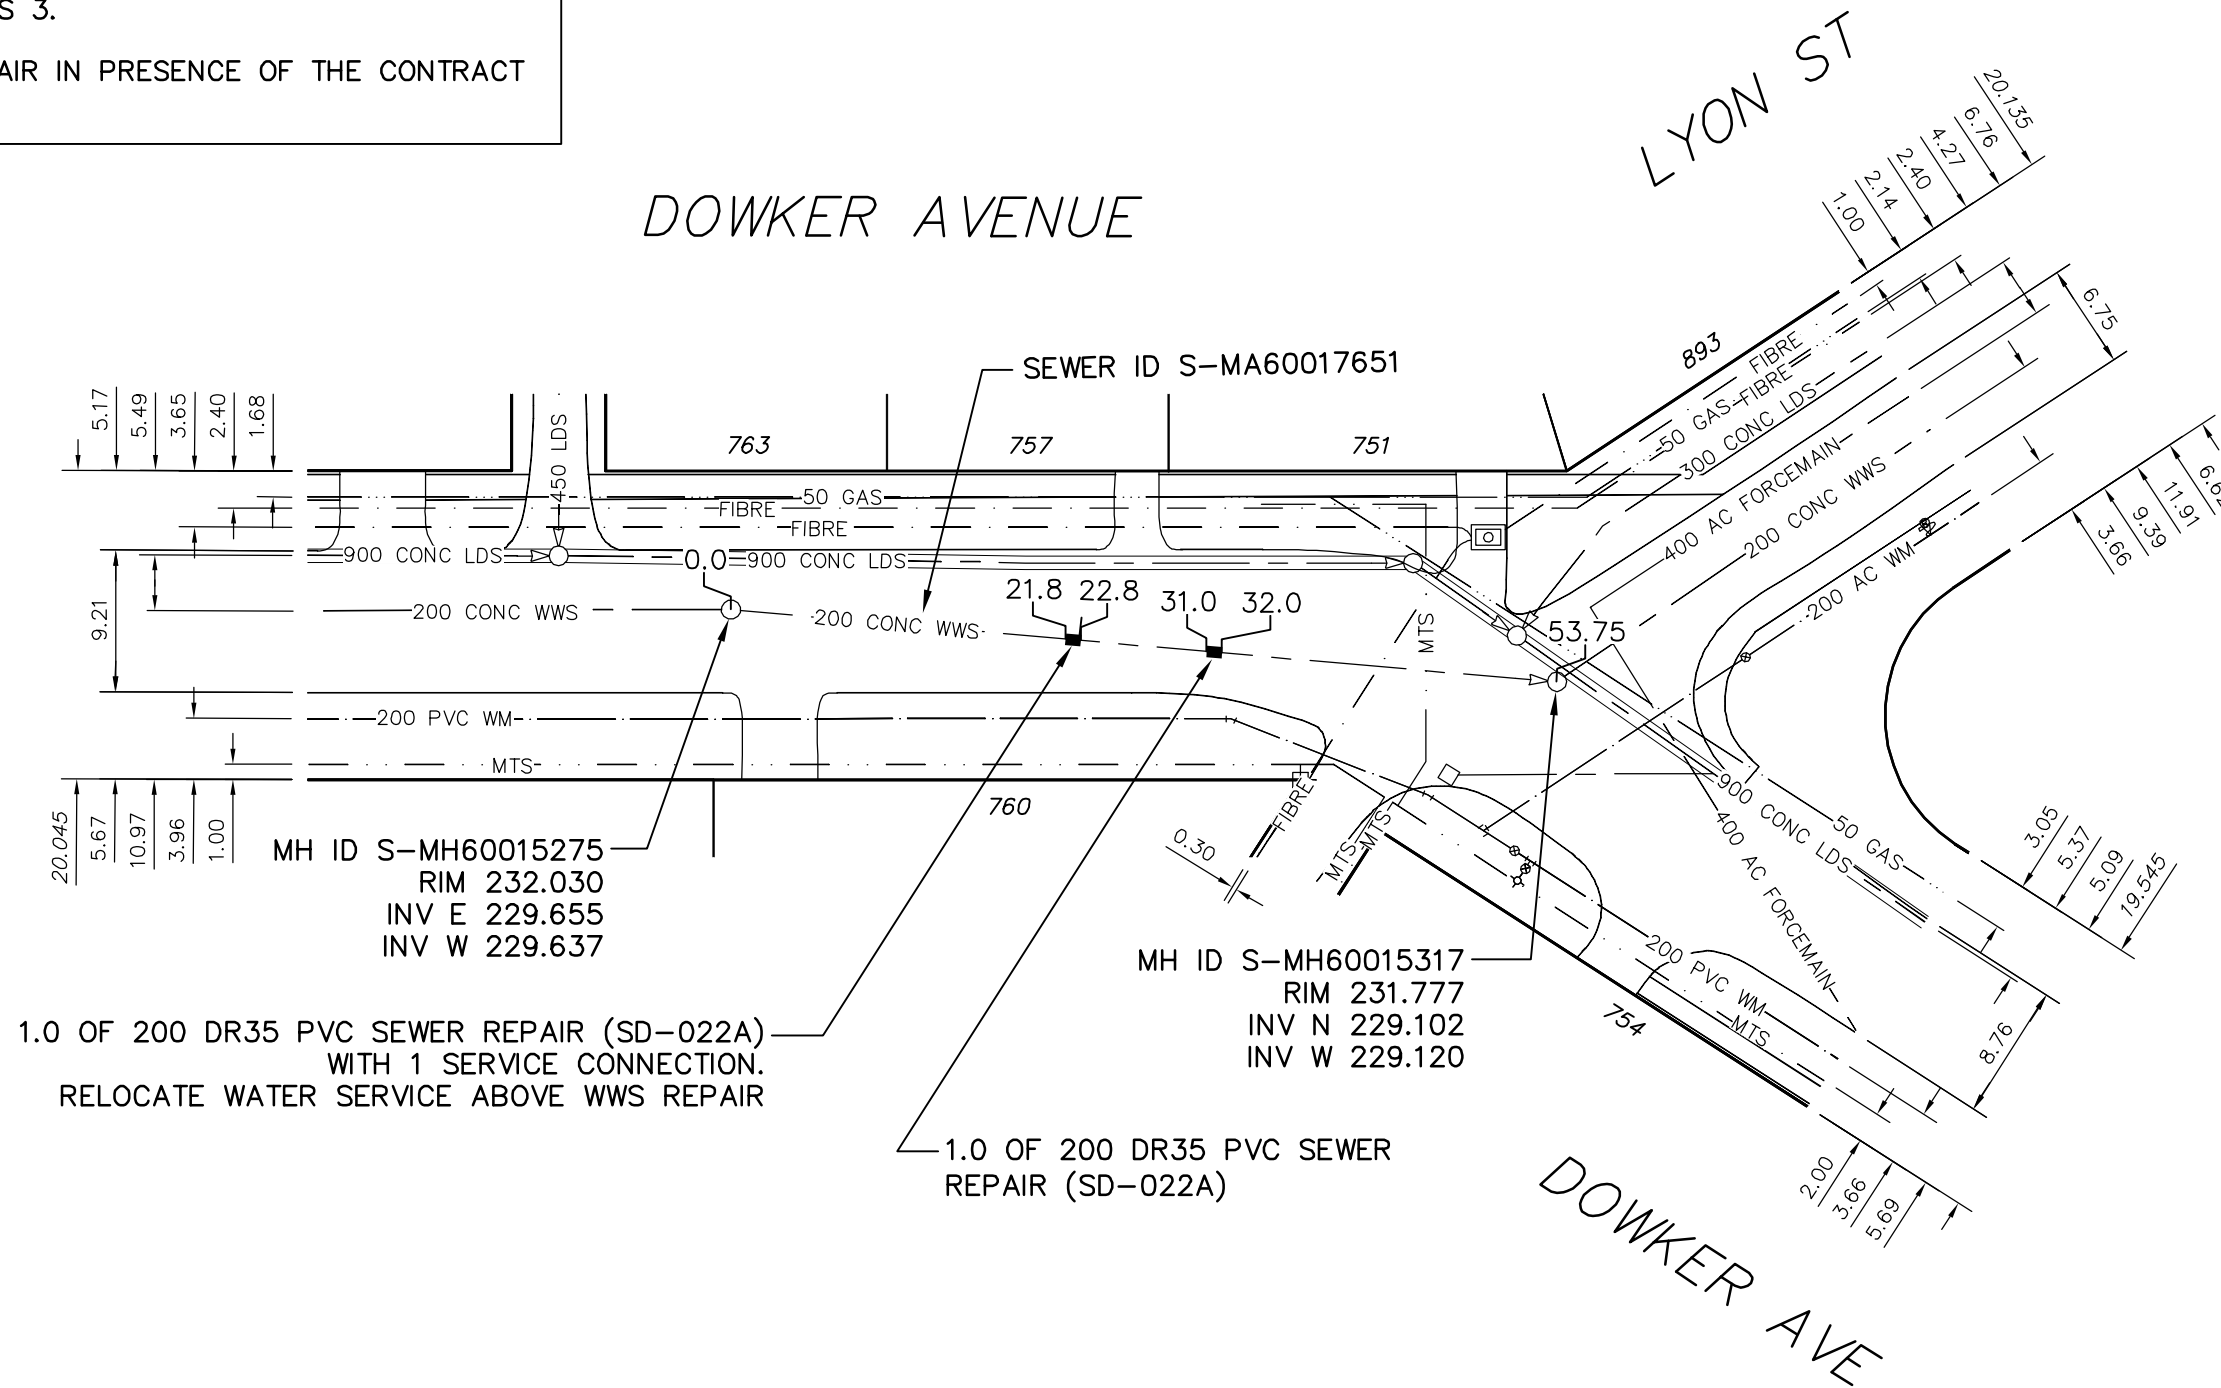

1.0 OF 200 DR35 PVC SEWER REPAIR (SD-022A) WITH 1 SERVICE CONNECTION. RELOCATE WATER SERVICE ABOVE WWS REPAIR

1.0 OF 200 DR35 PVC SEWER REPAIR (SD-022A)

MH ID S-MH60015275  
RIM 232.030  
INV E 229.655  
INV W 229.637

MH ID S-MH60015317  
RIM 231.777  
INV N 229.102  
INV W 229.120

SEWER JUNCTION INFORMATION FROM SEWER VIDEO INSPECTION SEWER ID S-MA60017651			
DISTANCE FROM MH ID S-MH60015275			
22.7	E	150ø	NORTH CNI

ENGINEER'S SEAL

ORIGINAL  
SIGNED BY  
S.R.J.  
COURNOYER  
09/10/22

BID OPPORTUNITY: 703-2009  
FILENAME : 9068.dwg  
PLOT DATE : 2009 10 26

**LEGEND:**  
52.0 | MEASUREMENT TO REPAIR FROM REFERENCE MH SHOWN THUS...  
0.0

**METRIC**  
WHOLE NUMBERS INDICATE MILLIMETRES  
DECIMALIZED NUMBERS INDICATE METRES

B.M. ELEV. POSTED TO LIS	FIELD BOOK #:	<b>CITY OF WINNIPEG</b> WATER AND WASTE ENGINEERING DIVISION		<b>THE CITY OF WINNIPEG</b> WATER AND WASTE DEPARTMENT	2009 SEWER RENEWALS AND REPAIRS CONTRACT 24 <b>DOWKER AVENUE</b> 1ST MH W OF LYON STREET TO MH AT LYON STREET	SHEET 1 OF 18 CITY DRAWING NUMBER 9068
DESIGNED BY AMC	CHECKED BY SC	DRAWN BY CJH	APPROVED BY KZ			
HOR. SCALE 1:500		RELEASED FOR CONSTRUCTION				
NO. REVISIONS		DATE BY		DATE 2009 10 20		