


B SIZE - 279mm x 432mm

LAST SAVE: 2009/12/08 - 2:13pm
 PATH: M:\112577\0105\4ENG\47ELE\DD - General DWG\1-0102G-A0040-001-00.dwg

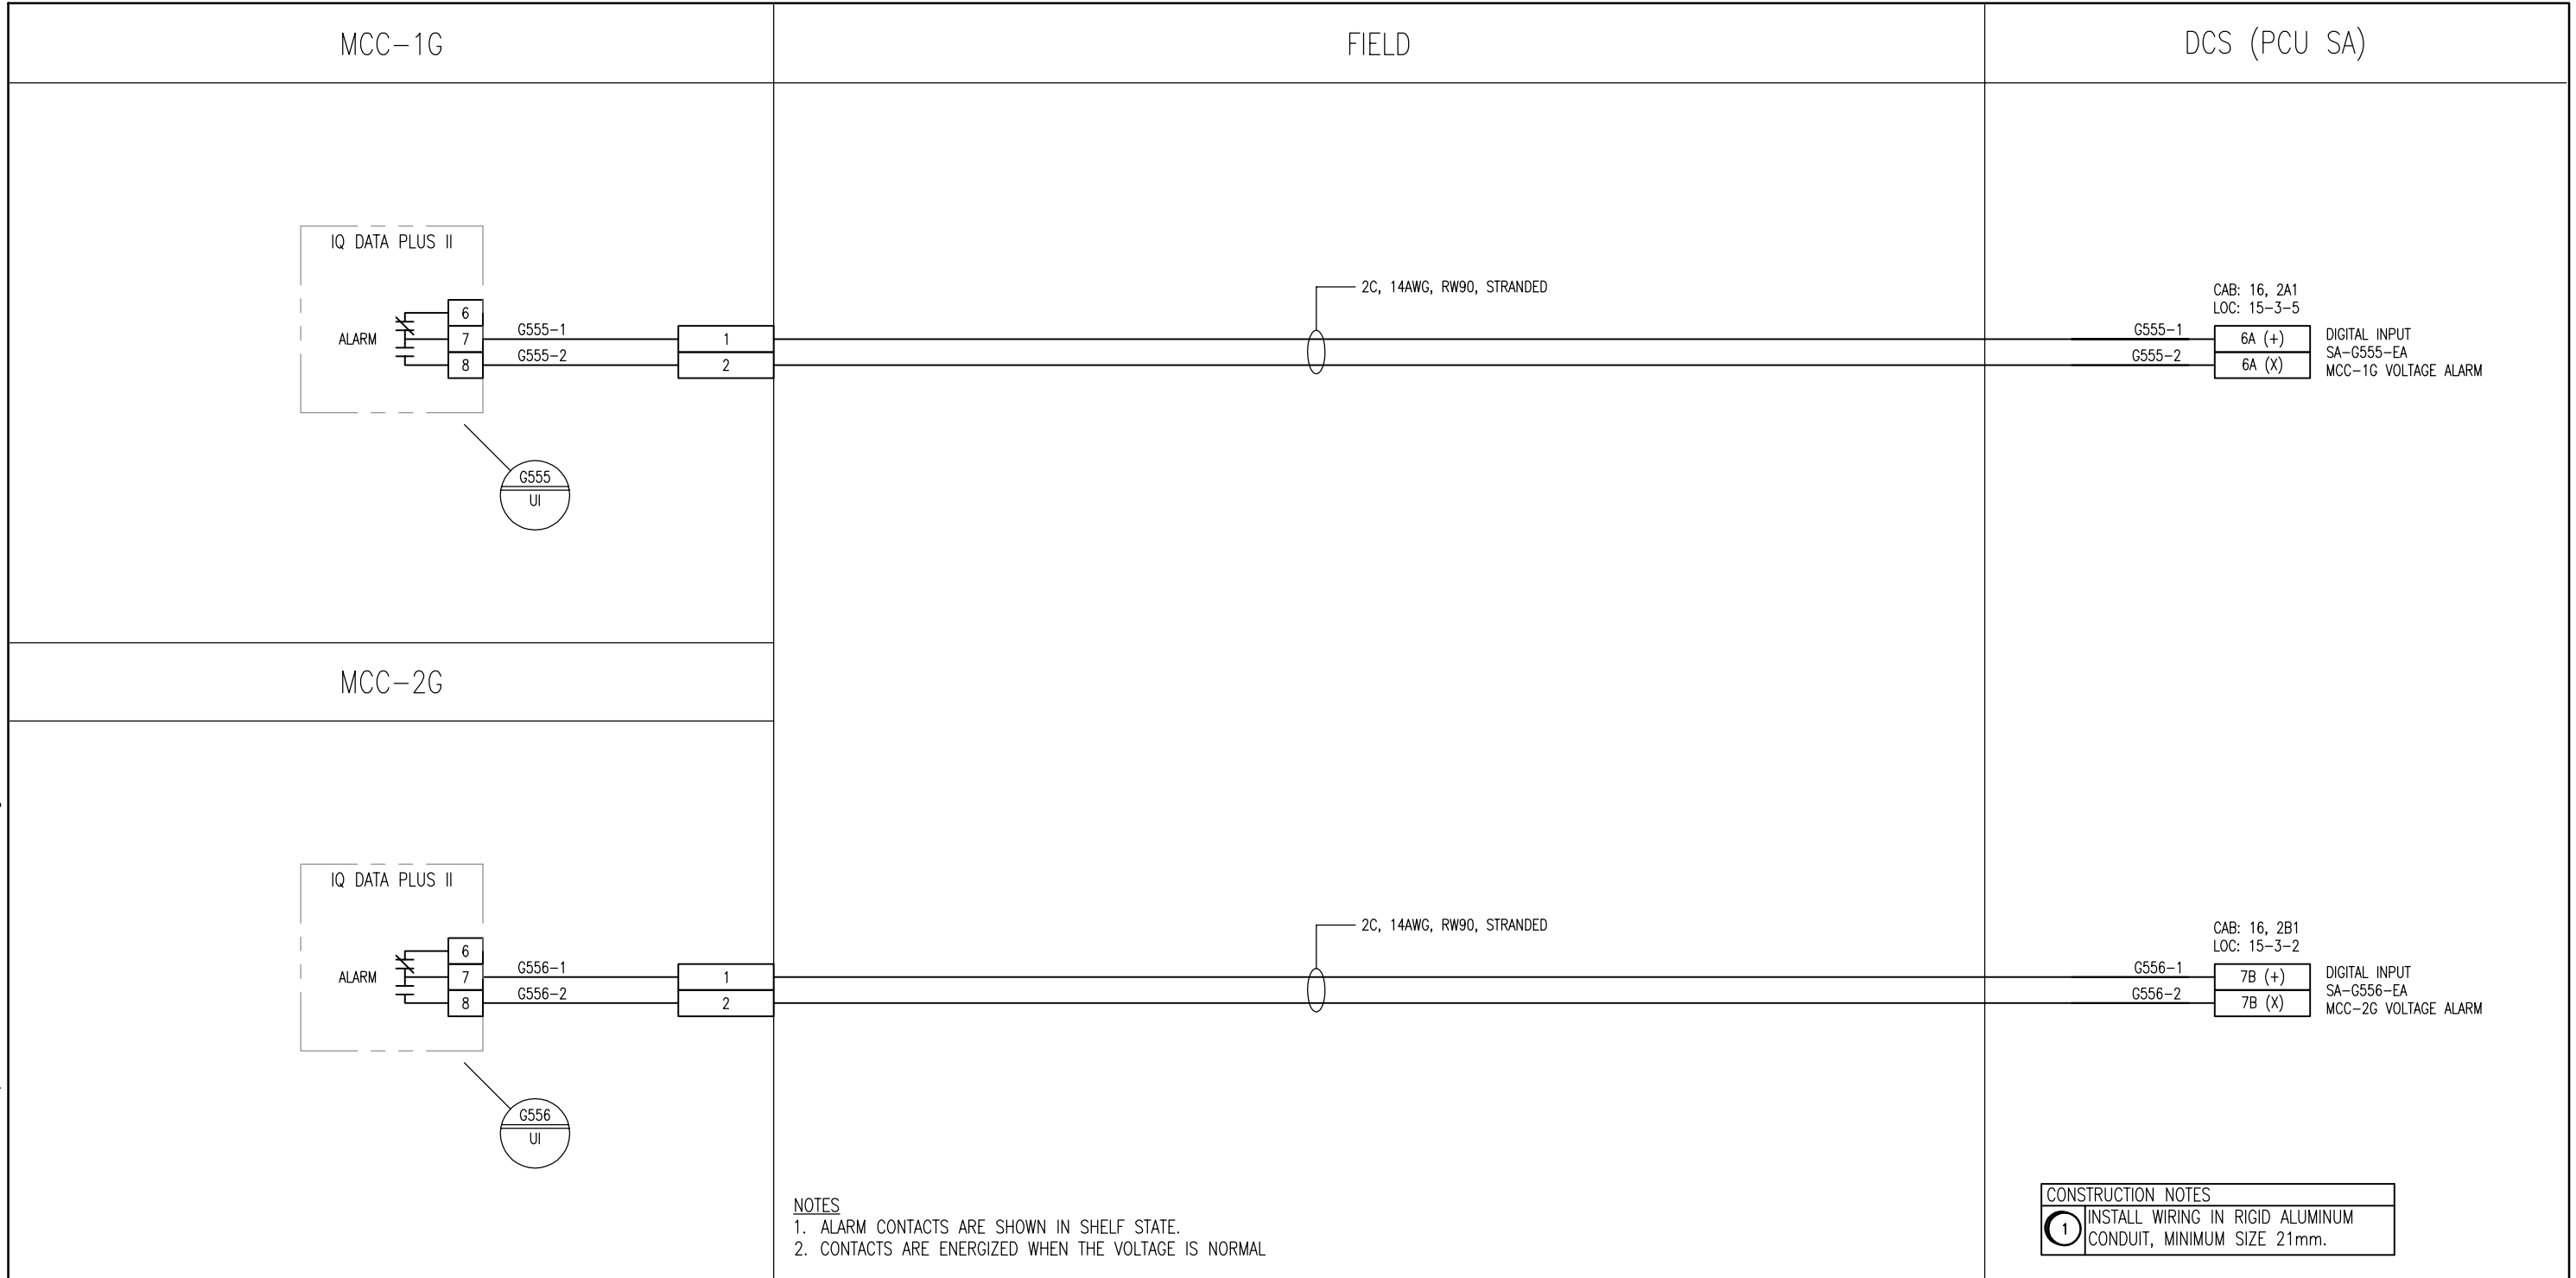

NOTES
 1. ALARM CONTACTS ARE SHOWN IN SHELF STATE.
 2. CONTACTS ARE ENERGIZED WHEN THE VOLTAGE IS NORMAL.

CONSTRUCTION NOTES
 1. INSTALL WIRING IN RIGID ALUMINUM CONDUIT, MINIMUM SIZE 21mm.

APEGM
 Certificate of Authorization
SNC-Lavalin Inc.
 No. 4489 Expiry: April 30, 2010

SNC-LAVALIN INC.
 148 Nature Park Way
 Winnipeg, MB, Canada R3P 0X7
 204-786-8080

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER, BID OPP. 837-2009	2009/12/07	NB	CJR

DESIGNED BY: N. BRADOO	CHECKED BY: C. REIMER
DRAWN BY: S. COATES	APPROVED BY: C. REIMER
SCALE: N.T.S.	DATE: 2009/12/07
RELEASED FOR CONSTRUCTION	
BY: J. VEILLEUX	DATE: 2009/12/02
CONSULTANT NO.: 112577-0105-47DD-0130	

ENGINEER'S SEAL
 ORIGINAL DRAWING
 SEALED BY:
N. BRADOO
 SNC-LAVALIN
 MEMBER 32727
 2009/12/07
 REV. 00

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
 ELECTRICAL INSPECTION AND UPGRADES
 LOOP DIAGRAM
 MCC-1G & MCC-2G VOLTAGE ALARMS

CITY DRAWING NUMBER 1-0102G-A0040	SHEET 001	REV. 00	SIZE B
---	---------------------	-------------------	------------------