


KEY PLAN

NOTES

1. FIELD RUN REFRIDGERANT PIPING TO AVOID INTERFERENCES AND MEET ALL CODES AND APPLICABLE STANDARDS.
2. INSTALL CONDENSING UNITS TO MEET ALL APPLICABLE CODES AND STANDARDS.

KEY NOTES

- ① EXISTING UTILITY PITCH POCKET, RESTORE FLASHING TO EXISTING CONDITION, AIR AND WATER TIGHT
- ② NEW CONDENSING UNITS, ON EXISTING ROOF CURBS; PROVIDE LABOR AND MATERIAL TO SUIT NEW CONDENSING UNITS INSTALLATION

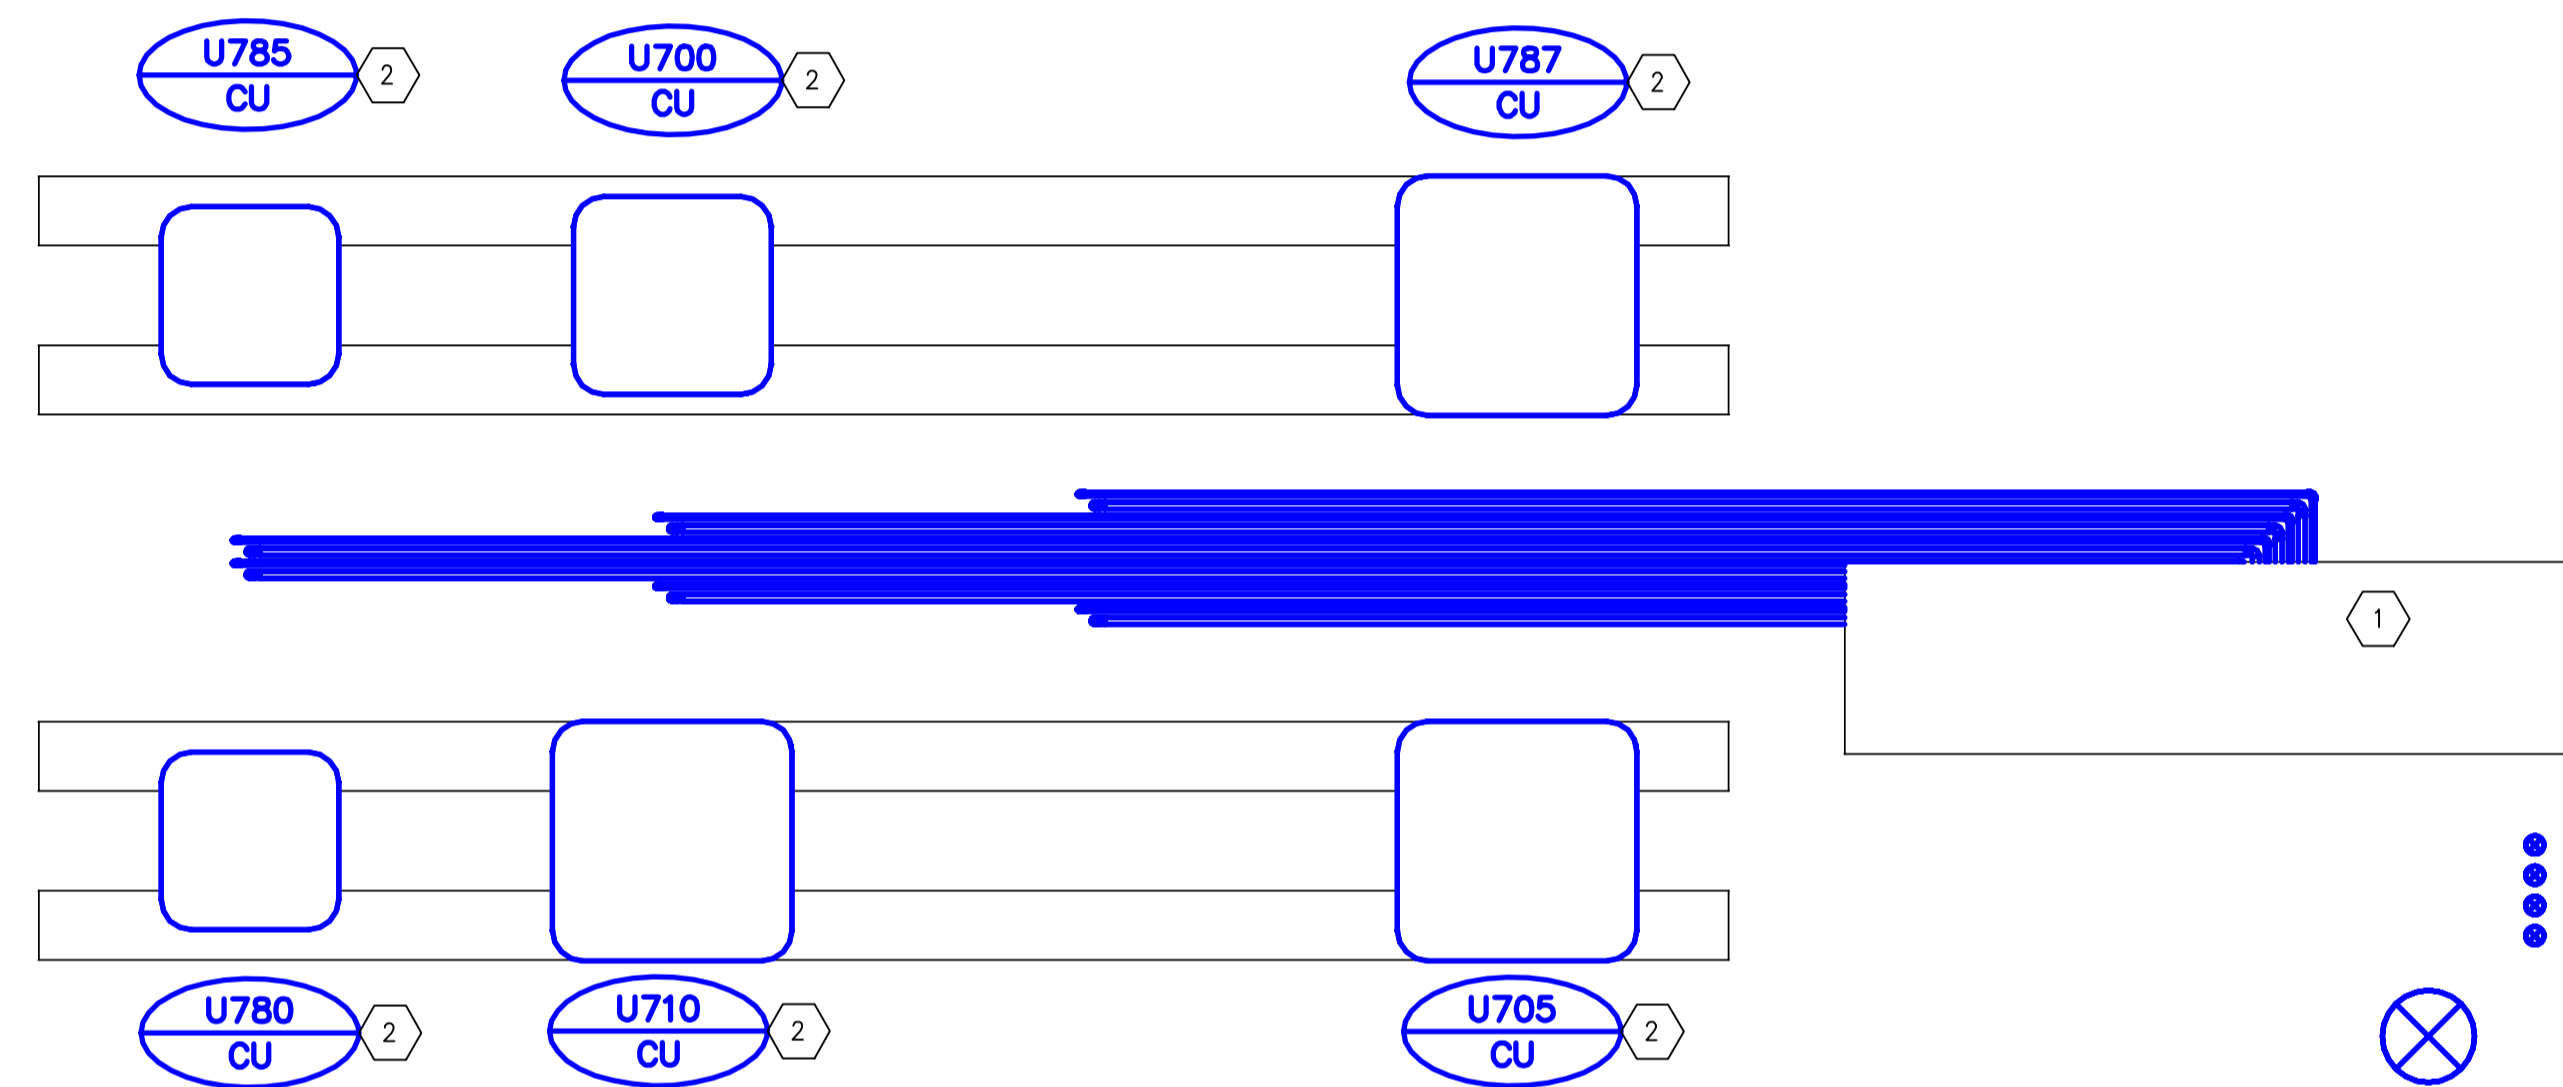

A MECHANICAL ROOM – ROOF LAYOUT
SCALE 1:25

GENERAL NOTES

1. PERFORM ALL WORK IN ACCORDANCE WITH ALL APPLICABLE CODES, STANDARDS AND PROVINCIAL MECHANICAL ENGINEERING & INSPECTIONS BRANCH REQUIREMENTS.
2. COORDINATE WORKS WITH OTHER SUB-TRADES. REFER TO SPECIFIC DETAILS FOR CUTTING AND SEALING PENETRATIONS THROUGH OPENINGS & FIRE SEPARATIONS.
3. REFER TO TECHNICAL SPECIFICATIONS FOR EQUIPMENT AND MATERIAL SPECIFICATIONS AND INSTALLATION CONSTRUCTION AND PHASING REQUIREMENTS.
4. INSULATE DUCTWORK WHERE INDICATED AND SPECIFIED.
5. SUPPORT ALL DUCTWORK TO MEET CODE REQUIREMENTS & ESTABLISHED INDUSTRY TRADE PRACTICES, (SMACNA, ASHRAE).
6. INVESTIGATE SITE PRIOR TO CONSTRUCTION TO CONFIRM ALL DIMENSIONS AND INSTALLATION REQ'S.
7. PERFORM ALL CUTTING & PATCHING NECESSARY FOR ANY REQUIRED OPENINGS.
8. PROVIDE TAB TO ENSURE AIR DISTRIBUTION TO VOLUMES INDICATED.
9. NOT ALL EQUIPMENT/PIPING, ETC. IS SHOWN.

APEGM
Certificate of Authorization
Alliance Engineering Services Inc.
No.2906 Date: _____

B.M. ELEV.	FIELD BOOK #:
POSTED TO LBIS	
DESIGNED BY	DD
CHECKED BY	
DRAWN BY	DD
APPROVED BY	
HOR. SCALE	1:25
VERTICAL	
00 ISSUED FOR TENDER	2010-12-21 AFG
NO. REVISIONS	DATE BY
	DATE 2010-11-05

ALLIANCE
Engineering Services Inc.

ENGINEER'S SEAL

 CONSULTANT DRAWING NO.
UM4.10

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

 2010 HVAC REPLACEMENT AND ASSOCIATED WORKS
 WEWPCC
 AREA U – ADMINISTRATION BUILDING
 MECHANICAL ROOM – ROOF LAYOUT [NEW]

SHEET 1 OF 1
CITY DRAWING NUMBER
1-0103V-M0029-001