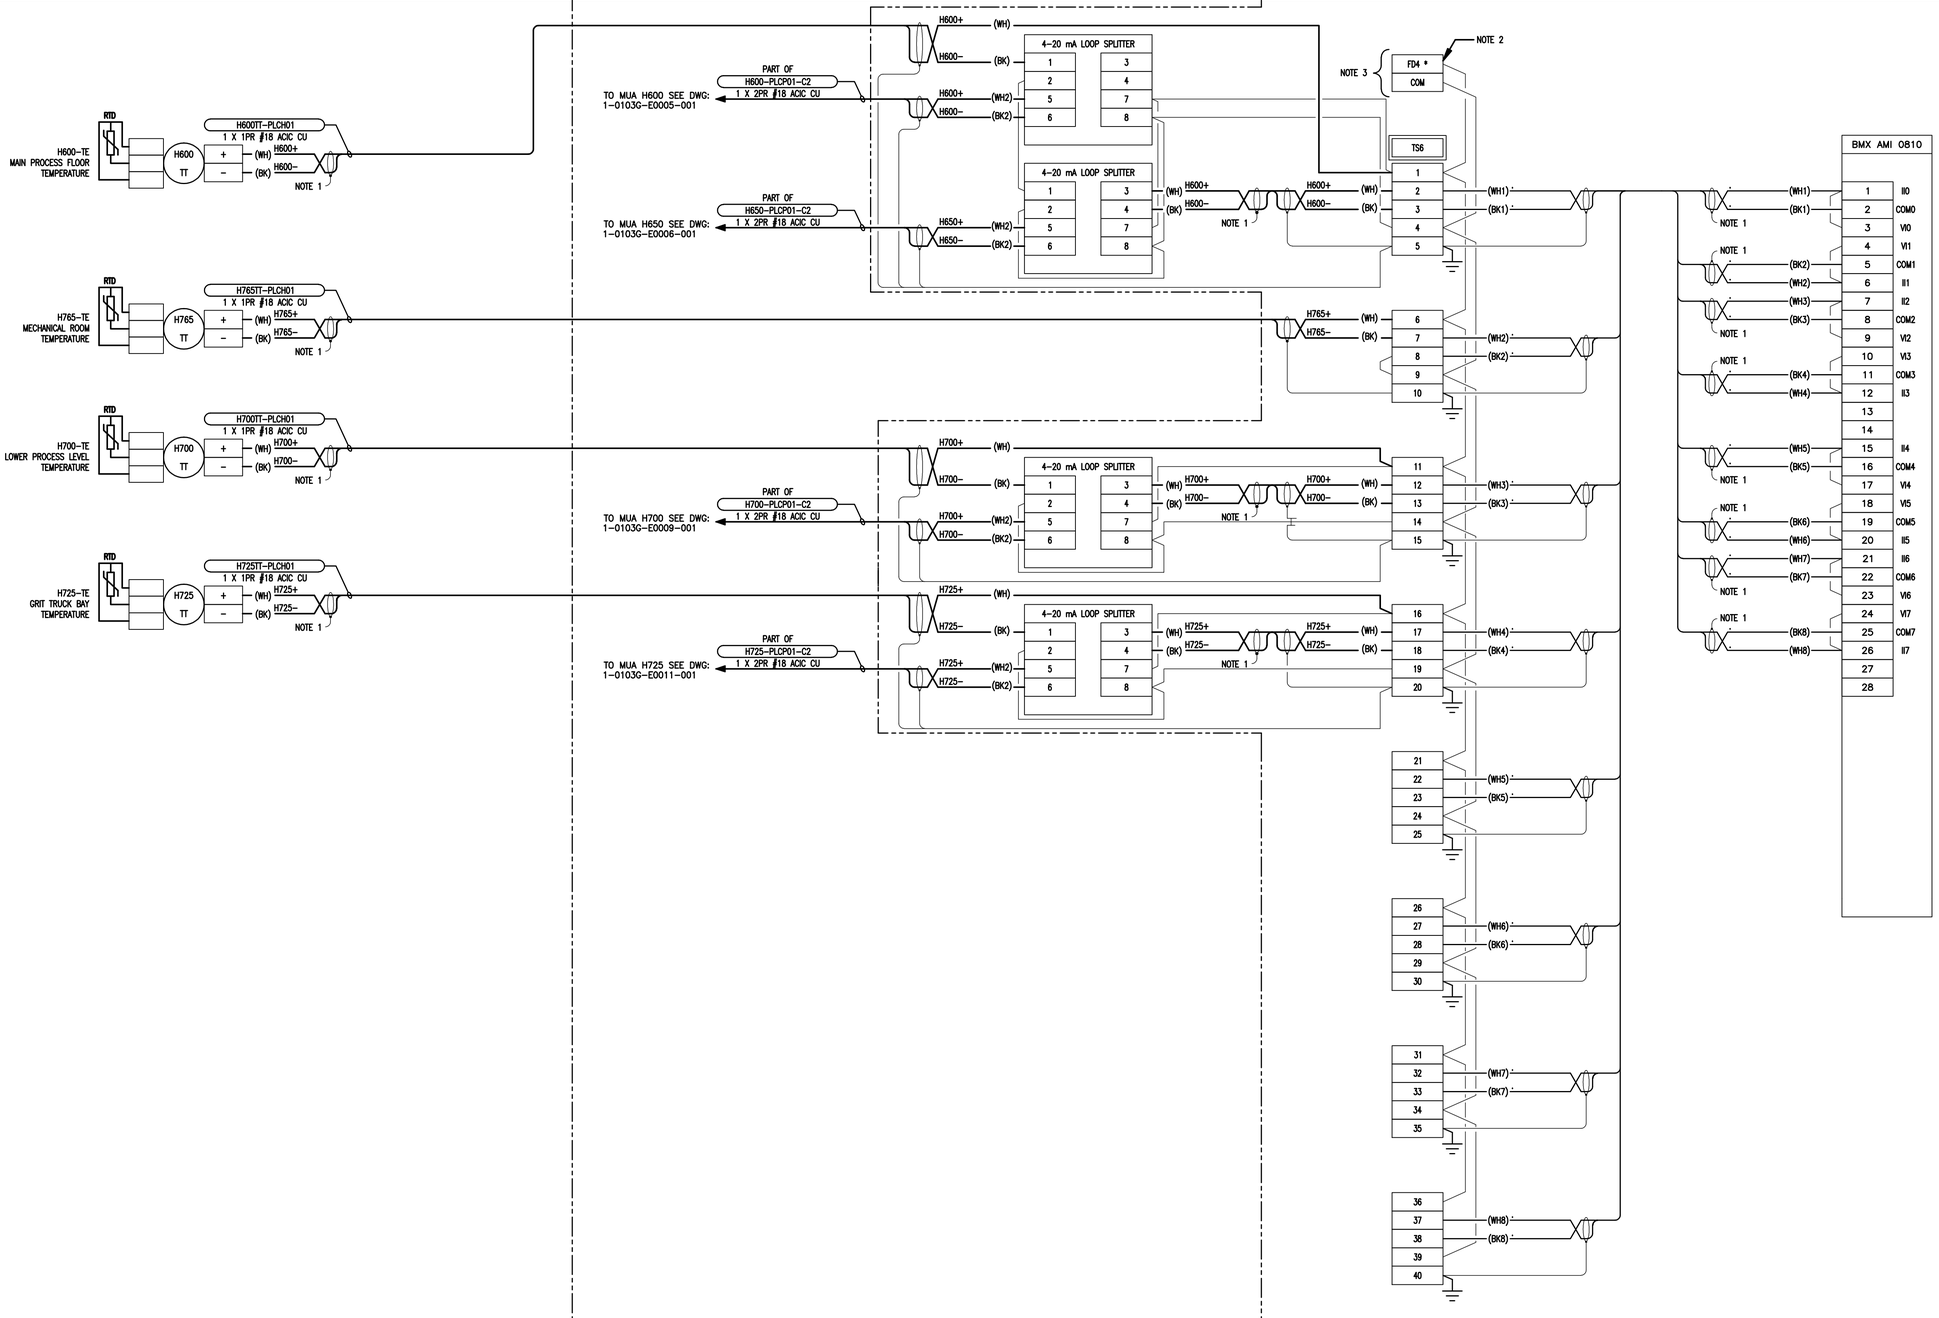

NOTES:

1. TAPE BACK AND ISOLATE SHIELD AT THIS END ONLY.
2. ASTERISK DENOTES FUSED DISCONNECT TERMINAL.
3. REFER TO DWG 1-0103G-E0016-002 FOR DETAILS ON POWER SUPPLY.

LEGEND

——— FIELD WIRING

——— PANEL WIRING

FileName: P:\Projects\2009\09-0754-08\Doc.Control\ToBeIssued\DWG\ELECTRICAL\1-0103G-A0004-001-Rev 00.dwg - Tab: 1-0103G-A0004-001 Plotted By: GNelson 12/16/2010 [Thu 5:16pm]

Certificate of Authorization
KGS Group
No. 245 Date: 2010/12/21

KGS GROUP CONSULTING ENGINEERS

B.M. ELEV. N/A | FIELD BOOK #:

POSTED TO LBIS

NO.	REVISIONS	DATE	BY
00	ISSUED FOR TENDER	2010-12-21	REW

ALLIANCE
Engineering Services Inc.

DESIGNED BY	DDW	BY	REW
DRAWN BY	GCN	APPROVED BY	REW
HOR. SCALE	N.T.S.	RELEASED FOR CONSTRUCTION	
VERTICAL	N.T.S.		
DATE	2010-03-17	DATE	

ENGINEER'S SEAL
PROVINCE OF MANITOBA
R.E. WILLMS
Member 3833
REGISTERED PROFESSIONAL ENGINEER

TENDER No. HI2.7
FILENAME 1-0103G-A0004-001-Rev 00.dwg
PLOT DATE: 2010/12/16

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

2010 HVAC REPLACEMENT AND ASSOCIATED WORKS
WEWPCC
AREA H - HEADWORKS
SLOT 6 ANALOG INPUT LOOP DRAWING

SHEET 1 OF 1
CITY DRAWING NUMBER
1-0103G-A0004-001

CW-9-M564-1