


FIELD DEVICE

FIELD ENCLOSURE

I/O MODULE, TELEFAST SUBBASE & TERMINALS

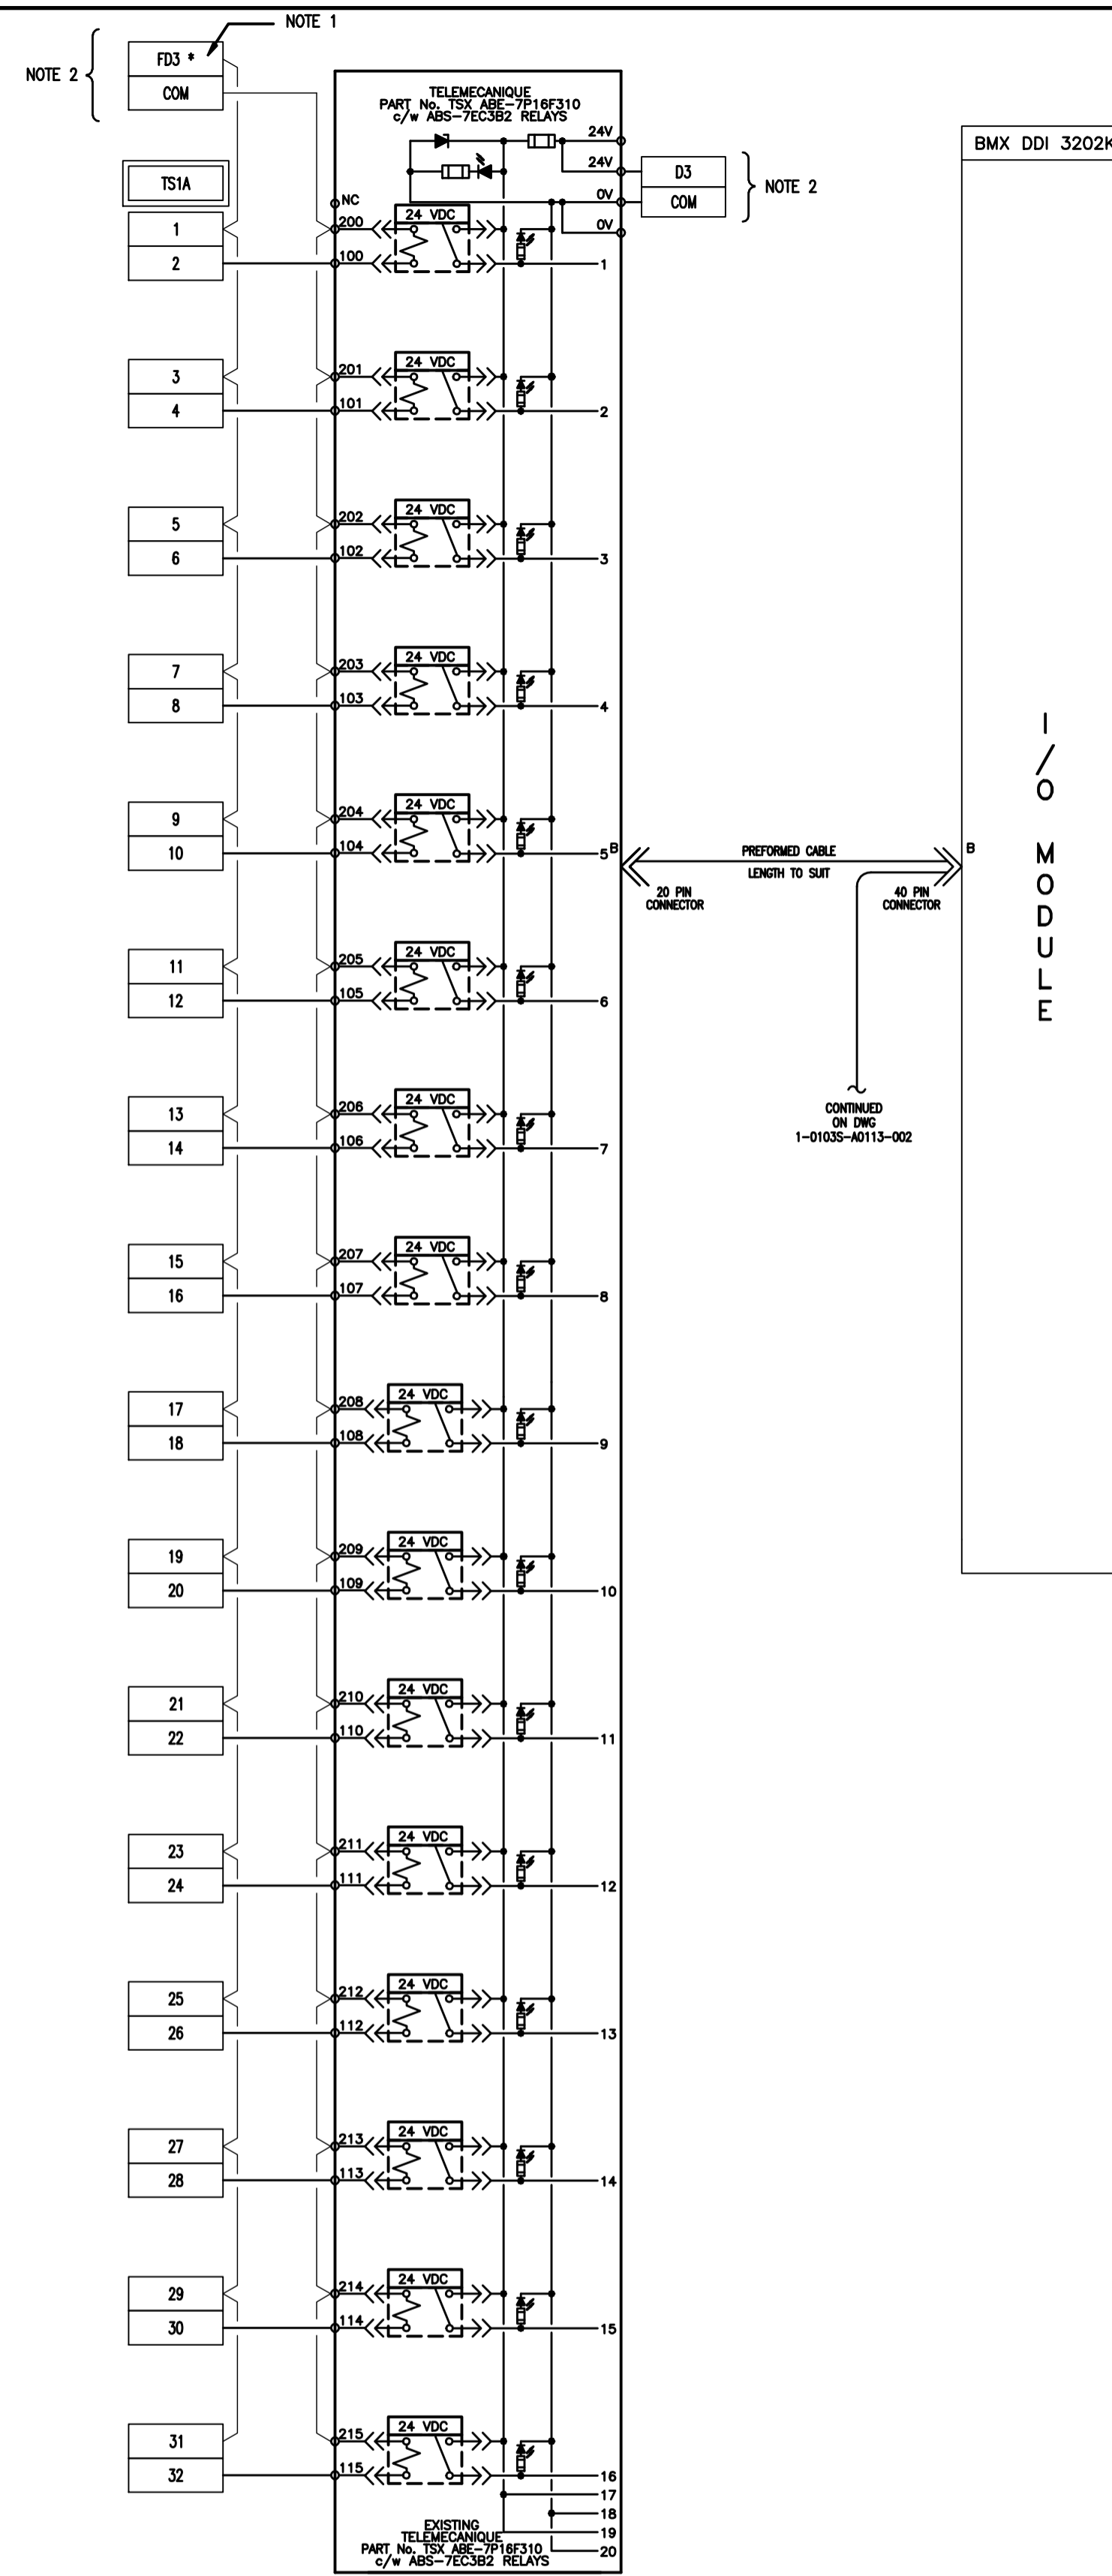

NOTES:

- 1. ASTERISK DENOTES FUSED DISCONNECT TERMINAL.
- 2. REFER TO DWG. 1-0103S-E0023-002 FOR DETAILS ON POWER SUPPLY.

LEGEND

- FIELD WIRING
- PANEL WIRING

| | | | | | | | | |
|--|---|----------------------|---------------------------|---|--|--|--|---|
| <p>APEGN Certificate of Authorization KGS Group No. 245 Date: 2010/12/21</p> | <p>KGS GROUP CONSULTING ENGINEERS</p> | B.M. ELEV. N/A | FIELD BOOK #: | <p>ALLIANCE Engineering Services Inc.</p> | <p>ENGINEER'S SEAL R.E. WILLMS Member 3833 PROVINCE OF MANITOBA REGISTERED PROFESSIONAL ENGINEER</p> | <p>THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT</p> | <p>2010 HVAC REPLACEMENT AND ASSOCIATED WORKS WEWPCC</p> | SHEET 1 OF 2 |
| | | DESIGNED BY: REW/DDW | BY: REW | | | | | TENDER No. S12.3 |
| <p>00 ISSUED FOR TENDER 2010-12-21 REW</p> | | DRAWN BY: GCN | APPROVED BY: REW | FILENAME: 1-0103S-A0113-001-Rev 00.dwg | <p>2010-06-23</p> | <p>2010-12-16</p> | <p>1-0103S-A0113-001</p> | |
| <p>NO. REVISIONS DATE BY</p> | | HDR. SCALE: N.T.S. | RELEASED FOR CONSTRUCTION | PLDT DATE: 2010/12/16 | | | | <p>SLOT 1 DISCRETE INPUT LOOP DRAWING</p> |