


File Name: P:\Projects\2009\09-0754-08\Doc.Control\Tobbeissued\DWG\ELECTRICAL\1-0103S-A0115-001-Rev 00.dwg - Tab. 1-0103S-A0115-001 Plotted By: G Nelson 12/18/2010 [Thu 4:50pm]

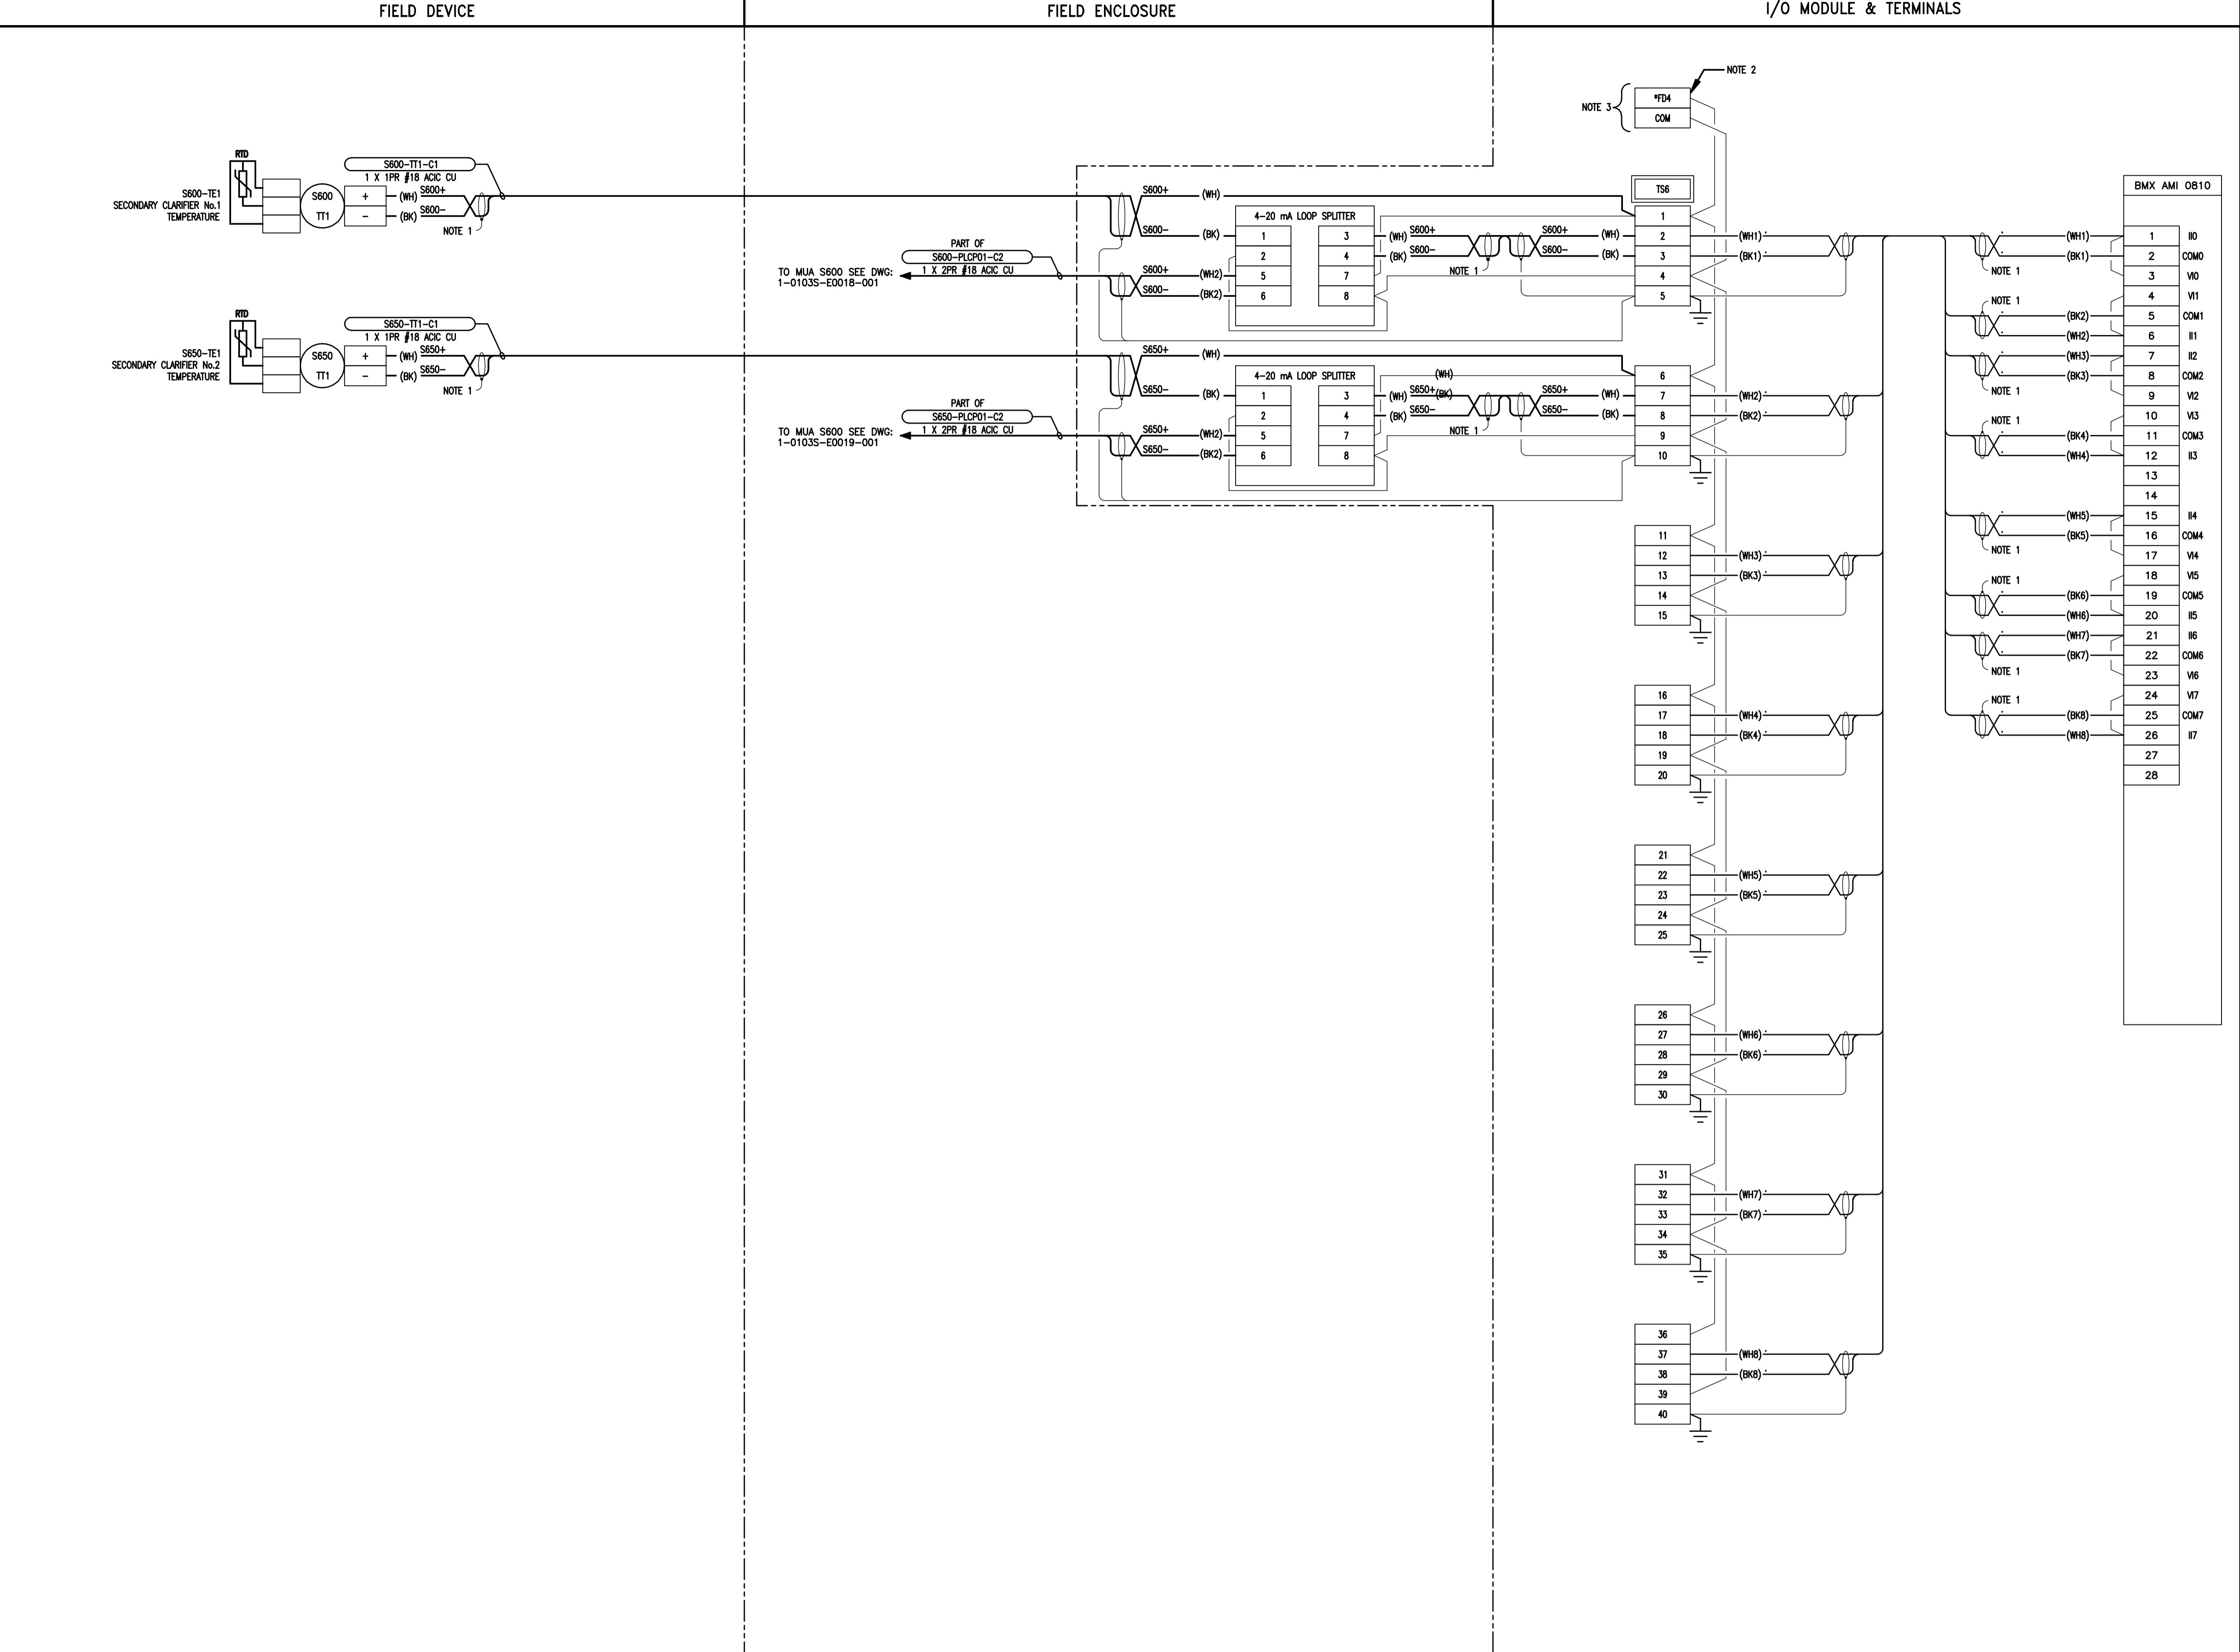

- NOTES:**
1. TAPE BACK AND ISOLATE SHIELD AT THIS END ONLY.
 2. ASTERISK DENOTES FUSED DISCONNECT TERMINAL.
 3. REFER TO DWG 1-0103S-E0023-002 FOR DETAILS ON POWER SUPPLY.

LEGEND

— FIELD WIRING

— PANEL WIRING

 Certificate of Authorization KGS Group No. 245 Date: 2010/12/21		B.M. ELEV. N/A	FIELD BOOK #:		 ENGINEER'S SEAL	 2010 HVAC REPLACEMENT AND ASSOCIATED WORKS WEWPC AREA S - SECONDARY CLARIFIERS 1 & 2 SLOTT 6 ANALOG INPUT LOOP DRAWING	SHEET 1 OF 1 CITY DRAWING NUMBER 1-0103S-A0115-001
		POSTED TO LBIS					