


KEY PLAN

NOTES:

1. LOWER/RELOCATE ALL HID FIXTURES IN THIS AREA TO ACCOMMODATE DUCTWORK.
2. REMOVE EXISTING EQUIPMENT AND TURN OVER TO THE CITY.
3. NOT ALL EXISTING ELECTRICAL WIRING AND EQUIPMENT WHICH REQUIRES RELOCATION IS SHOWN IN DETAIL. THE CONTRACTOR SHALL REVIEW ALL TENDER DRAWINGS TO DETERMINE GLOBAL SCOPE OF RELOCATION.

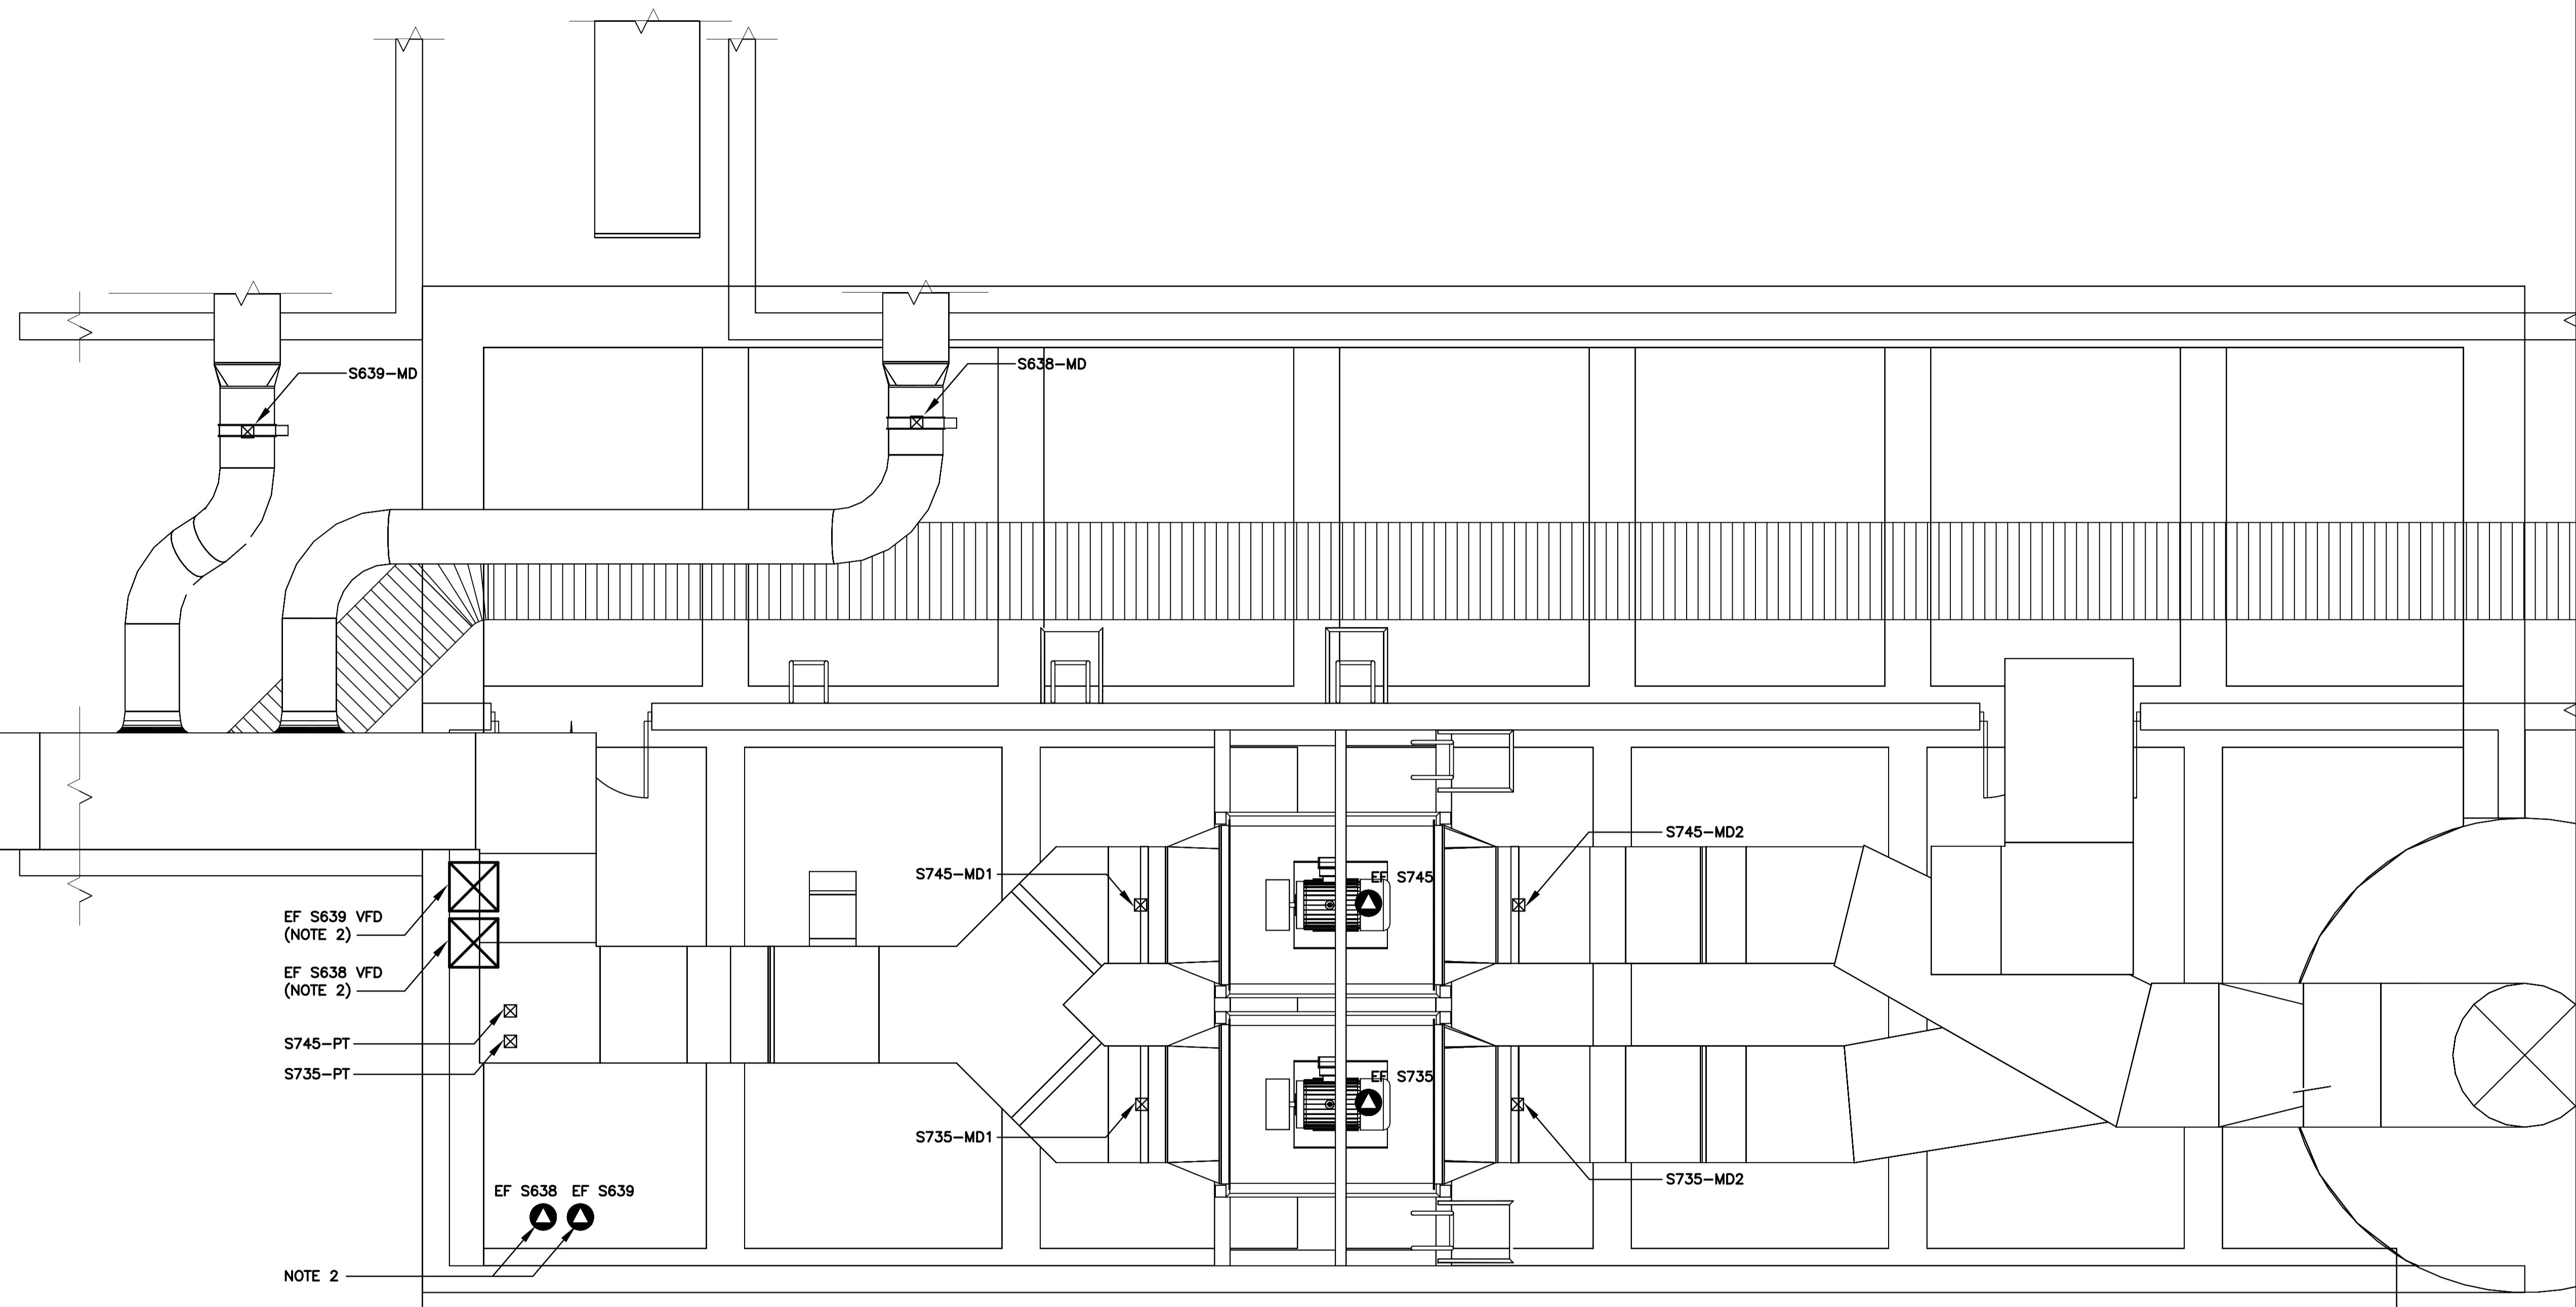

EF S639 VFD (NOTE 2)
 EF S638 VFD (NOTE 2)
 S745-PT
 S735-PT
 EF S638 EF S639
 NOTE 2

A ODOUR DISPERSION ROOM - PLAN
 SCALE: 1:50

File Name: P:\Projects\2009\09-0754-08\Drawg\Elec\20101026 DWG from Alliance\1-0103S-E0026-001.dwg - Tab: 1-0103S-E0026-001.dwg - Plotted By: G.Nelson 12/17/2010 [Fri 9:21am]

APEGM
 Certificate of Authorization
 KGS Group
 No. 245 Date: 2010/12/21

KGS GROUP
 CONSULTING ENGINEERS

B.M. ELEV.	FIELD BOOK #:
POSTED TO LBIS	
DESIGNED BY	AP
CHECKED BY	DDW
DRAWN BY	GCN
APPROVED BY	REW
HOR. SCALE	-
VERTICAL	-
RELEASSED FOR CONSTRUCTION	
TENDER No. SE4.1	
FILENAME: 1-0103S-E0026-001.dwg	
PLOT DATE: 2010/12/17	

ALLIANCE
 Engineering Services Inc.

ENGINEER'S SEAL

 TENDER No. SE4.1
 FILENAME: 1-0103S-E0026-001.dwg
 PLOT DATE: 2010/12/17

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

2010 HVAC REPLACEMENT AND ASSOCIATED WORKS
WEWPCC
 AREA S - ODOUR DISPERSION ROOM
 ODOUR DISPERSION ROOM PLAN - ELECTRICAL

SHEET 1 OF 1
 CITY DRAWING NUMBER
 1-0103S-E0026-001