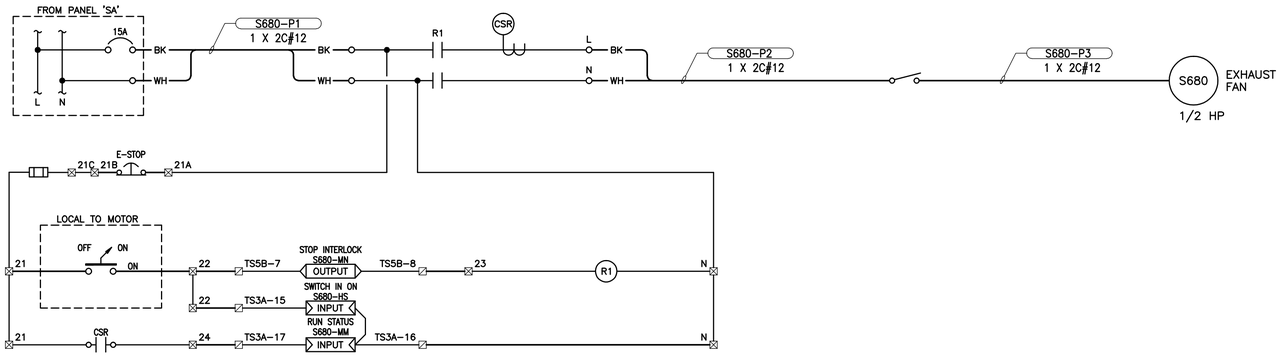

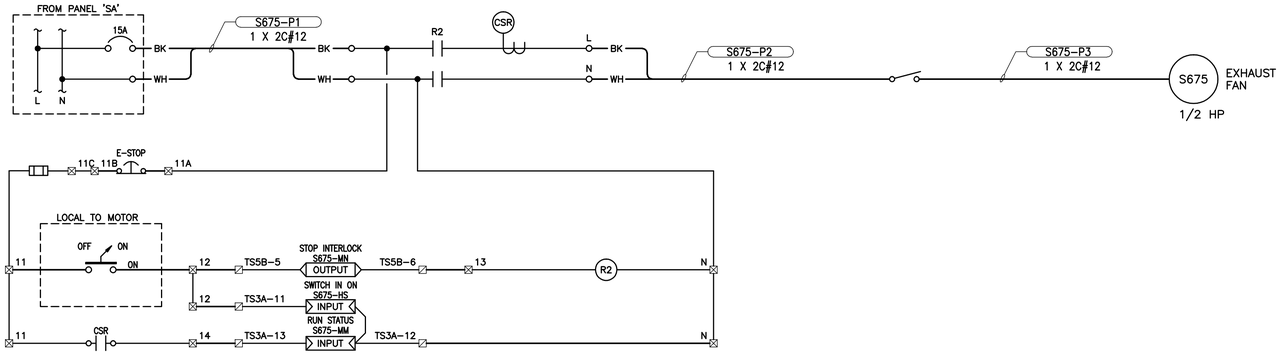

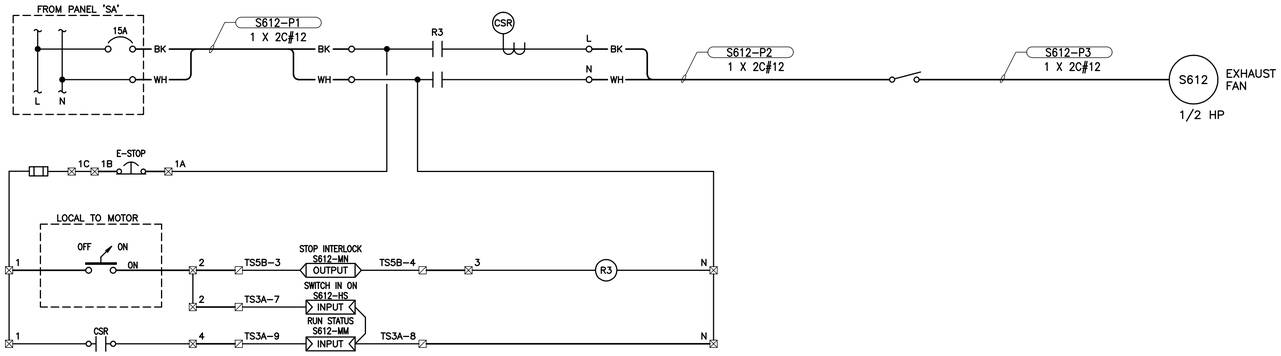



LEGEND

- PLC TERMINALS
- STARTER TERMINALS
- MUA U600 TERMINALS
- FIELD WIRING
- PANEL WIRING
- ( ) CONDUCTOR IDENTIFICATION
- WIRE CONNECTION
- PILOT LIGHT
- ETM — ELAPSED TIME METER
- OUTPUT — PLC OUTPUT
- INPUT — PLC INPUT

NOTES:

1. CONTACT CLOSES WHEN ADEQUATE CURRENT IS DRAWN TO PROVE EXHAUST FAN IS RUNNING.

CONSTRUCTION NOTES:

1. REPLACE EXISTING STARTER WRAPPER WITH NEW WITH FEATURES SHOWN ON SCHEMATIC.

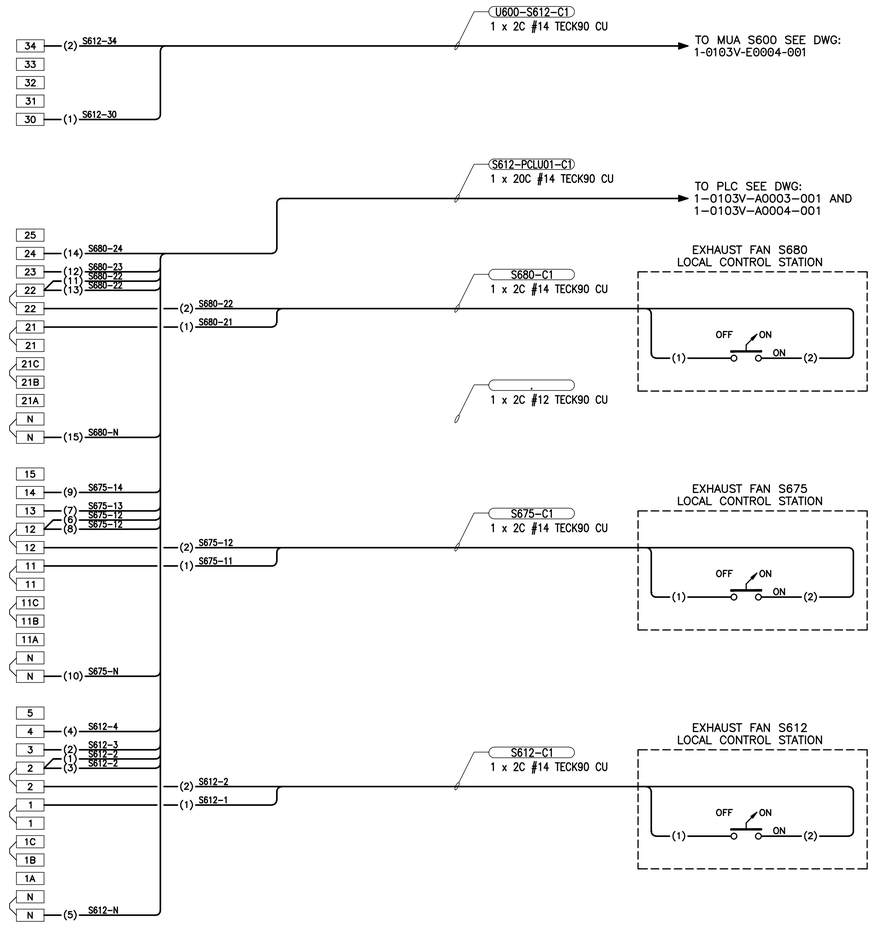

B.M. ELEV.		FIELD BOOK #			
POSTED TO LBIS					
00	ISSUED FOR TENDER	2010-12-21	REW		
NO.	REVISIONS	DATE	BY		

APEGM Certificate of Authorization KGS Group No. 245 Date: 2010/12/21

KGS GROUP CONSULTING ENGINEERS

ALLIANCE Engineering Services Inc.

DESIGNED BY	DDW	CHECKED BY	REW
DRAWN BY	GCN	APPROVED BY	REW
HOR. SCALE	N.T.S.	RELEASED FOR CONSTRUCTION	
VERTICAL	N.T.S.		
DATE	2009 09 29	DATE	

ENGINEER'S SEAL — PROVINCE OF MANITOBA — R.E. WILLMS Member 3833 — REGISTERED PROFESSIONAL ENGINEER

TENDER No. UE2.7
FILENAME: 1-0103V-E0007-001-Rev 00.dwg
PLOT DATE: 2010/12/16

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

2010 HVAC REPLACEMENT AND ASSOCIATED WORKS

WEWPCC

AREA U - TUNNEL VENTILATION

EF-S612, S675 & S680 SCHEMATIC & WIRING DIAGRAM

SHEET 1 OF 1

CITY DRAWING NUMBER

1-0103V-E0007-001

FileName: P:\Projects\2009\09-0754-08\Doc.Control\ToBeIssued\DWG\ELECTRICAL\1-0103V-E0007-001-Rev 00.dwg - Tab: 1-0103V-E0007-001 Plotted By: GNelson 12/16/2010 [Thu 4:25pm]
CW-9-M564-1