


shop drawing

project specification	D500LED.FLX.2.2wp' LV LED Flx Lighting – D121-D121c extrusion and Lens
fixture type	

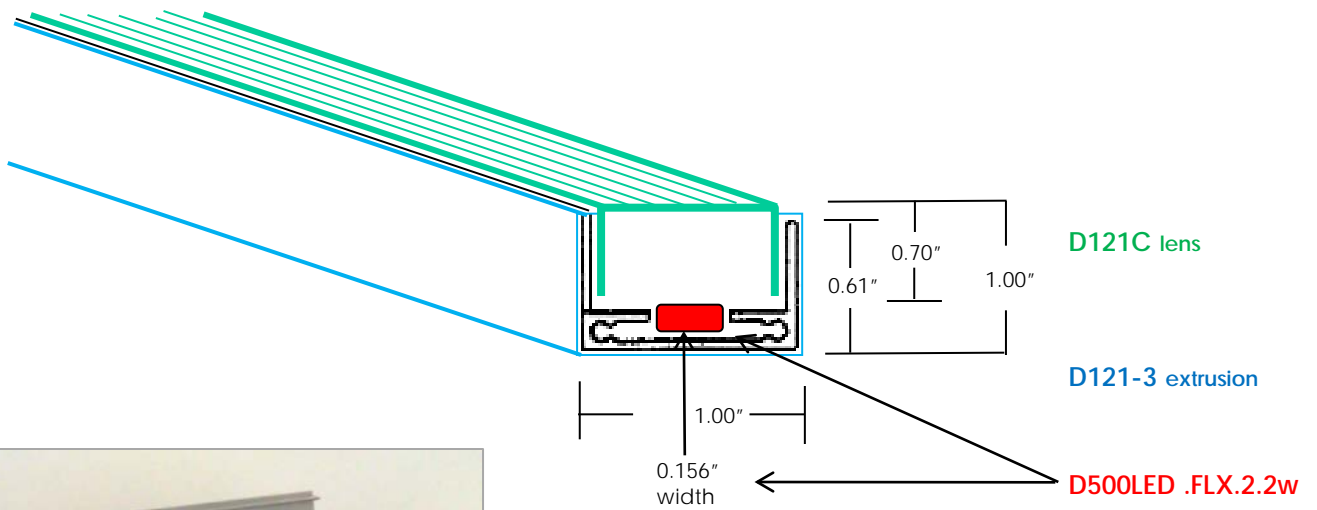

POWER SUPPLY and ENCLOSURE: ET TRD15012M [150w12vDC]

- Lighting:** D500LED.FLX.2.2w per foot x 5 typical runs x 25 TOTAL LOAD
- one run 2' 6" - 5.5w12vDC
 - second run 2' 6" - 5.5w12vDC
 - third run 2' 6" - 5.5w12vDC
 - fourth run 2' 6" - 5.5w12vDC
 - fifth run 2' 6" - 5.5w12vDC
- X 5 = 25 runs = 137.5w 12vDC
ET ETH15012M

Note:
 Any Changes or modifications to mmj lighting 96 ltd lighting fixtures, must be done in the mmj lighting 96 ltd factory.
 Any modifications or changes done in the field will void all warranties and approvals.

Job Name: Osborne Bridge
 Job Nbr:
 Tag: Vertical Picket Back Lighting
 Distributor:
 Electrician
 Engineer:
 Interior Design:
 Architect:
 note: site measurements required

150 ferrier street, unit 2, markham, ontario L3R 3K3
 T 905 479 0788 F 905 479 7117 E sales@mmjlighting96.com

www.mmjlighting96.com

mmj
 lighting 96 ltd