

EQUIPMENT SCHEDULE																																	
EQUIPMENT				POWER REQUIREMENTS							SUPPLY PANEL					CABLE				STARTER			LOCAL DISC.			CONTROL			NOTES				
TAG				DESCRIPTION	LOCATION	HP	KW	MCA	VOLTAGE	PHASE	PANEL NAME	OCP				NUMBER OF RUNS	NUMBER OF WIRES	WIRE SIZE (COPEX)	CONDUIT SIZE	SIZE	TYPE	SUPPLIED	INSTALLED	CONNECTED	TYPE	SUPPLIED	INSTALLED	CONNECTED		TYPE	SUPPLIED	INSTALLED	CONNECTED
												BREAKER	DISCONNECT SWITCH	TIME-DELAY FUSE	POLES																		
RTU-1	M	M	E	Rooftop Unit – Basement	Roof	.	15.588	15	600	3	MDP	35	.	.	3	1	3	10	21	.	.	.	.	NFD	E	E	E	ECP	M	M	M	1	
RF-1	M	M	E	Return Fan	Kitchen	1/2	.	9.8	120	1	CDP	25	.	.	1	1	2	10	21	.	.	.	.	NFD	E	E	E	ECM	M	M	M	1	
RTU-2	M	M	E	Rooftop Unit – Main Floor	Roof	.	37.412	36	600	3	MDP	90	.	.	3	1	3	6	36	.	.	.	.	NFD	E	E	E	ECP	M	M	M	1	
EF-1	M	M	E	Exhaust Fan	Basement WC	3/4	0.0932	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	NFD	E	E	E	PS	M	M	M	1	
EF-2	M	M	E	Exhaust Fan	Service Room	1/40	0.019	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	.	.	.	LS	E	E	E	1		
EF-3	M	M	E	Exhaust Fan	Elevator Machine Room	1/30	0.025	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	NFD	E	E	E	LVT	M	M	M	1	
EF-4	M	M	E	Exhaust Fan	Roof	1/30	0.025	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	NFD	E	E	E	PS	M	M	M	1	
EF-5	M	M	E	Exhaust Fan	Roof	1/4	0.186	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	NFD	E	E	E	LS	E	E	1		
EF-6	M	M	E	Exhaust Fan	Roof	1	0.746	.	208	3	CDP	15	.	.	3	1	3	12	16	.	.	.	.	NFD	E	E	E	LS	E	E	1		
EF-7	M	M	E	Exhaust Fan	Mechanical Room	1/4	0.186	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	NFD	E	E	E	LVT	M	M	M	1	
FF-1	E	E	E	Force Flow Heater	Basement Vestible; Rm 14	.	4.8	.	208	3	CDP	30	.	.	2	1	2	10	21	.	.	.	.	.	.	.	IT	V	V	V	1;4;5		
FF-2	E	E	E	Force Flow Heater	Basement Vestible; Rm 15	.	2	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;7		
FF-3	E	E	E	Force Flow Heater	Main Floor Vestible; Rm 20	.	3	.	208	3	CDP	20	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;6		
LS-1	M	M	E	Lift Station	Service Room	3	2.2371	.	600	3	MDP	15	.	.	3	1	3	12	21	.	.	.	.	NFD	E	E	E	FS	M	M	M	1	
LS-2	M	M	E	Lift Station	Service Room	1/2	0.3728	.	600	3	MDP	15	.	.	3	1	3	12	21	.	.	.	.	NFD	E	E	E	FS	M	M	M	1	
PU-1	M	M	E	Boiler Circulation Pump	Mechanical Room	1/3	0.2485	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	NFD	E	E	E	ECM	M	M	M	1	
PU-2	M	M	E	DHW Recirculation Pump	Mechanical Room	.	.	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	NFD	E	E	E	ECM	M	M	M	1	
BB-1	E	E	E	Baseboard Heater	Lobby Stairs	.	1.5	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;8		
BB-2	E	E	E	Baseboard Heater	Lobby Stairs	.	1.5	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;8		
BB-3	E	E	E	Baseboard Heater	Lobby Stairs	.	1.5	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;8		
BB-4	E	E	E	Baseboard Heater	Lobby Stairs	.	1.5	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;8		
BB-5	E	E	E	Baseboard Heater	Lobby Stairs	.	1	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;9		
BB-6	E	E	E	Baseboard Heater	Lobby Stairs	.	1.5	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;8		
BB-7	E	E	E	Baseboard Heater	Lobby Stairs	.	1.5	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;8		
BB-8	E	E	E	Baseboard Heater	Lobby Stairs	.	1.5	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;9		
BB-9	E	E	E	Baseboard Heater	Lobby Stairs	.	1.5	.	208	3	CDP	15	.	.	2	1	2	12	16	.	.	.	.	.	.	.	IT	V	V	V	1;4;8		
B-1	M	M	E	Boiler	Mechanical Room	.	.	.	120	1	CDP	15	.	.	1	1	2	12	16	.	.	.	.	NFD	E	E	E	ECM	M	M	M	1;2	
EL-1	M	M	E	Elevator	Elevator Machine Room	.	.	.	600	3	MDP	25	.	.	3	1	3	10	21	.	.	.	.	NFD	E	E	E	ECM	.	.	.	1	

NOTE 10 ➡

THIS DRAWING MUST NOT BE SCALED.

THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS, DATUMS, AND LEVELS PRIOR TO COMMENCEMENT OF WORK. ALL ERRORS AND OMISSIONS TO BE REPORTED TO NUMBER TEN ARCHITECTURAL GROUP BEFORE PROCEEDING.

VARIAIONS AND MODIFICATIONS TO WORK SHOWN ON THESE DRAWINGS SHALL NOT BE CARRIED OUT WITHOUT WRITTEN PERMISSION OF NUMBER TEN ARCHITECTURAL GROUP.

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF NUMBER TEN ARCHITECTURAL GROUP AND THE COPYRIGHT IN THE SAME BEING RESERVED TO THEM. IT MAY BE REPRODUCED ONLY WITH THE PERMISSION OF NUMBER TEN ARCHITECTURAL GROUP, IN WHICH CASE THE REPRODUCTION MUST BEAR THEIR NAME.

REVISED/ ISSUED/ PLOTTED	DATE
Rev. 1 - ISSUED FOR TENDER	FEBRUARY 03/2012
Rev. 0 - ISSUED FOR TENDER	NOVEMBER 21/2011

NOTES:

1. REFER TO MECHANICAL DRAWINGS FOR LOCATION OF ALL MECHANICAL EQUIPMENT.
2. PROVIDE A REMOTE DISCONNECT FOR THE BOILER. DISCONNECT TO BE LOCATED AT THE MAIN ENTRY DOOR TO THE MECHANICAL ROOM. COVER PLATE TO BE RED IN COLOR COMPLETE WITH LABEL TO READ "BOILER B-1 DISCONNECT".
3. REFER TO PANEL SCHEDULE FOR CIRCUIT NUMBERS.
4. ALL BASEBOARD SHOP DRAWINGS TO BE SENT TO MECHANICAL ENGINEER TO CONFIRM SIZING AND ALSO THE ELECTRICAL CONTRACTOR IS TO ENSURE ALL BASEBOARD AND FORCE FLOW HEATER PHYSICAL SIZES SHALL BE AS PER THE ELECTRICAL HEATER SCHEDULE ON DRAWING M&O.
5. FORCE FLOW HEATER SHALL BE OUELLET O4C04808 SURFACE WALL MOUNTED COMPLETE WITH BUILT-IN TAMPER PROOF THERMOSTAT.
6. FORCE FLOW HEATER SHALL BE OUELLET O4C04808 RECESSED WALL MOUNTED COMPLETE WITH BUILT-IN TAMPER PROOF THERMOSTAT.
7. FORCE FLOW HEATER SHALL BE OUELLET O4C02008 RECESSED WALL MOUNTED COMPLETE WITH BUILT-IN TAMPER PROOF THERMOSTAT.
8. BASEBOARD HEATER SHALL BE OUELLET OHB11508-T-AV COMPLETE WITH BUILT-IN TAMPER PROOF THERMOSTAT AND 3" PEDESTAL.
9. BASEBOARD HEATER SHALL BE OUELLET OHB11008-T-AV COMPLETE WITH BUILT-IN TAMPER PROOF THERMOSTAT AND 3" PEDESTAL.
10. THE CONTRACT FOR THE ELEVATOR INSTALLATION SHALL BE HELD AS SEPARATE TENDER PACKAGE. ELECTRICIAN IS TO COORDINATE WITH THE ELEVATOR SUPPLIER TO PROVIDE POWER TO THE ELEVATOR.

numberTEN
architectural group

winnipeg MB regina SK victoria BC
204 942.0981 306 721.1501 250 360.2106

architecture ■ interior design ■ graphic design



PEGUIS PAVILION
UPGRADES AND ENTRY ADDITION
BIDDING #913-2011

project

MISCELLANEOUS SCHEDULES

sheet title

consultant

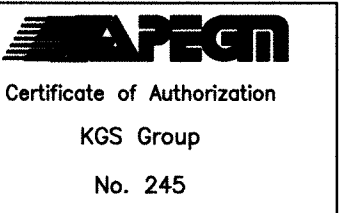

seal

scale: N.T.S.

drawn by: GCN

date: September 14, 2011

checked by:

	1990	1991	1992	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035	2036	2037	2038	2039	2040	2041	2042	2043	2044	2045	2046	2047	2048	2049	2050	2051	2052	2053	2054	2055	2056	2057	2058	2059	2060	2061	2062	2063	2064	2065	2066	2067	2068	2069	2070	2071	2072	2073	2074	2075	2076	2077	2078	2079	2080	2081	2082	2083	2084	2085	2086	2087	2088	2089	2090	2091	2092	2093	2094	2095	2096	2097	2098	2099	2100
1990	1991	1992	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035	2036	2037	2038	2039	2040	2041	2042	2043	2044	2045	2046	2047	2048	2049	2050	2051	2052	2053	2054	2055	2056	2057	2058	2059	2060	2061	2062	2063	2064	2065	2066	2067	2068	2069	2070	2071	2072	2073	2074	2075	2076	2077	2078	2079	2080	2081	2082	2083	2084	2085	2086	2087	2088	2089	2090	2091	2092	2093	2094	2095	2096	2097	2098	2099	2100	

project no. 2011026

sheet no. E9.0

EQUIPMENT SCHEDULE LEGEND:

O	OWNER
E	ELECTRICAL CONTRACTOR
M	MECHANICAL CONTRACTOR
I	VENDOR
T	INTEGRAL THERMOSTAT
L	LOW VOLTAGE THERMOSTAT
LV	LINE VOLTAGE THERMOSTAT
RAT	REVERSE ACTING THERMOSTAT
H	HUMIDITY TIMER SWITCH
TS	TIME SENSITIVE SPEED SWITCH
LS	LINE VOLTAGE SWITCH
COS	CO/VG GAS SENSOR
FS	FLOAT SWITCH
PS	PRESSURE SWITCH
HOA	HAND/OFF/AUTO SWITCH
TC	TIME CLOCK
VFD	VARIABLE FREQUENCY DRIVE
MAG	MAGNETIC STARTER
MAN	MANUAL STARTER
DDC	DIRECT DIGITAL CONTROL
F	FUSED DISCONNECT
NFD	NON-FUSED DISCONNECT
ECP	EQUIPMENT CONTROL PANEL
VNVR	VOLTAGE NON-REVERSING
PB	PUSHBUTTON

seal

scale: N.T.S.

drawn by: GCN

date: September 14, 2011

checked by:

[illegible]

project no. 2011026

sheet no. E9.0