


FIELD

JB IN FIELD

PUMP CONTROLLER

RTU PANEL

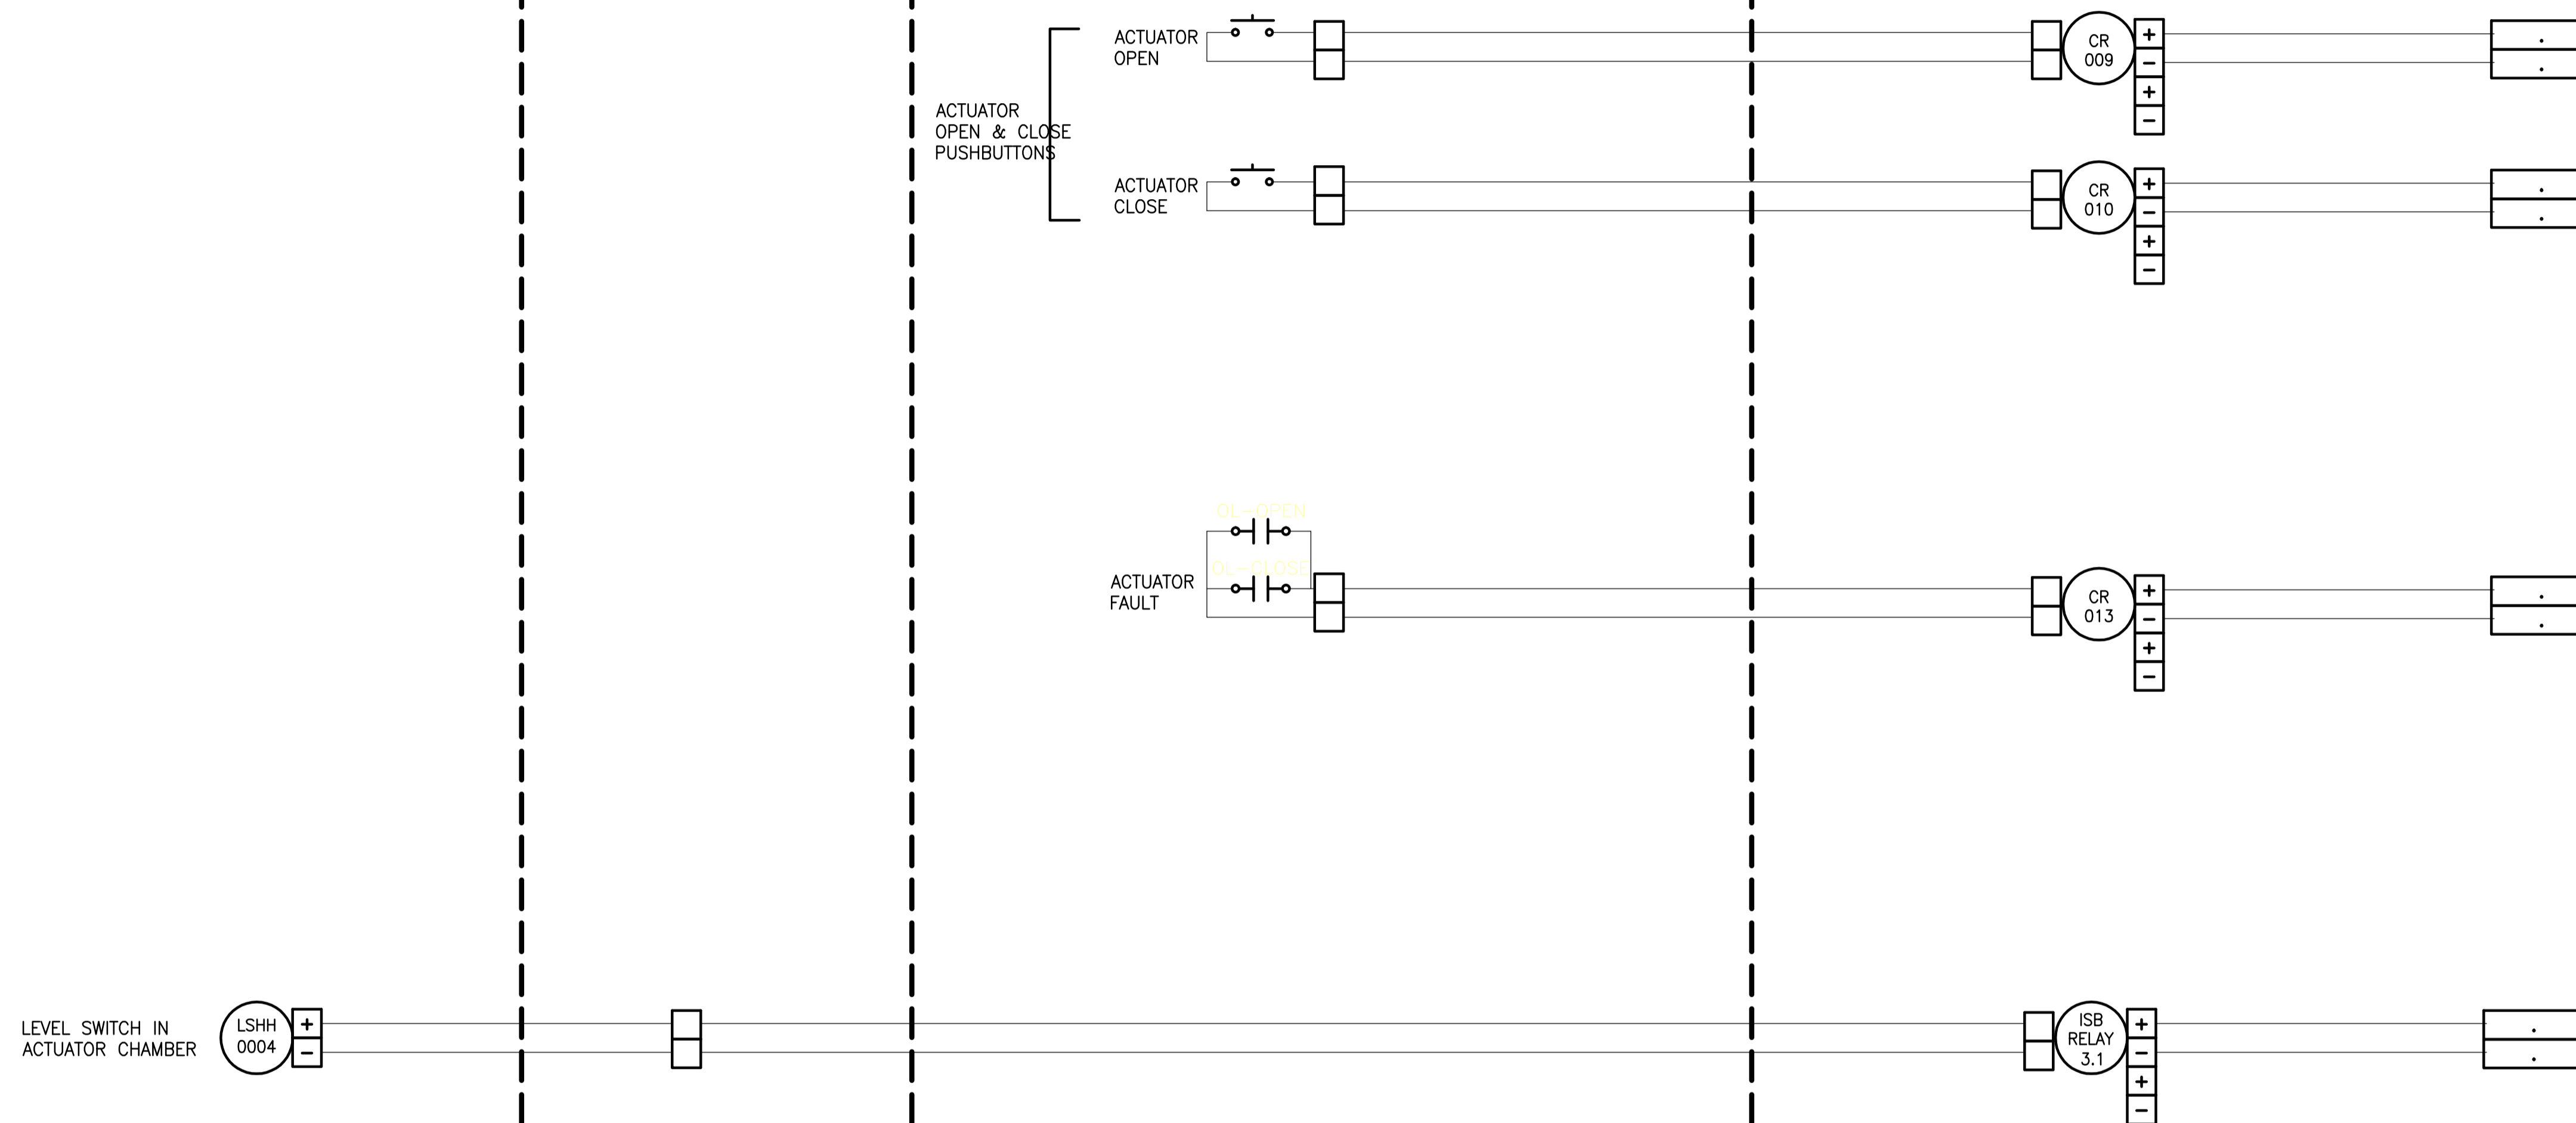

NOTE:

1. PLC ANALOG INPUTS ARE SINGLE-ENDED TYPE.

RTU-000

Printed: November 02, 2016, at 2:26:26 PM. I:\as\Shared\B...
File: C:\131655\131655000\McDermot\as\Outfall Gate Chamber\LD...
electrical\Sheet07.dwg - Layout: 173



DESIGNED BY: J.D.S/ M.P.			CHECKED BY: M.P./D.C.		
DRAWN BY: R.D.			APPROVED BY: K.H.		
C	ISSUED FOR ADDENDUM #1	13 11 22	M.P.	HOR. SCALE	AS NOTED
B	ISSUED FOR TENDER	13 11 12	M.P.	VERT. SCALE	AS NOTED
A	ISSUED FOR CLIENT REVIEW	13 11 04	M.P.	RELEASED FOR CONSTRUCTION	
No.	REVISIONS	DATE	BY	DATE	DATE
				13.10.16	13.10.16



THE CITY OF WINNIPEG
WASTE AND WATER DEPARTMENT
Winnipeg

OUTFALL GATE CHAMBER UPGRADES
McDERMOT
RSR OUTFALL GATE CHAMBER
LOOP DIAGRAMS

CONSULTANT DRAWING No.: 17 - SHT 2 OF 2
SHEET 22 OF 22
CITY DRAWING No.: LD-7267