


TK-X321/ X322
OZONE CONTACTORS
HEIGHT: 6.5m
DIAMETER: 200mm

MXR-X313
STATIC MIXER
SIZE: 50mm
MATERIAL: PVC

TK-X320
OZONATED WATER HOLDING TANK
VOLUME: 1.2m³
DIAMETER: 1.0m
HEIGHT: 1.5m

MXR-X314
STATIC MIXER
SIZE: 50mm
MATERIAL: PVC

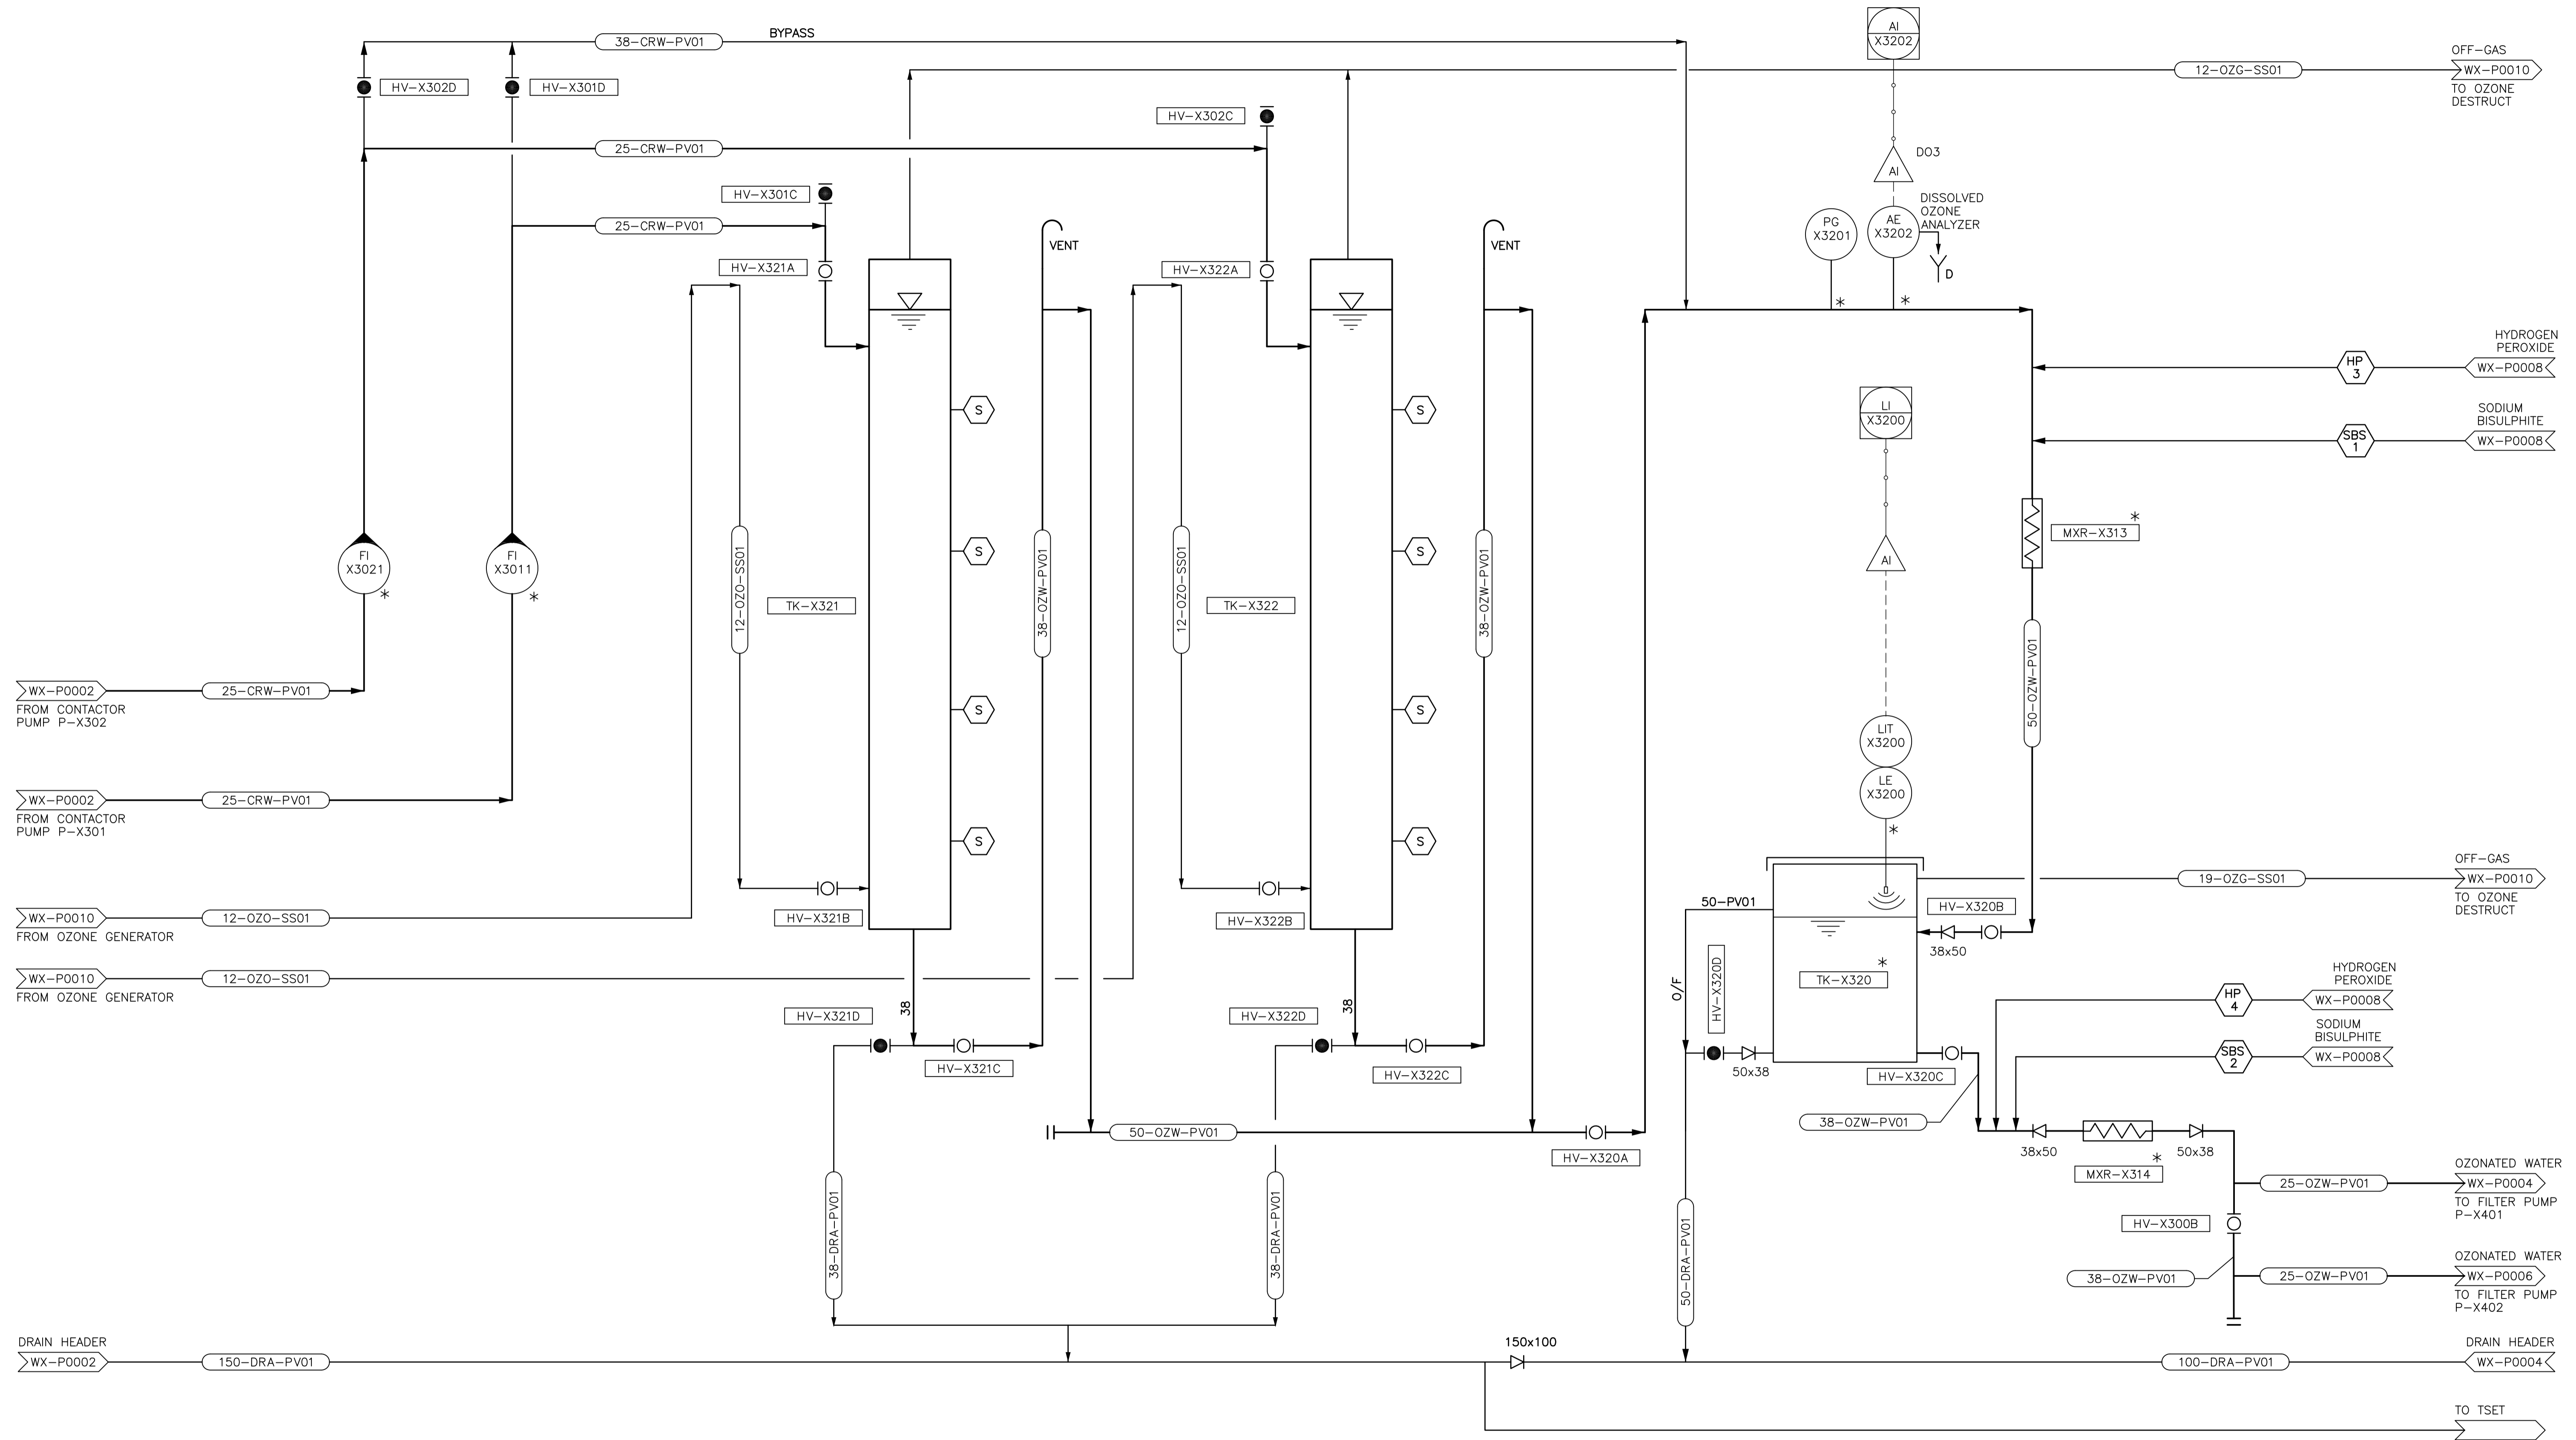

NOTES:

* CITY OF WINNIPEG TO SUPPLY EQUIPMENT/ INSTRUMENTATION. CONTRACTOR TO INSTALL.




DILLON CONSULTING

B.M. ELEV.	CONSTRUCTION COMPLETION DATE: YYYY MM DD		
DESIGNED BY	KG	CHECKED BY	BW
DRAWN BY	JBC	APPROVED BY	BW
SCALE:	HORIZONTAL NTS	RELEASED FOR CONSTRUCTION	
DATE	2014 06 13	DATE	
NO.	REVISIONS	DATE	BY
1	ISSUED FOR BID OP. 1068-2014	15/01/23	JBC
0	ISSUED FOR TENDER	14/06/13	JBC

CH2MHILL

DESIGNED BY	KG	CHECKED BY	BW
DRAWN BY	JBC	APPROVED BY	BW
SCALE:	HORIZONTAL NTS	RELEASED FOR CONSTRUCTION	
DATE	2014 06 13	DATE	

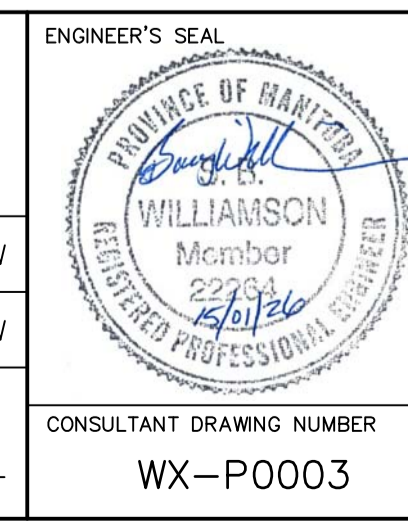

CONSULTANT DRAWING NUMBER
WX-P0003

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

CITY OF WINNIPEG WATER TREATMENT RESEARCH AND PROCESS OPTIMIZATION FACILITY
PROCESS
OZONE CONTACTORS
PROCESS AND INSTRUMENTATION DIAGRAM

SHEET X OF X
CITY DRAWING NUMBER
1-0601X-P0003-001-01

PLOT DATE: 2015 01 26

BID OPPORTUNITY: 1068-2014

FILE PATH: \\WINNIPEG\Pro\WinnipegCityof\462784Waterworks\DWG\DLV\462784-P-0001.dwg