


SEWPCC LIGHTING SITE PLAN
SCALE: 1 : 1000


SPECIFIC NOTES

- 1 DISCONNECT & REMOVE CONDUITS & CABLING TO ALLOW FOR SITE WORK. COMPLETELY REMOVE INTERIOR PORTION OF CONDUIT / WIRING FROM EXTERIOR WALL PENETRATION TO THE LIGHTING CONTACTOR IN THE GRIT ELECTRICAL ROOM. REMOVE WALL MOUNTED JUNCTION BOX. SEAL WALL OPENINGS. NEW CABLING TO BE RUN (VIA A DIFFERENT ROUTE) TO ENERGIZE EXISTING AND NEW LUMINAIRES.
- 2 DISCONNECT & REMOVE LAMP STANDARDS. TURN OVER EQUIPMENT TO CONTRACT ADMINISTRATOR. REMOVE CONCRETE BASES. CUT AND ABANDON UNDERGROUND CABLING / CONDUIT.
- 3 LAMP STANDARD TO REMAIN. DISCONNECT POWER CABLING AND LEAVE DE-ENERGIZED.
- 4 REMOVE EXISTING TRANSFORMER & DISTRIBUTION EQUIPMENT & TURN OVER TO THE CONTRACT ADMINISTRATOR. TRANSPORT EQUIPMENT TO THE DESIGNATED STORAGE AREA. ABANDON ASSOCIATED WIRING AND ENSURE THE IT IS DISCONNECTED & REMOVED FROM THE SUPPLY DISTRIBUTION ENCLOSURE WITHIN THE PLANT.



LEGEND

○ ○ LAMP STANDARD C/W CONCRETE BASE

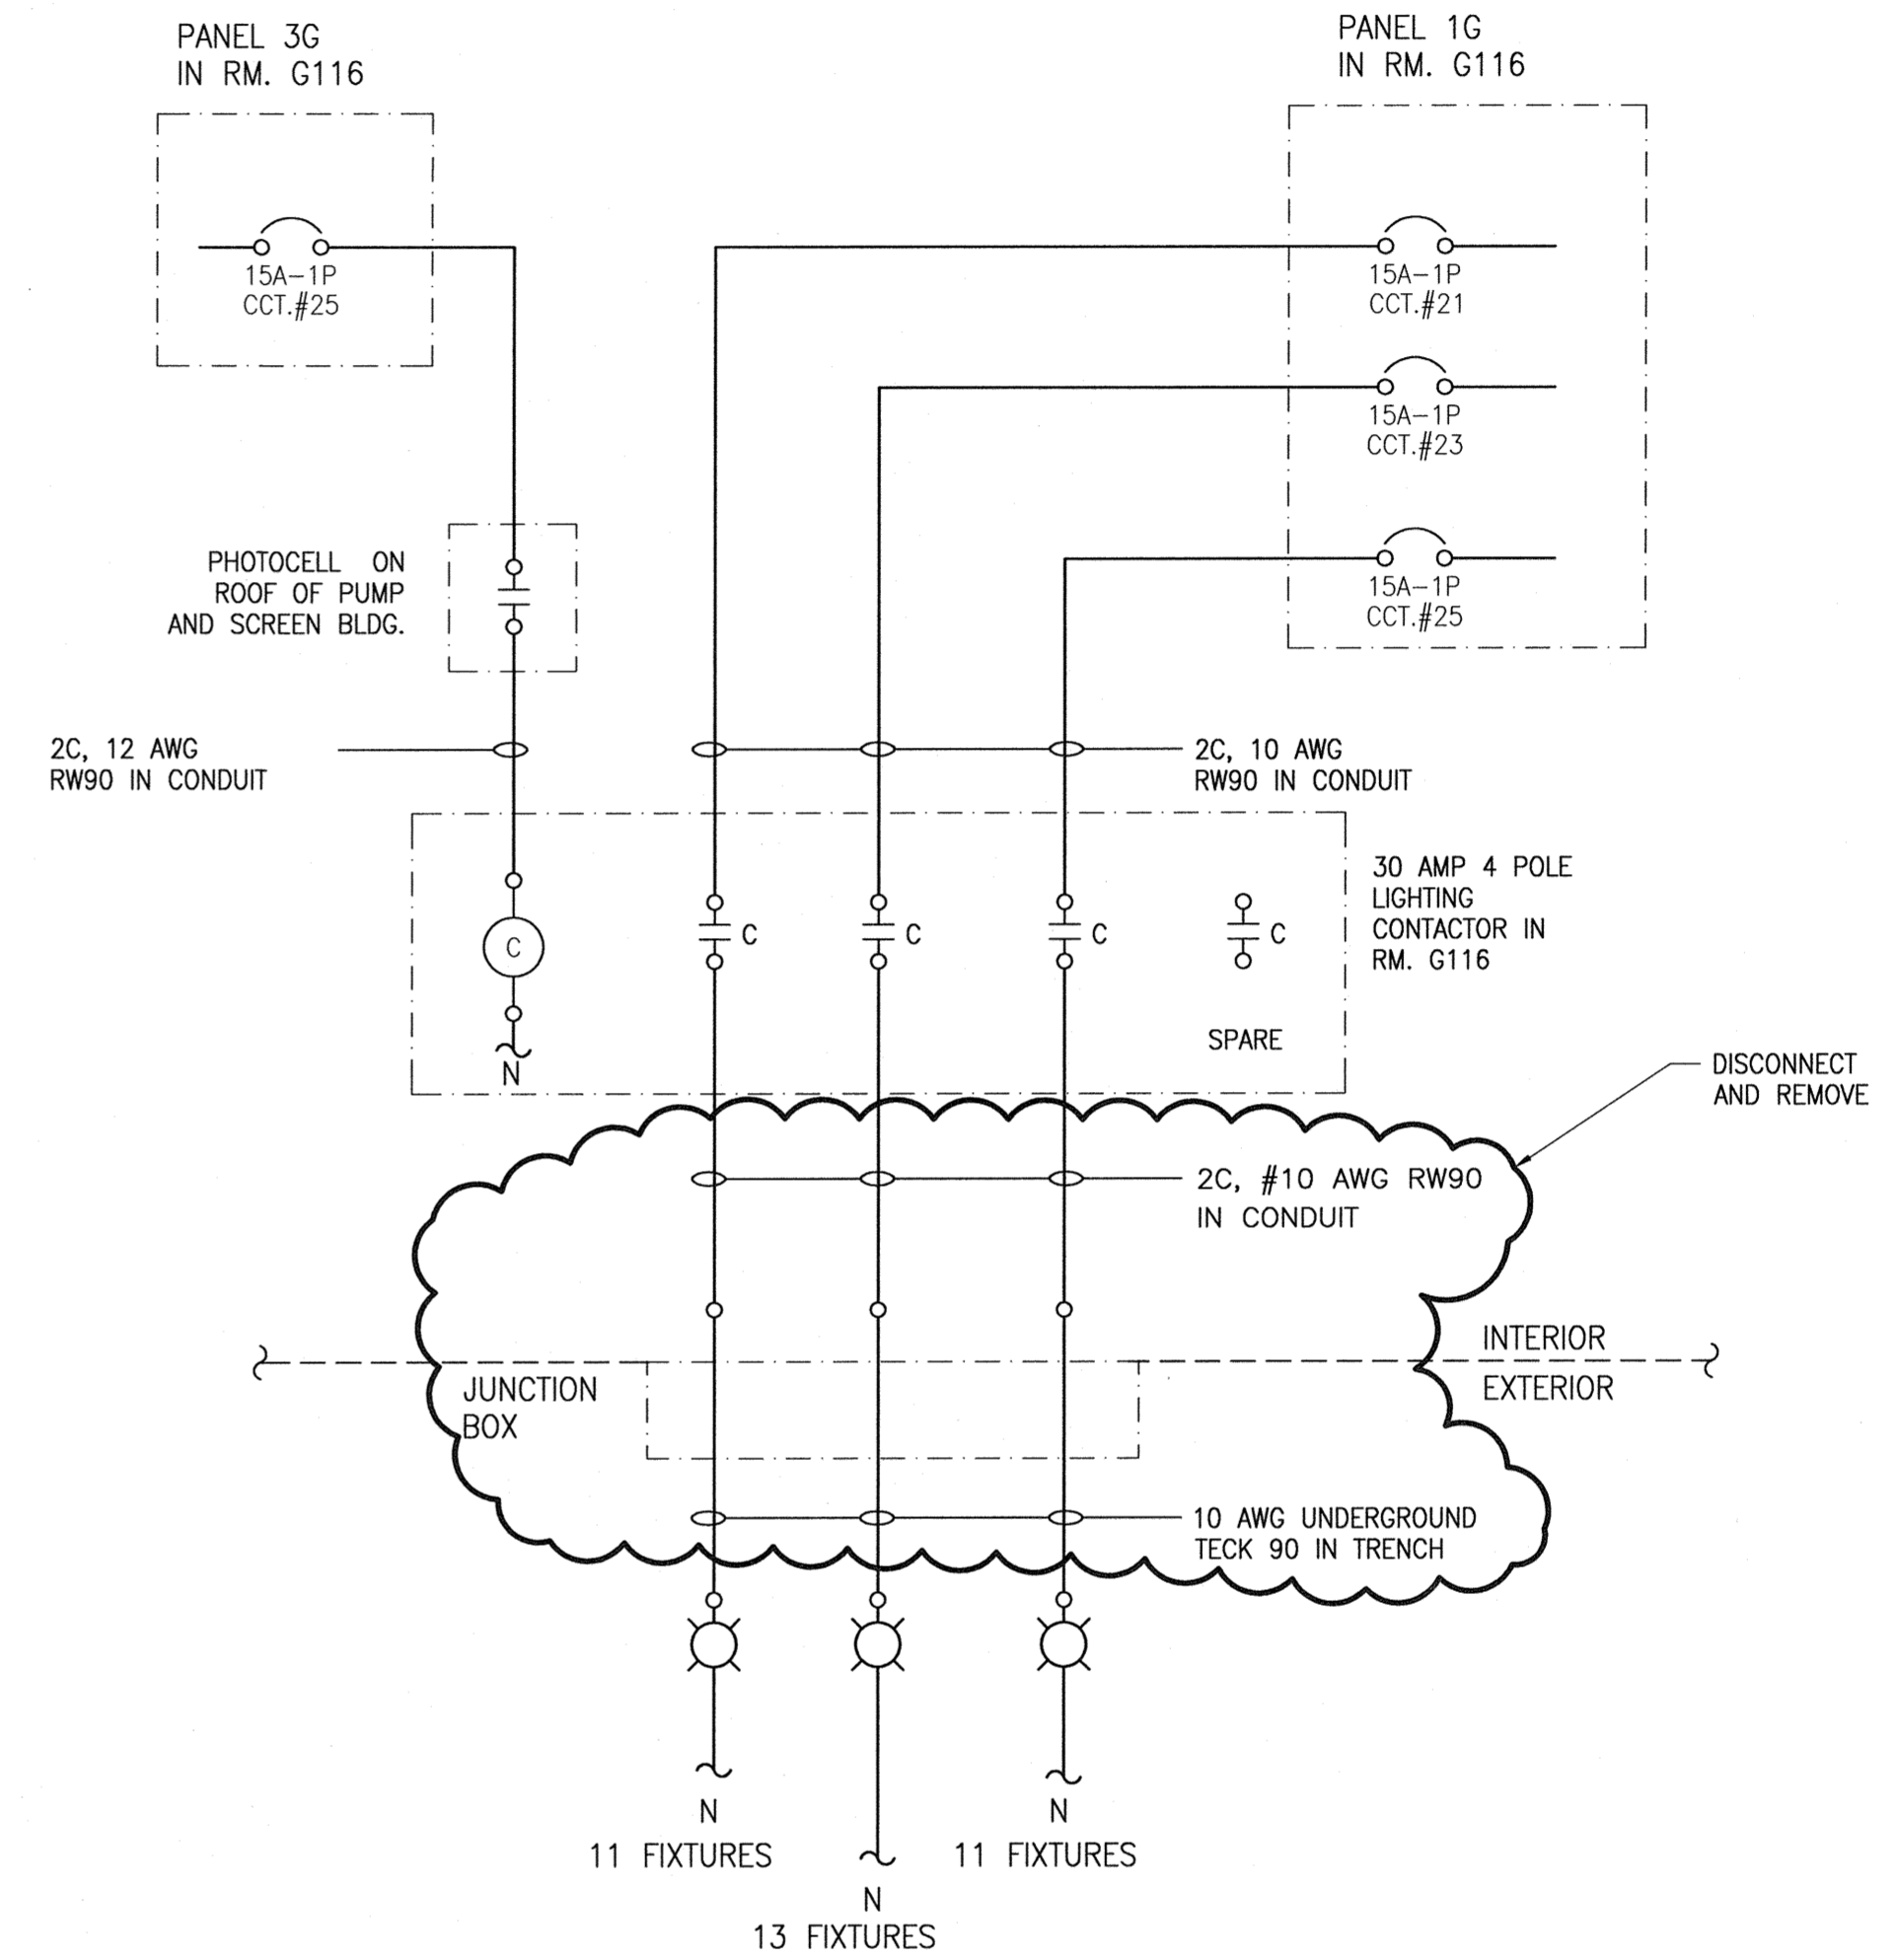

ROADWAY LIGHTING SCHEMATIC
SCALE: NTS

GENERAL NOTES

1. COORDINATE SITE WORK WITH THE CONTRACT ADMINISTRATOR. PRIOR TO DISCONNECTING SERVICES, ADVISE THE CONTRACT ADMINISTRATOR IN WRITING AND COORDINATE THE SYSTEM SHUTDOWN AHEAD OF TIME.

DESIGNED BY: D. BECKER		CHECKED BY: E. RYCZKOWSKI		APPROVED BY: E. RYCZKOWSKI		SOUTH END WATER POLLUTION CONTROL CNETRE SEWPCC UPGRADING/EXPANSION PROJECT SITE LIGHTING DEMOLITION	
DRAWN BY: M.J. PERSSON		SCALE: AS SHOWN		DATE: 2014/06/27		CITY DRAWING NUMBER 4-0102-ELTG-A001	
CONSULTANT NO.: 474248		DATE: 06/2014		DESIGN/CHECK: DB ER		SHEET 001	
NO. REVISIONS		DATE		DESIGN/CHECK		REV. SIZE 00 1A1	