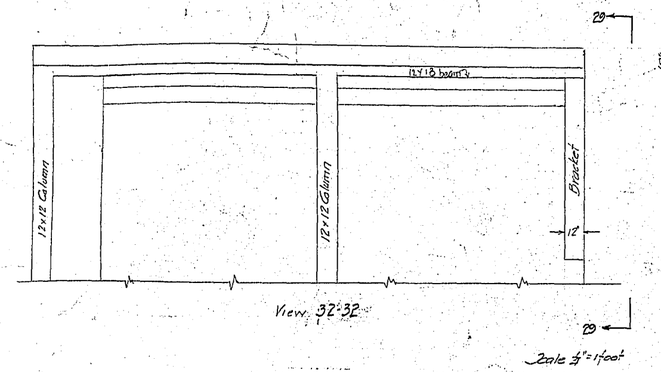

View 32-32

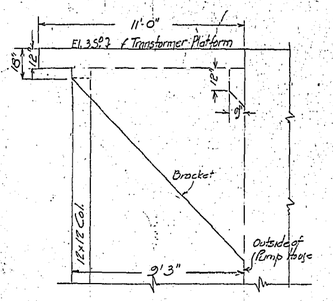

View 29-29

Scale 3/4"=1 foot

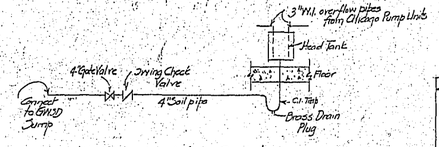

Diagram of Seal Pump drain
Not to Scale



Head Tank - 1 required
All welded - Galvanized
Scale 1"=1 foot
Support in field

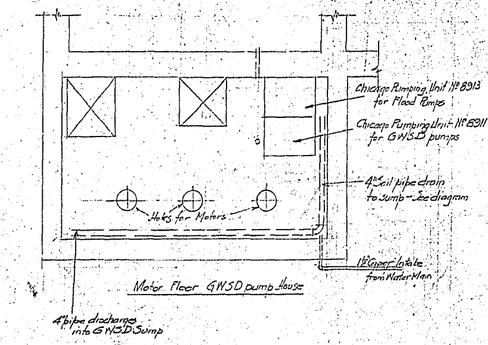

Motor Floor GWSD pump House

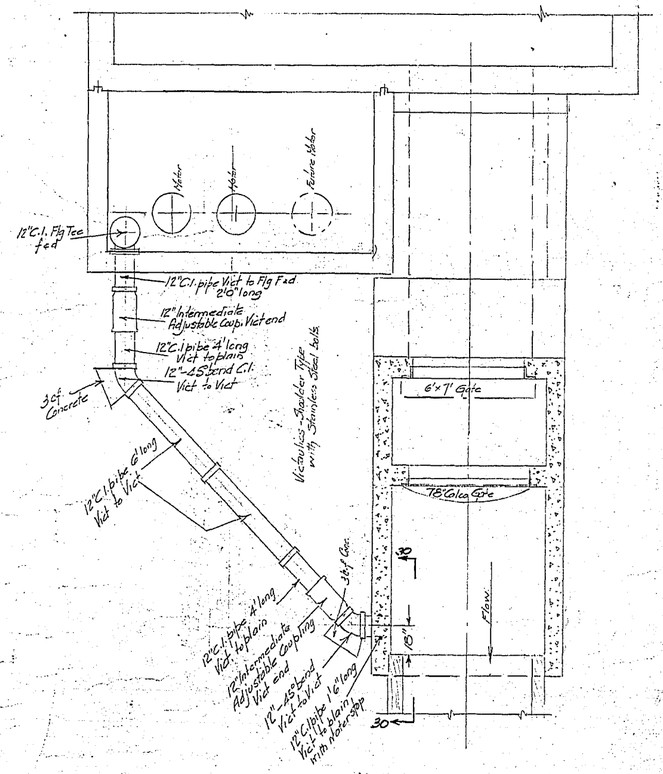

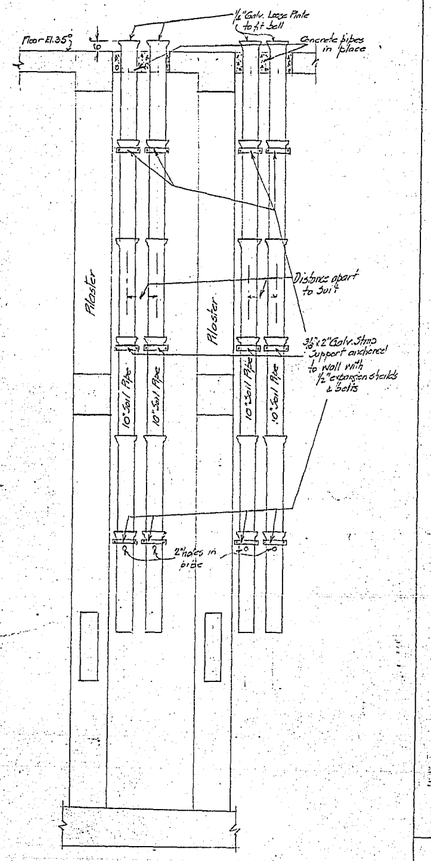

Section 31-31 Float pipes
Scale 1/4"=1 foot

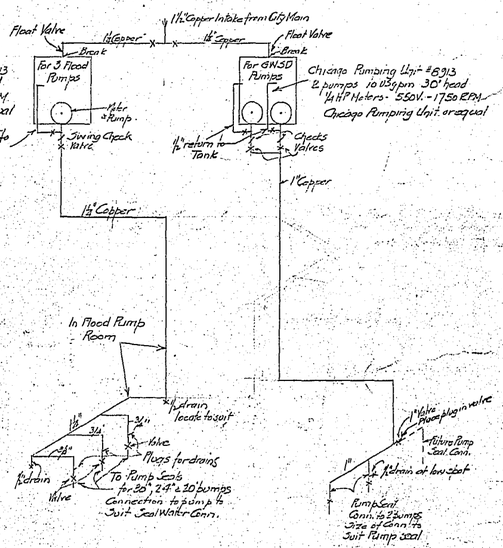

Diagram of Seal Water Connections
Not to Scale

G.W.S.D. Pump Discharge
Scale 1½"=1 foot



View 30-30



Top of Weir
Scale 1½"=1 foot

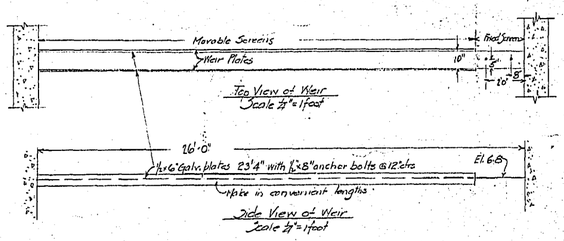

Top View of Weir
Scale 1½"=1 foot

Side View of Weir
Scale 1½"=1 foot

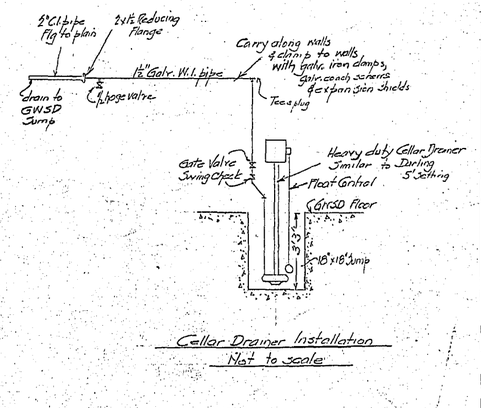

Cellar Drainer Installation
Not to scale

PROVINCE OF MANITOBA
J. C. D. TAYLOR
REGISTERED C.E.

R-140

FLOOD PUMPING STATION
COCKBURN STREET
DETAILS

CITY OF WINNIPEG
ENGINEERING DEPARTMENT
W. D. HURST, CITY ENGINEER
A. J. S. TAUNTON, DEPUTY CITY ENGINEER

DRAWN BY ... DATE. Mar. 1954
TRACED BY ...
CHECKED BY ...
APPROVED ...

SCALE As Shown
DRAWING NO. 6824