


FIELD

CONTROL PANEL CP-M801

FIELD TERMINALS

PLC SECTION

BMX DAI 1604  
RACK 0, SLOT 2

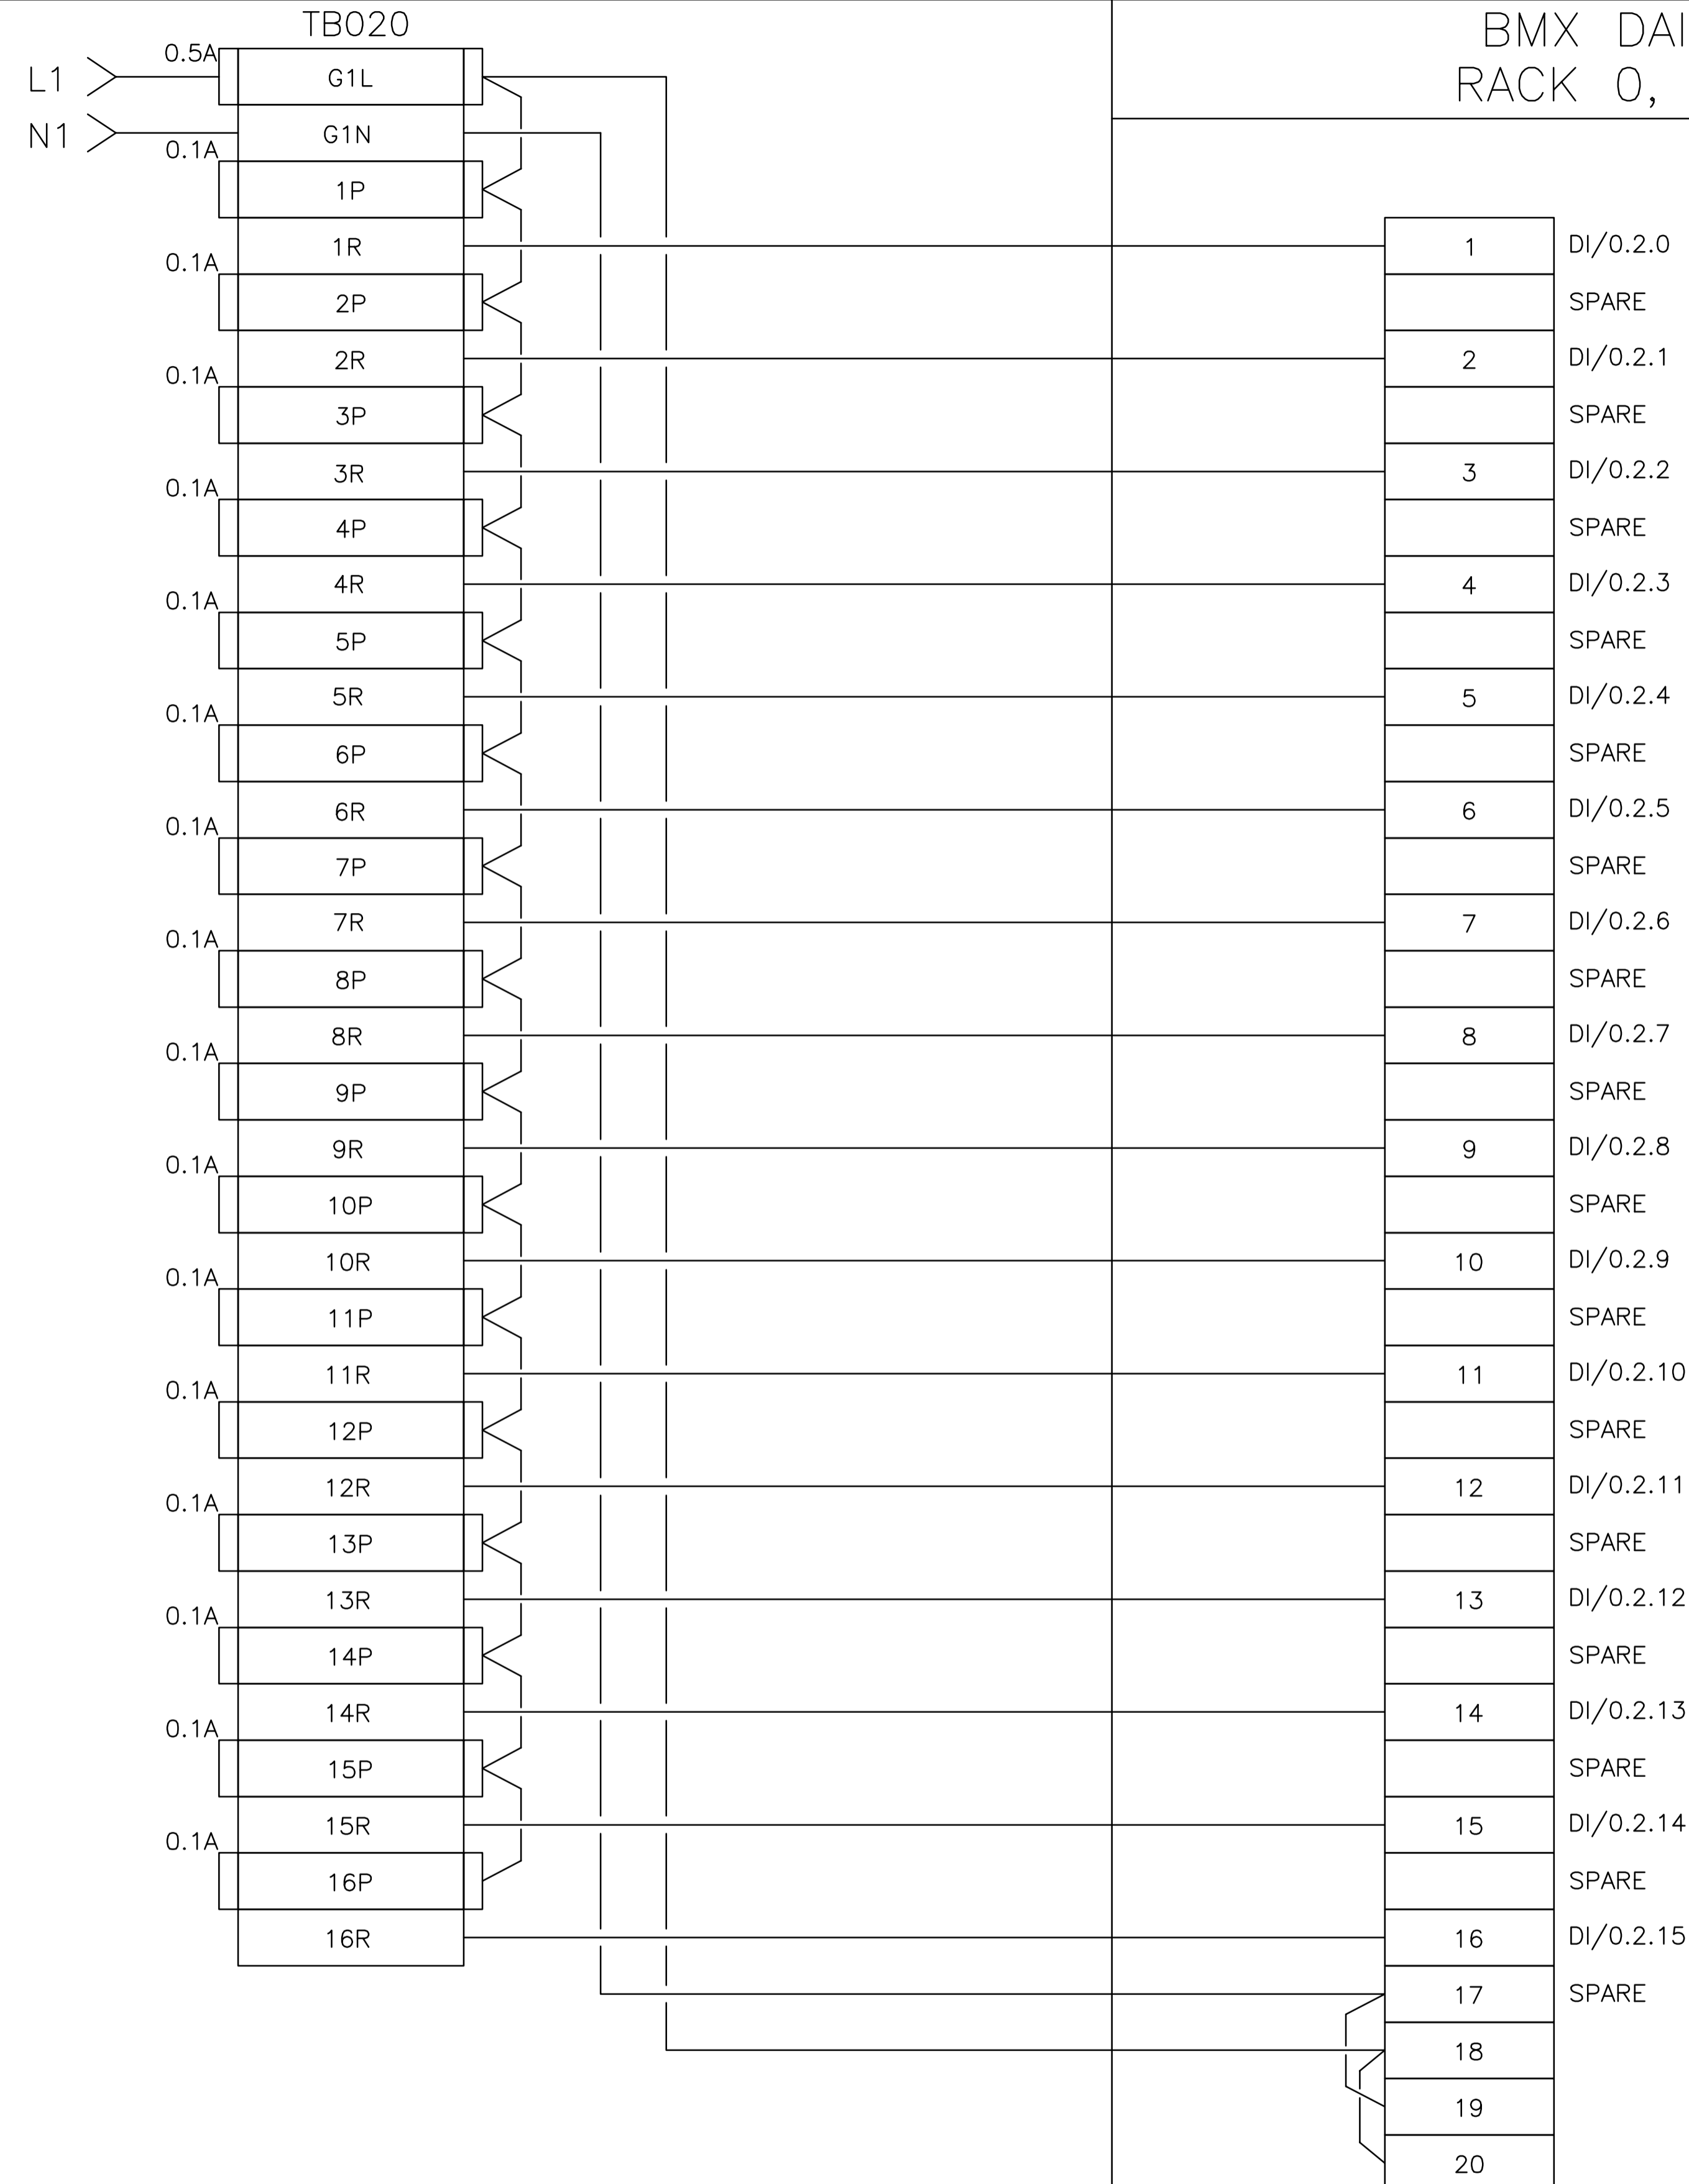

B.M. ELEV.	DESIGNED BY	BLM
	DRAWN BY	MS
	CHECKED BY	-
	APPROVED BY	-
	HOR. SCALE	
	VERTICAL SCALE	
0	ISSUED FOR TENDER	16/10/27 BLM
NO.	REVISIONS	DATE BY DATE

RELEASED FOR CONSTRUCTION

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT  
NEWPCC MAIN BUILDING - HVAC REPLACEMENT

CONTROL PANEL CP-M801  
RACK 0, SLOT 2, WIRING DIAGRAM

CITY DRAWING NUMBER  
1-0101M-A0044-001

SHEET 14 OF 21

IL-03