

GENERAL NOTES:

1. REFER TO DRAWING 1-0102-AGAD-C010 FOR GENERAL NOTES.
2. PROVIDE ALL INTERCONNECTING WIRING/CABLING REQUIRED BY THE FUEL STORAGE AND TRANSFER SYSTEM VENDOR FOR OPERATION OF THEIR PACKAGED SYSTEM AS PER VENDOR PROVIDED SHOP DRAWINGS. COORDINATE WITH VENDOR AS REQUIRED TO INCLUDE ALL COSTS AT TIME OF TENDER. PROVIDE WIRE AND CABLE IDENTIFICATION CONSISTENT WITH THE CITY'S IDENTIFICATION STANDARD. WIRING/CABLING TO BE IN CONDUIT UNLESS OTHERWISE APPROVED BY THE CONTRACT ADMINISTRATOR.

SPECIFIC NOTES:

- 1 NUMBER OF ACTUATORS AND LOCATIONS TO BE DETERMINED BY DAMPER MANUFACTURER. COORDINATE PROVISION OF JUNCTION BOXES AND LOCATION TO SUIT ACTUATORS PROVIDED.
- 2 COORDINATE LOCATION OF DIESEL FUEL TANK INSTRUMENTATION WITH FUEL STORAGE AND TRANSFER SYSTEM VENDOR.
- 3 AREA SURROUNDING FUEL STORAGE TANK IS A HAZARDOUS CLASS 1, ZONE 2 AREA. INSTALLATION OF EQUIPMENT SHALL BE SUITABLE FOR THIS AREA CLASSIFICATION. SEE EHLC-C002 FOR DETAILS.
- 4 INSTALL LCP-C650 OUTSIDE OF HAZARDOUS RATED AREA.

REFERENCE DRAWINGS	DESCRIPTION

GENERATOR ROOM
1 : 50




NO.	REVISIONS	DATE	DESIGN	CHECK
01	ISSUED FOR ADDENDUM 2 - 976-2016	2017/06/09	SSB	TMC
00	ISSUED FOR CONSTRUCTION - 976-2016	2017/04/05	MW	TMC

CH2MHILL.
SNC-LAVALIN

DESIGNED BY: M. WANG
DRAWN BY: M. WANG
SCALE: 1:50

CHECKED BY: T. CHURCH
APPROVED BY: E. RYCZKOWSKI
ISSUED FOR CONSTRUCTION BY: J. SHUMKA
DATE: 2015/12/07
DATE: 2017/04/05

CONSULTANT NO.: 474248

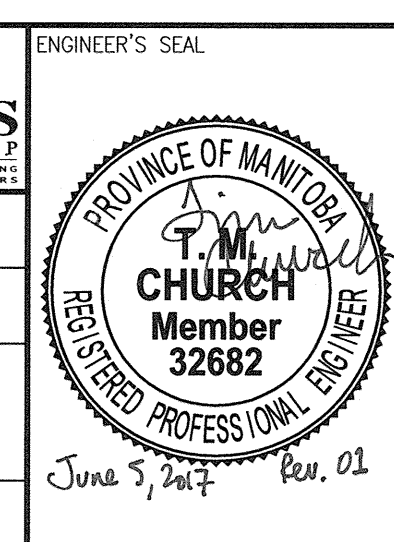

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
SEWPPC UPGRADING/EXPANSION PROJECT
AUTOMATION - INSTRUMENT LOCATION PLAN
CHEMICAL/ELECTRICAL BUILDING
GENERATOR ROOM

CITY DRAWING NUMBER: 1-0102-AGAD-C014
SHEET: 001
REV: 01
SIZE: A1