


B SECTION - PART B
1:50
PGAD-K001

NOTE:
1. FOR 25-FC-PV04 PROVIDE DROP LEGS OF CLEAR PVC. GANG TOGETHER CONTAINMENT PIPING REDUCE TO 12MM CLEAR PVC AND RUN TO NEAREST WALL OR VERTICAL TRAY. TERMINATE WITH A 12MM PVC BALL VALVE 500MM ABOVE THE FLOOR. REFER TO SECTION A ON DWG PGAD-C005 FOR CONCEPT.



NO.	REVISIONS	DATE	DESIGN	CHECK
03	ISSUED FOR ADDENDUM 2 - 976-2016	2017/06/09	J.S.	J.C.
02	ISSUED FOR CONSTRUCTION - 976-2016	2017/04/08	B.C.	J.C.
01	ISSUED FOR CONSTRUCTION	10/2015	B.C.	J.C.
00	ISSUED FOR TENDER	08/2015	B.C.	J.C.

CH2MHILL		KCS GROUP	
SNC-LAVALIN		ENGINEERING CONSULTANTS	
DESIGNED BY: J. KRAEMER	CHECKED BY: F. ABSI	SCALE: 1:50	ISSUED FOR CONSTRUCTION
DRAWN BY: B. COOPER	APPROVED BY: H. T. FREIHAMMER	DATE: 2017/04/05	DATE: 2017/04/05
CONSULTANT NO.: 474248			

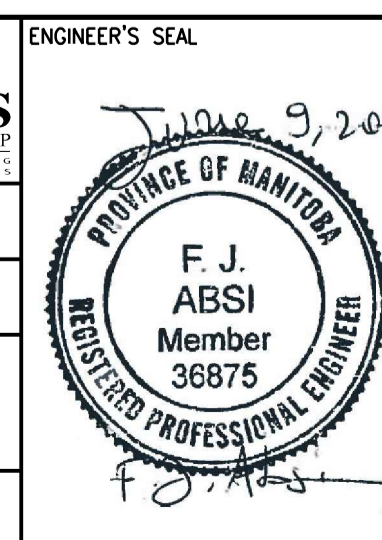

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
SEWPC UPGRADING/EXPANSION PROJECT
PROCESS
HIGH RATE CLARIFICATION BUILDING
SECTION B - PART B

CITY DRAWING NUMBER: 1-0102-PGAD-K006
SHEET: 03
REV.:
SIZE: A1