


TO HVAC PLC-C806
IO/0.4.31
SEE DWG. AILD-C909

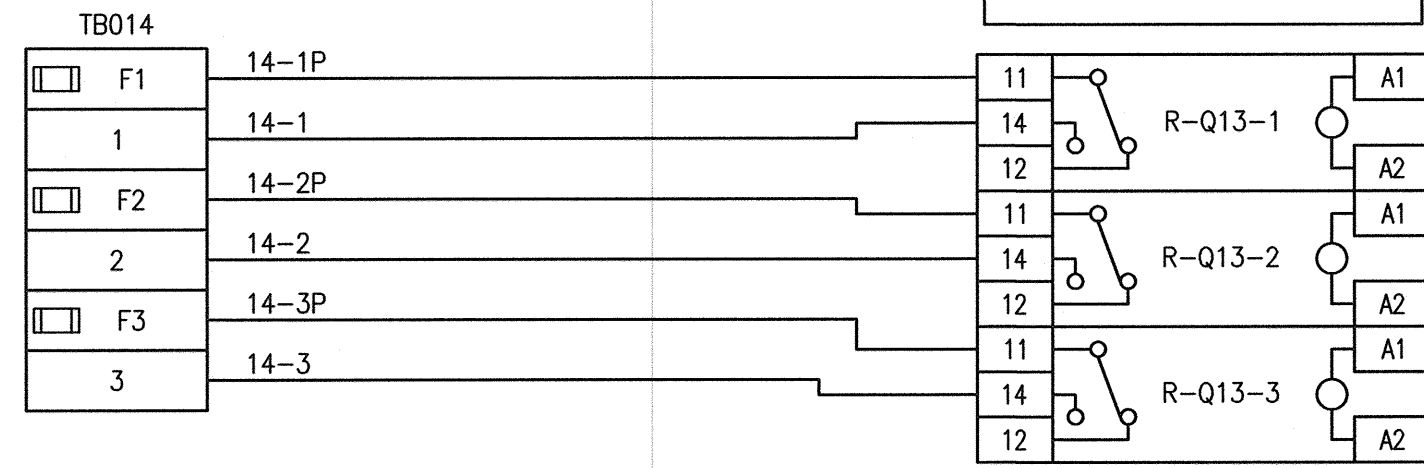

FROM PROCESS PLC RIO-C800-1
Q1/0.7.15
SEE DWG. ACBD-C013-001

| FUSE SCHEDULE | | | |
|---------------|------------|--------|----------|
| TB | IDENTIFIER | SIZE | RATING |
| TB014 | F1 | 5x20mm | 0.05A FA |
| | F2 | 5x20mm | 0.05A FA |
| | F3 | 5x20mm | 0.05A FA |

NOTES
FA = FAST ACTING
TD = TIME DELAY

| REFERENCE DRAWINGS | DESCRIPTION |
|--------------------|-------------|
| | |




| NO. | REVISIONS | DATE | DESIGN | CHECK |
|-----|------------------------------------|------------|--------|-------|
| 01 | ISSUED FOR ADDENDUM 3 - 976-2016 | 2017/06/23 | TMC | PC |
| 00 | ISSUED FOR CONSTRUCTION - 976-2016 | 2017/04/05 | MW | PC |

CH2MHILL
SNC-LAVALIN

DESIGNED BY: M. WANG
DRAWN BY: S. BOGHOSIAN
SCALE: NTS

CHECKED BY: P. CHICATUN
APPROVED BY: E. RYCZKOWSKI
ISSUED FOR CONSTRUCTION BY: J. SHUMKA
DATE: 2016/09/21
DATE: 2017/04/05

CONSULTANT NO.: 474248

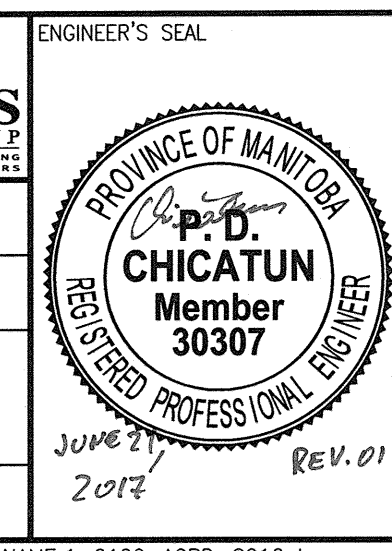

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
SEWPCC UPGRADING/EXPANSION PROJECT
AUTOMATION - WIRING DIAGRAM
CHEMICAL/ELECTRICAL BUILDING
CP-C821, RIO-C800-1 - MISCELLANEOUS WIRING

CITY DRAWING NUMBER: 1-0102-ACBD-C016
SHEET: 001
REV: 01
SIZE: A1