



1 KIOSK - SECTION (TYP. OF KIOSK 1 & 2)
SCALE: 1:20

VENTILATION DESIGN INFORMATION		
VENTILATION STANDARD	ASHRAE 62.1-2016	
ERV-1	TYPE OF OCCUPANCY	OFFICE SPACE
	OCCUPANCY	1 PERSON
	AREA	12.8 SQ. M.
	PEOPLE OUTDOOR AIR RATE	2.5 L/S/PERSON
	AREA OUTDOOR AIR RATE	0.3 L/S/SQ. M.
	MINIMUM REQUIRED OUTDOOR AIR RATE	7 L/S
ERV-1	TYPE OF OCCUPANCY	BREAKROOM
	OCCUPANCY	2 PEOPLE
	AREA	16.0 SQ. M.
	PEOPLE OUTDOOR AIR RATE	2.5 L/S/PERSON
	AREA OUTDOOR AIR RATE	0.6 L/S/SQ. M.
	MINIMUM REQUIRED OUTDOOR AIR RATE	15 L/S
ERV-1	TYPE OF OCCUPANCY	CORRIDOR
	OCCUPANCY	0 PEOPLE
	AREA	19.5 SQ. M.
	PEOPLE OUTDOOR AIR RATE	0 L/S/PERSON
	AREA OUTDOOR AIR RATE	0.3 L/S/SQ. M.
	MINIMUM REQUIRED OUTDOOR AIR RATE	6 L/S
TOTAL REQUIRED OUTDOOR AIR RATE		28 L/S
DESIGN OUTDOOR AIR RATE		54 L/S

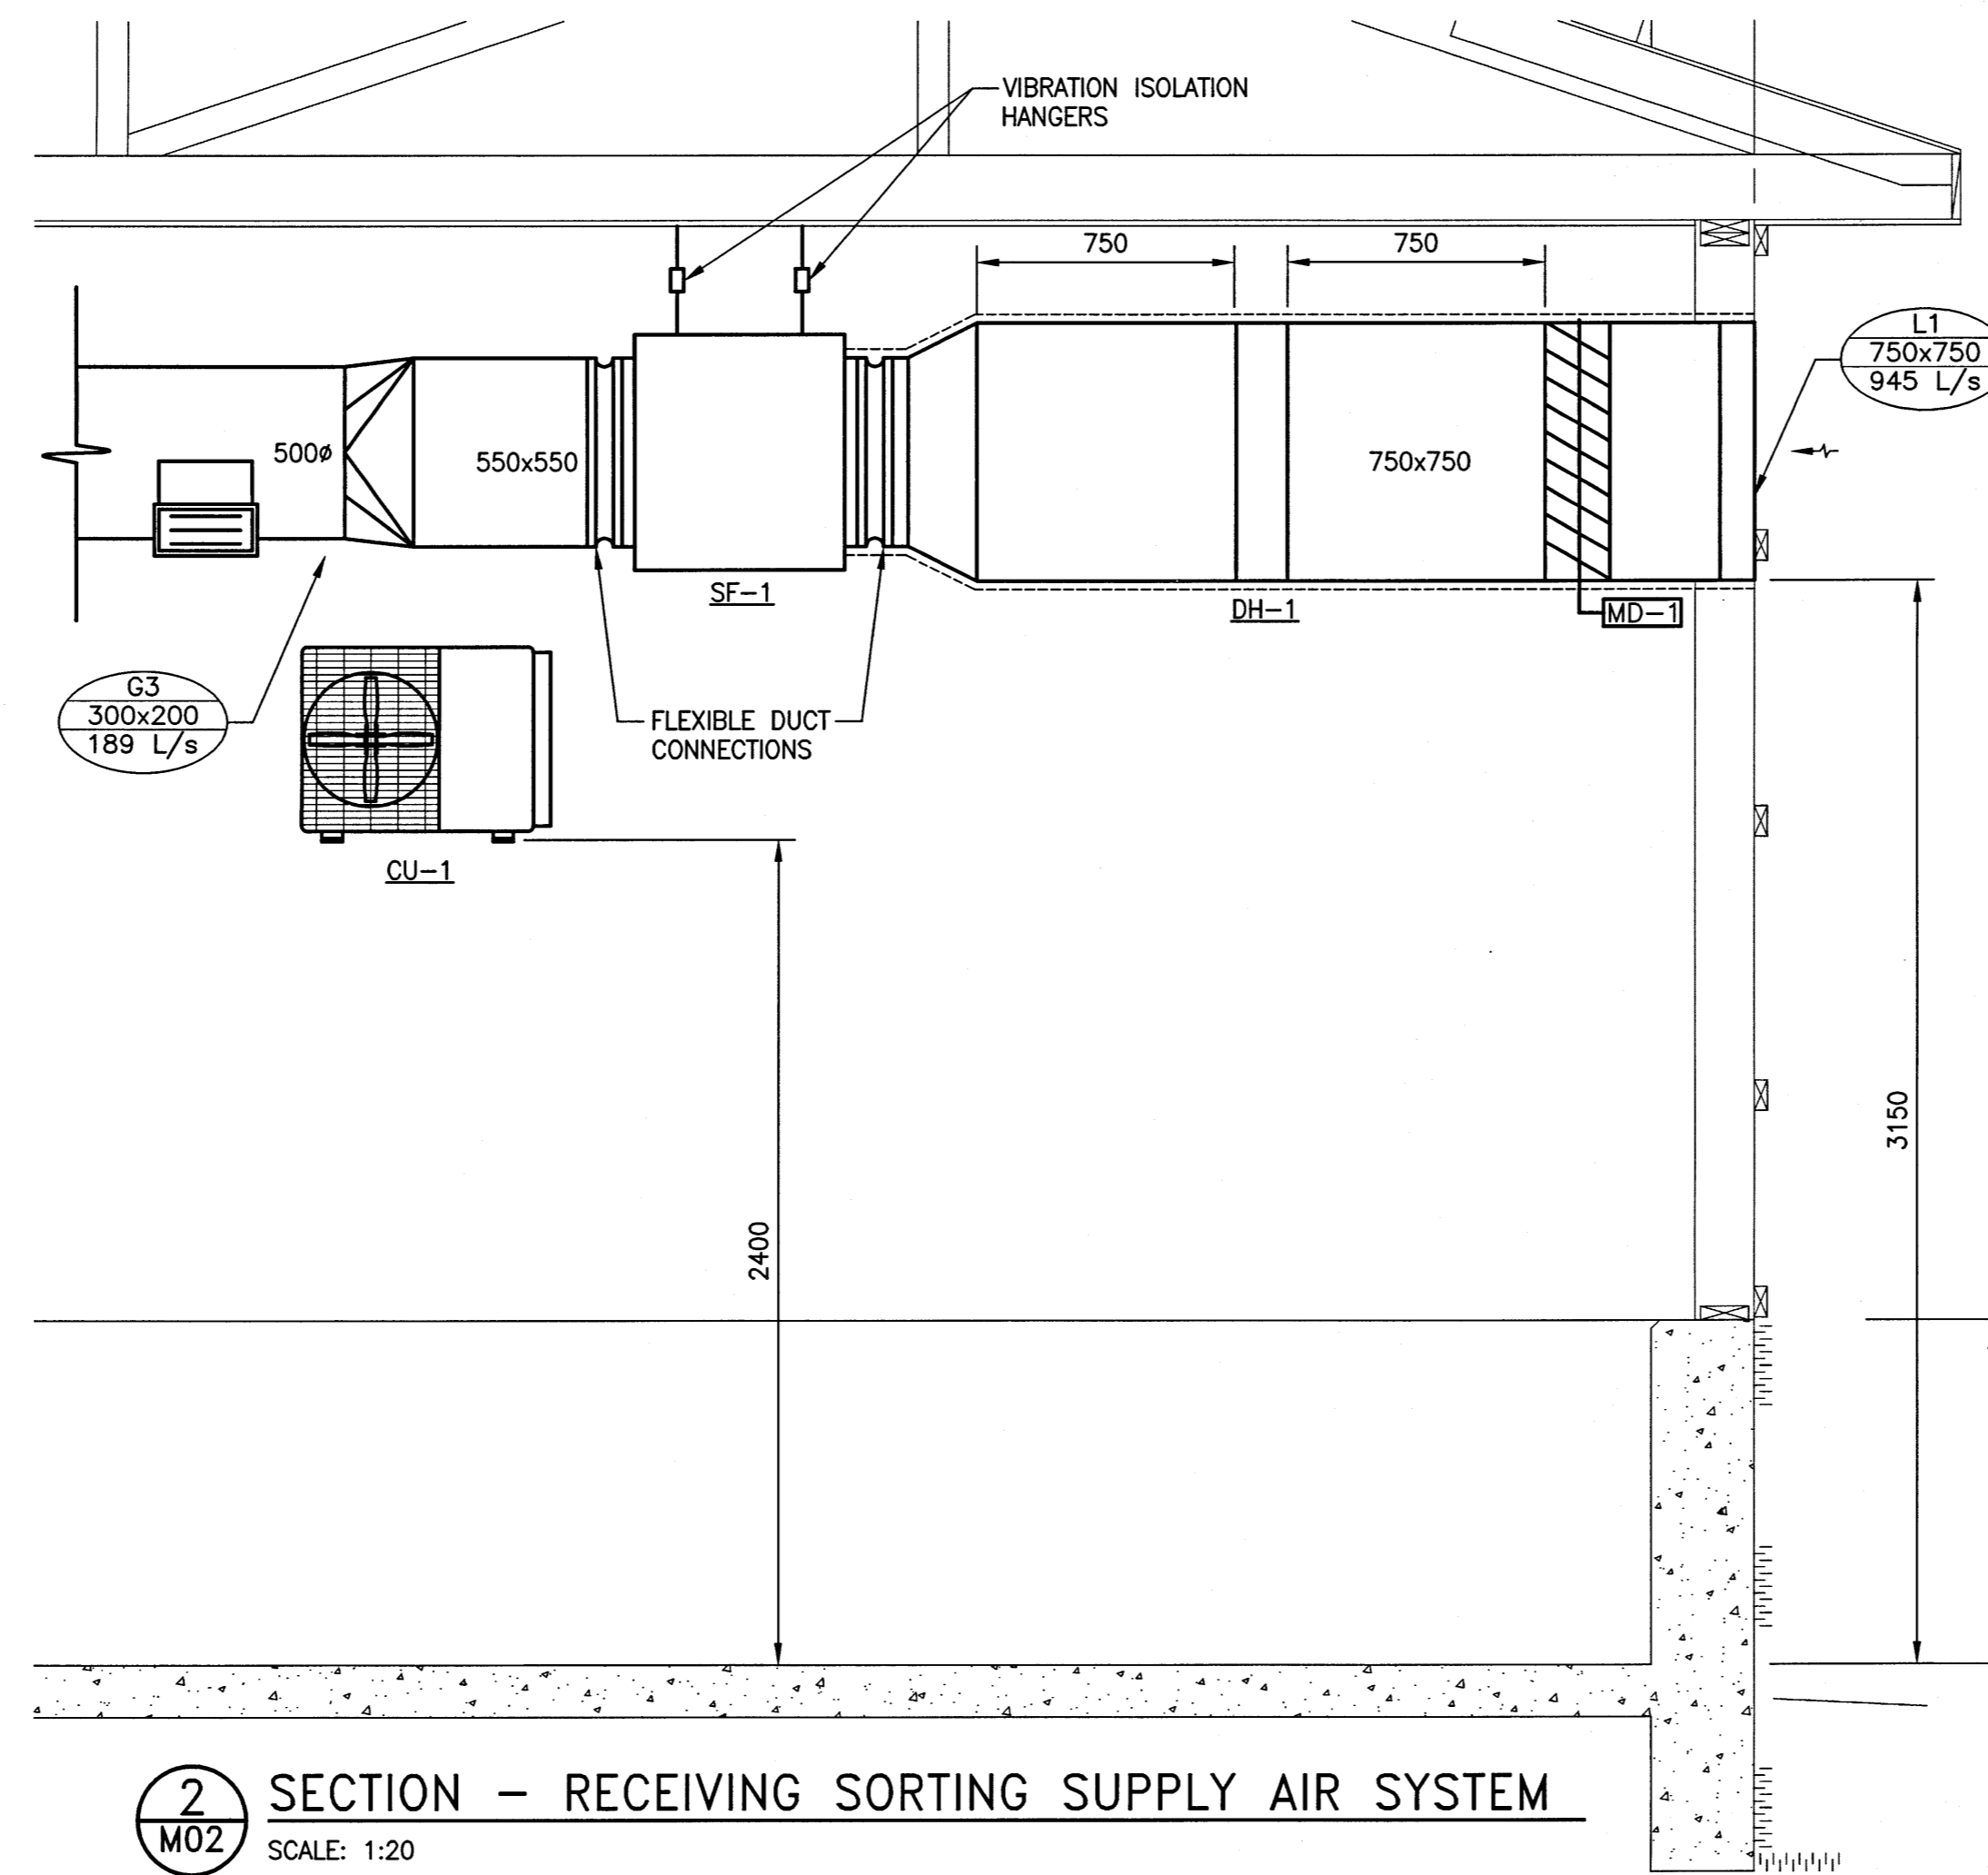


2 SECTION - RECEIVING SORTING SUPPLY AIR SYSTEM
SCALE: 1:20

16-0107-010\16-0107-010_CALL-Rev. B.dwg

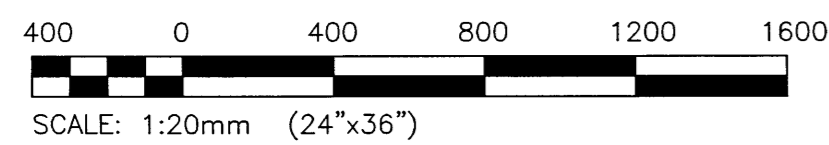

SCALE VERIFIED BY: *MAP*

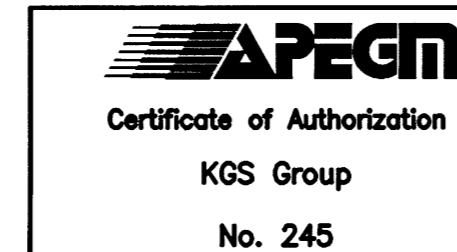

LOCATION APPROVED UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. ELEV.	NO.	REVISIONS	DATE	BY
	0	ISSUED FOR TENDER	17/03/14	

KGS GROUP CONSULTING ENGINEERS		ENGINEER'S SEAL
DESIGNED BY: MAP	CHECKED BY: <i>[Signature]</i>	
DRAWN BY: EAG	APPROVED BY:	
HOR. SCALE: AS NOTED	RELEASSED FOR CONSTRUCTION:	CONSULTANT DRAWING NO. 16-0107-010
VERTICAL: AS NOTED	DATE: 16/08/17	

THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT		SHEET OF 24 OF 41
PROJECT TITLE 4R WINNIPEG DEPOT EAST WINNIPEG COMMUNITY RESOURCE RECOVERY CENTRE HHW BUILDING SECTIONS, DETAILS & SCHEDULES		COMPUTER FILE NAME 16-0107-010
		CITY DRAWING NUMBER M03