


INSTRUMENT AIR SUPPLY FROM DISTRIBUTION
C P0-X602

IAS

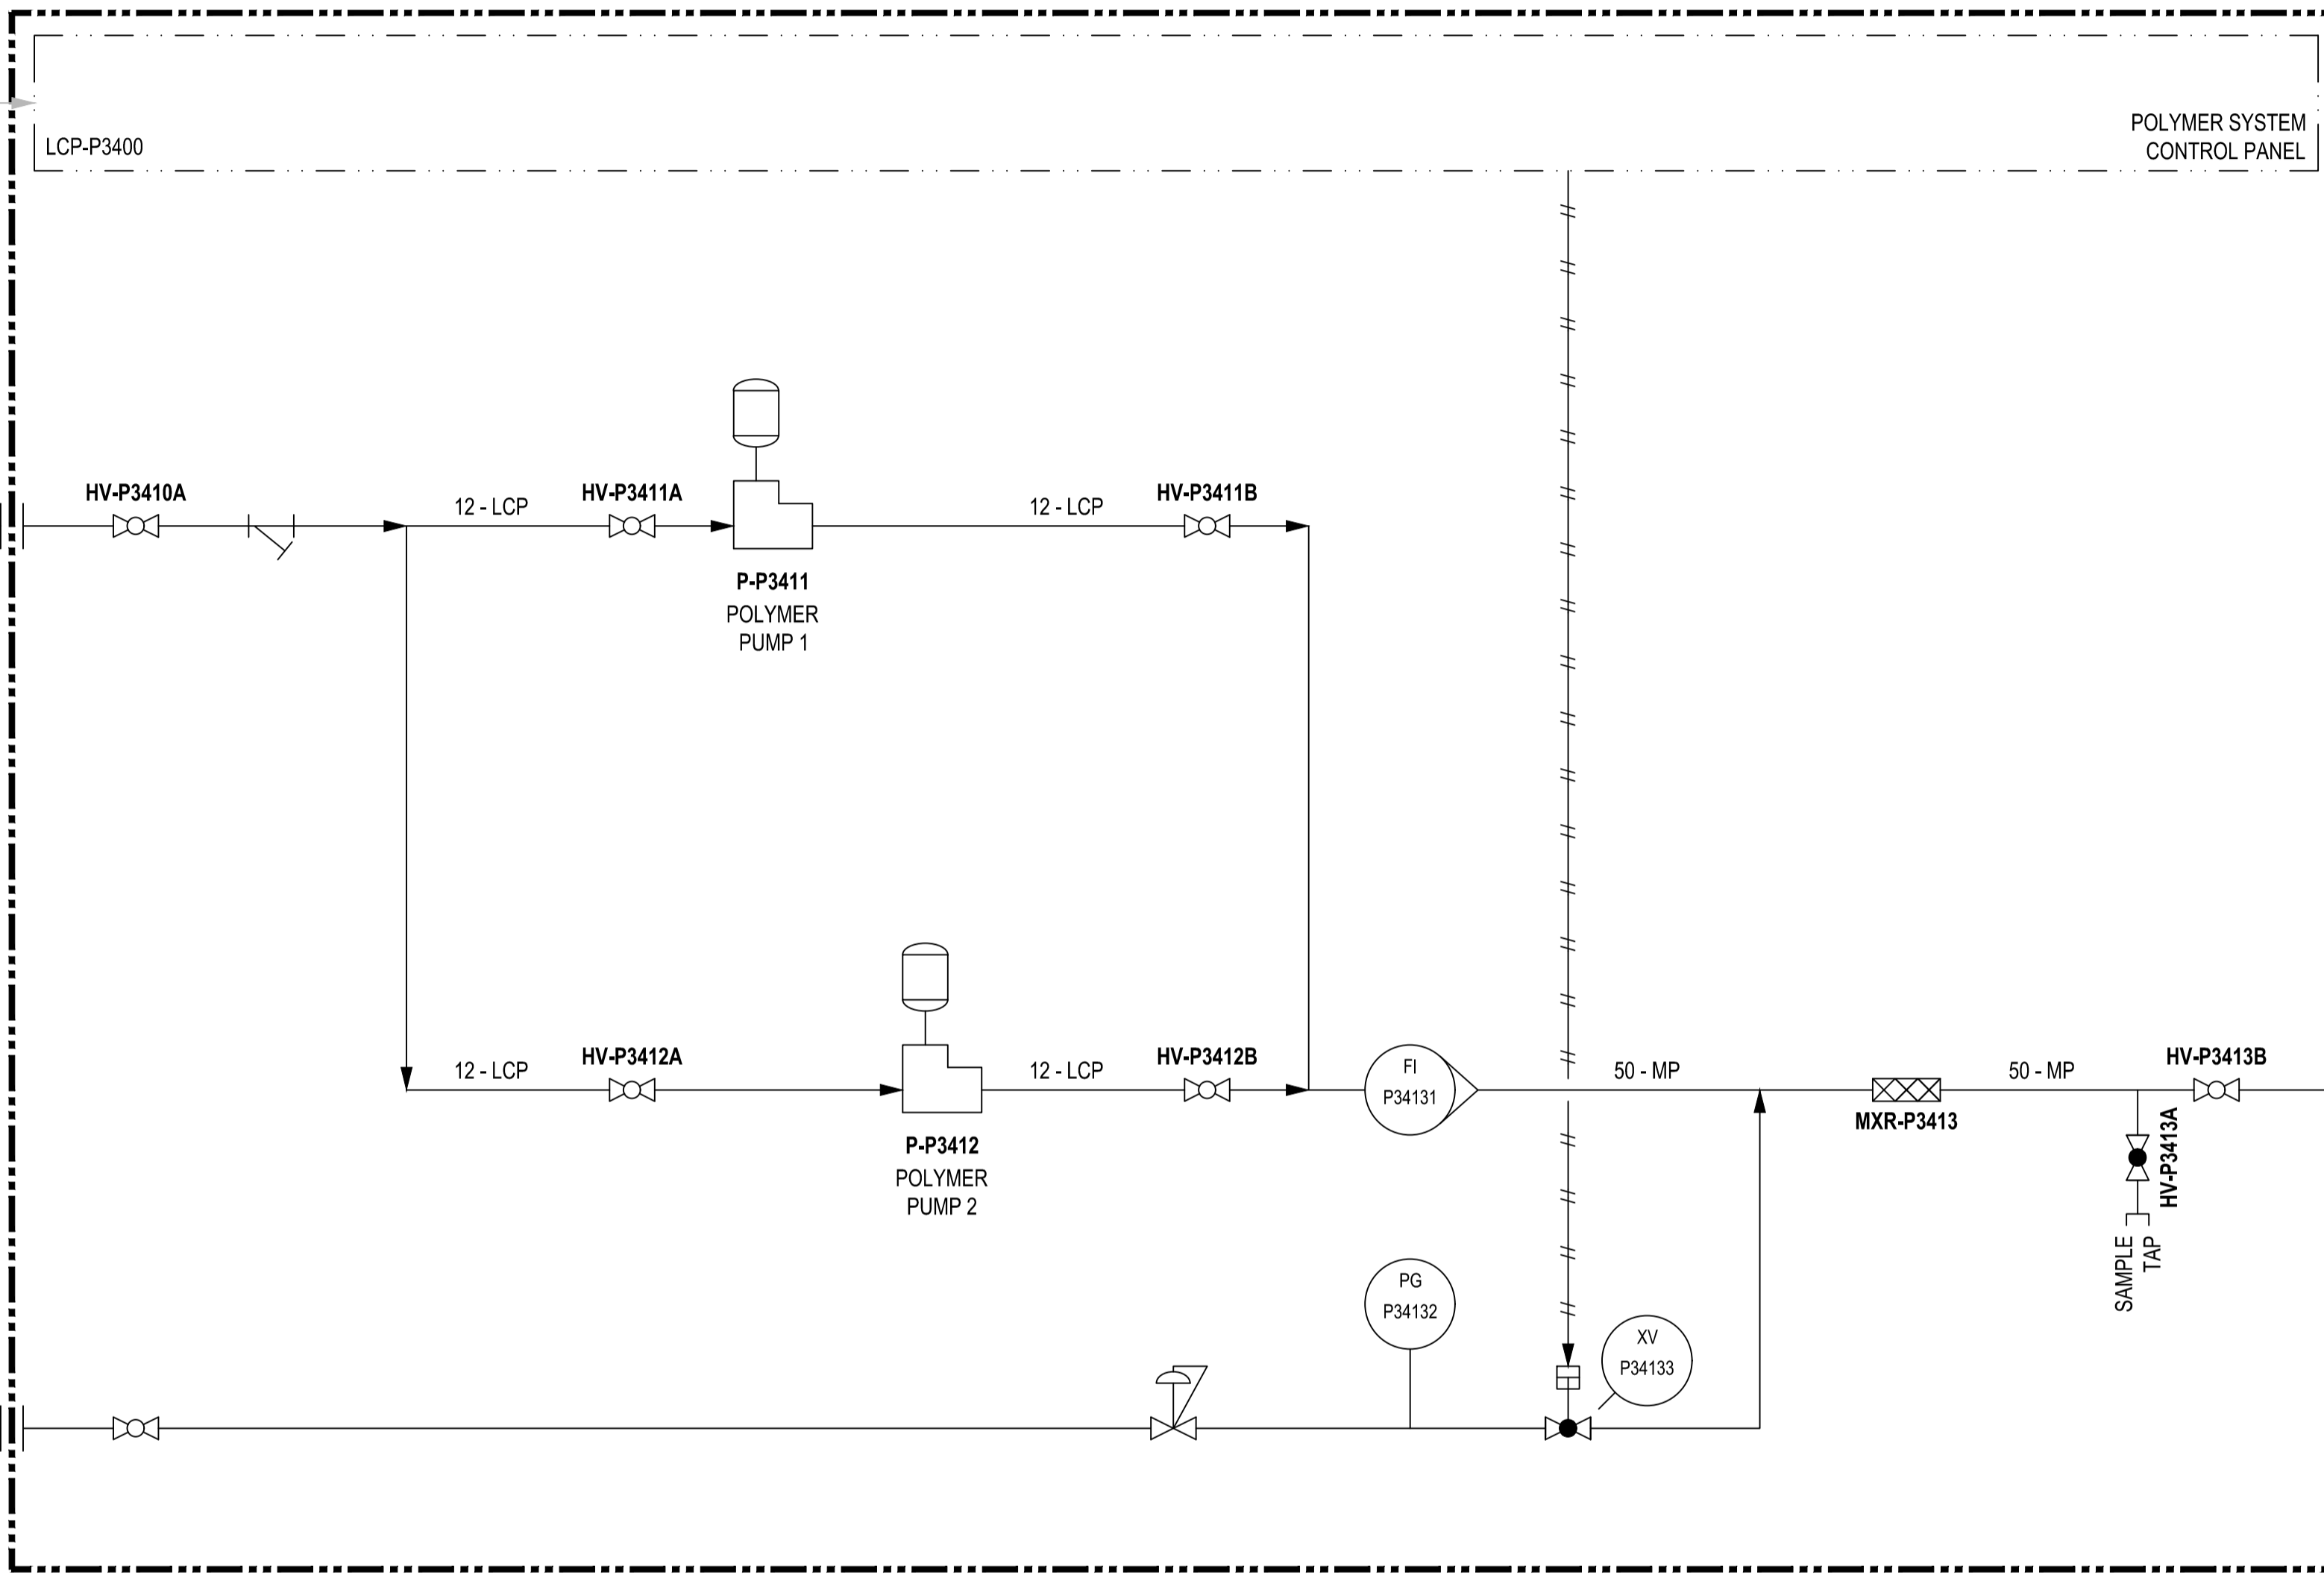

W2 FROM DISTRIBUTION
12 - W2

LIQUID POLYMER TOTE (BY OTHERS)
SUPPLIED BY ROTARY PRESS VENDOR

ROTARY PRESS VENDOR SUPPLY PACKAGE

POLYMER SYSTEM CONTROL PANEL

P-P3411
POLYMER PUMP 1
120V or 24Vdc
(4-20mA)

P-P3412
POLYMER PUMP 2
120V or 24Vdc
(4-20mA)

TENDER NO.

FOR REFERENCE ONLY

DRAFT

| NO. | REVISIONS | DATE | DESIGN | CHECK |
|-----|--|------------|--------|-------|
| 0 | ISSUED FOR TENDER OF ROTARY PRESS SUPPLY | 2022-12-15 | MK | PB |

| | |
|-------------------------|-------------------------------------|
| AECOM | |
| DESIGNED BY: MK | CHECKED BY: PB |
| DRAWN BY: ES | APPROVED BY: NW |
| SCALE: NONE | RELEASED FOR CONSTRUCTION BY: DATE: |
| DATE: | DATE: |
| CONSULTANT NO.: P3-X608 | |

ENGINEER'S SEAL

PRELIMINARY

NOT TO BE USED FOR CONSTRUCTION

THE CITY OF WINNIPEG
Winnipeg WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
REQUEST FOR PROPOSALS FOR SUPPLY OF ROTARY PRESS & APPURTENANCES
PROCESS & INSTRUMENTATION DIAGRAM
SCUM DEWATERING POLYMER SYSTEM

CITY DRAWING NUMBER: **1-0101P-A####** SHEET: **001** REV: **0** SIZE: **A1**