
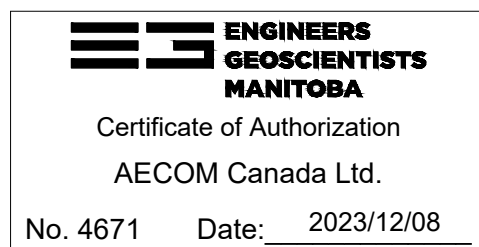


- NOTES:
- ALL CABLES ARE CAT-6, SHIELDED ETHERNET CABLES UNLESS OTHERWISE NOTED.
 - GREYED OUT ITEMS INDICATE EXISTING EQUIPMENT OR DEVICES.

- CONTRACTOR NOTES:
- CONTRACTOR SCOPE IS LIMITED TO THE FOLLOWING:
 - PROVIDE CAT-6 COMMUNICATION CABLES BETWEEN NETWORK SWITCHES AND PLC PANEL.
 - PROVIDE AND INSTALL CAT-6 COMMUNICATION CABLES IN SEPARATE CONDUITS TO PROVIDE REDUNDANCY PATH FOR EACH CABLE.

REF. NO.	DRAWING TITLE	DRAWING NUMBER	NO.	REVISIONS	DATE	DESIGN	CHECK
3	POWER DISTRIBUTION SCHEMATIC BOILER CONTROL PANEL CP-B8001	1-0101-AWDG-B001-001 1-0101-AWDG-B001-002					
2	BOILER PANEL LAYOUT DIAGRAM	1-0101-ACBD-B101-001					
1	BOILER AREA CONTROL ROOM	1-0101-AGAD-B001-001	1	ISSUED FOR GC TENDER	2024-01-08	KG	SDS
0			0	ISSUED FOR TENDER	2023-03-17	KG	SDS
	REFERENCE DRAWING						

AECOM	
DESIGNED BY: KG	CHECKED BY: SDS
DRAWN BY: RC	APPROVED BY: SB
SCALE: NTS	RELEASED FOR CONSTRUCTION BY:
DATE: 2024-01-08	DATE:
CONSULTANT NO.:	

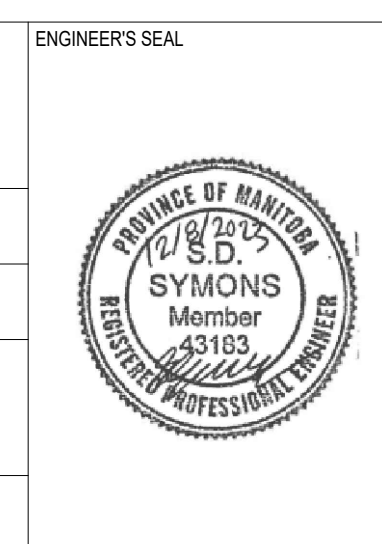

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
DCS MIGRATION
NETWORK DIAGRAM
BOILERS PLC DEVICE NETWORK

CITY DRAWING NUMBER 1-0101-ANET-B101	SHEET 001	REV. 0A	SIZE A1
--	---------------------	-------------------	-------------------