




| | | | |
|---------------------|------------------------|------------|-------------------------|
| CI WM | REPAIR 5-15YRS-ABANDON | AQUEDUCT | HISTORICAL PROJECT |
| PVC WM | REPAIR >15YRS | MANHOLE | SCHOOL |
| AC WM | REPAIR >15YRS-ABANDON | SEWERS | PWD PROJECT |
| UNKNOWN WM | VALVE | RAILWAY | SEWER RELIEF WORK |
| REPAIR <5YR | HYDRANT | WM RENEWAL | CATHODIC PROTECTION |
| REPAIR <5YR-ABANDON | HYDRANT BRANCH | WM NEW | FIRE PROTECTION UPGRADE |
| REPAIR 5-15YRS | FEEDER MAIN | WM ABANDON | |


Additional Notes:
 -200mm is good for Edmonton.
 -For the Kennedy HYD - we could relocate the hydrant to connect to the 250mm WM on St Mary Av and abandon the 200 CI WM.

Printed: 11/16/2023



CITY OF WINNIPEG WATER AND WASTE DEPARTMENT 2024 WATER MAIN RENEWAL PROGRAM

| | |
|---|--------------------------------|
| Location ID: 26 | Street: EDMONTON ST/KENNEDY ST |
| Location Description: THROUGH ST MARY AVE | |
| Scale: 1:2000 | Renewal Type: PWD-REGIONAL |

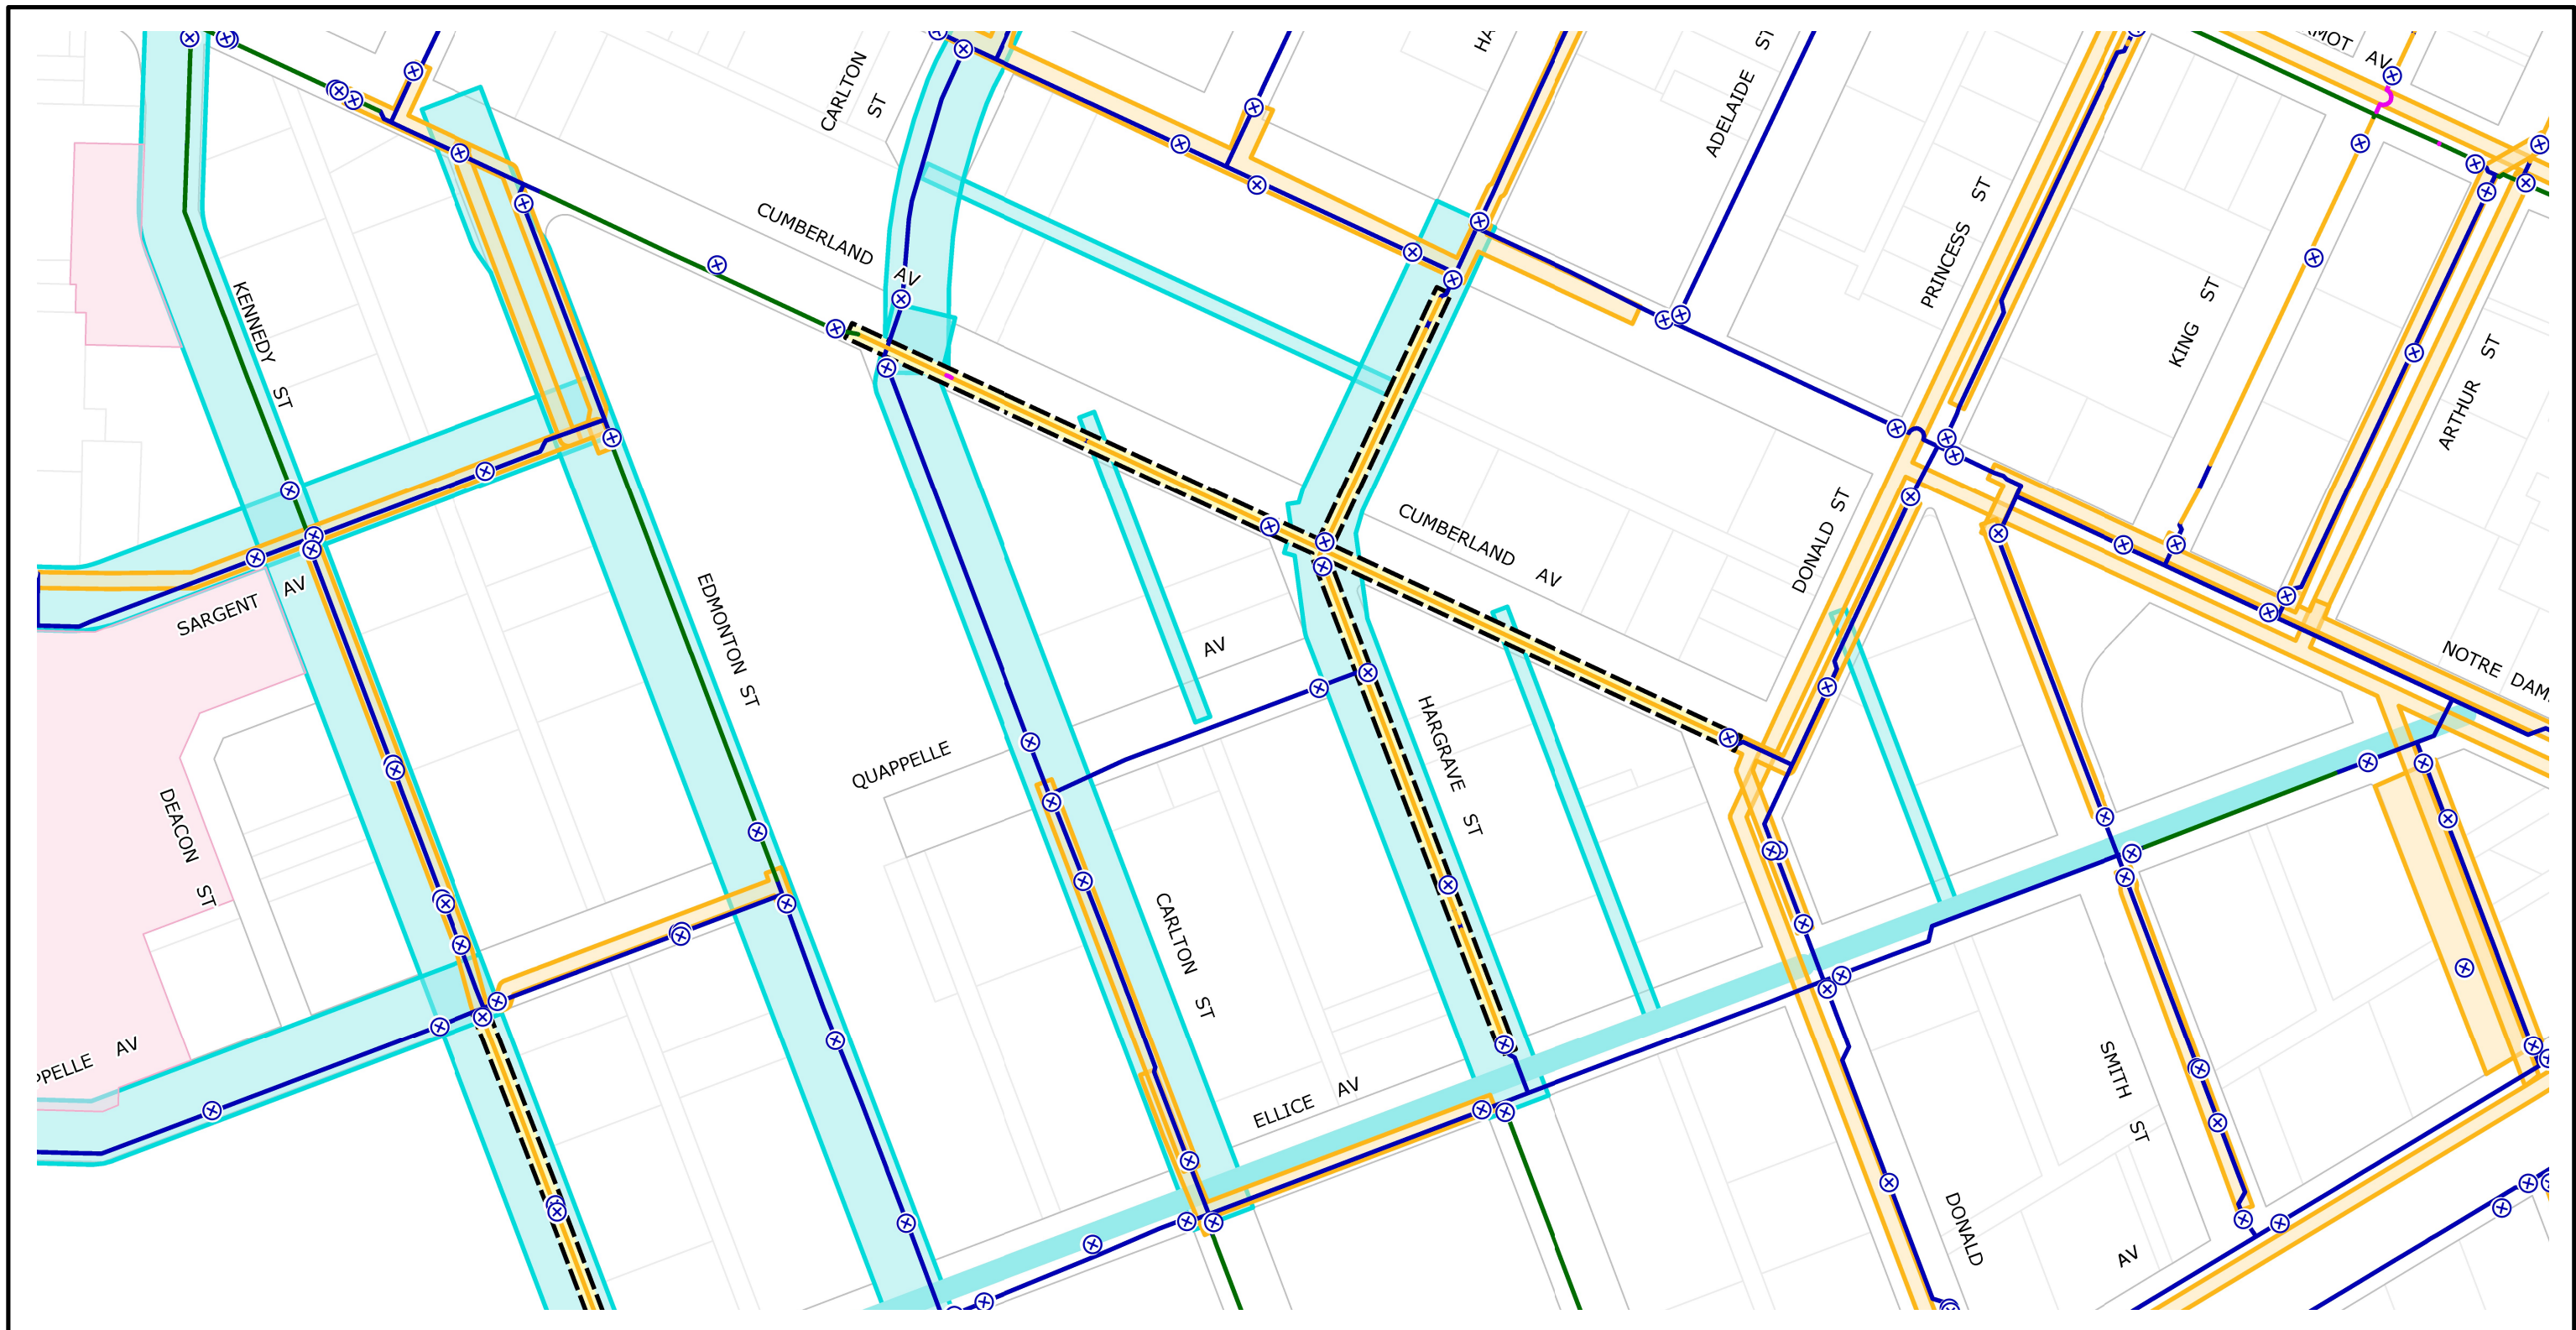


| | | | |
|---------------------|------------------------|------------|-------------------------|
| CI WM | REPAIR 5-15YRS-ABANDON | AQUEDUCT | HISTORICAL PROJECT |
| PVC WM | REPAIR >15YRS | MANHOLE | SCHOOL |
| AC WM | REPAIR >15YRS-ABANDON | SEWERS | PWD PROJECT |
| UNKNOWN WM | VALVE | RAILWAY | SEWER RELIEF WORK |
| REPAIR <5YR | HYDRANT | WM RENEWAL | CATHODIC PROTECTION |
| REPAIR <5YR-ABANDON | HYDRANT BRANCH | WM NEW | FIRE PROTECTION UPGRADE |
| REPAIR 5-15YRS | FEEDER MAIN | WM ABANDON | |

Additional Notes:
 -300mm on Cumberland
 -200mm on Hargrave

Printed: 9/19/2023

CITY OF WINNIPEG WATER AND WASTE DEPARTMENT 2024 WATER MAIN RENEWAL PROGRAM

| | |
|--|------------------------------------|
| Location ID: 27 | Street: HARGRAVE ST/CUMBERLAND AVE |
| Location Description: NOTRE DAME AVE TO ELLICE AVE/ CARLTON ST TO DONALD ST | |
| Scale: 1:2000 | Renewal Type: PWD-REGIONAL |

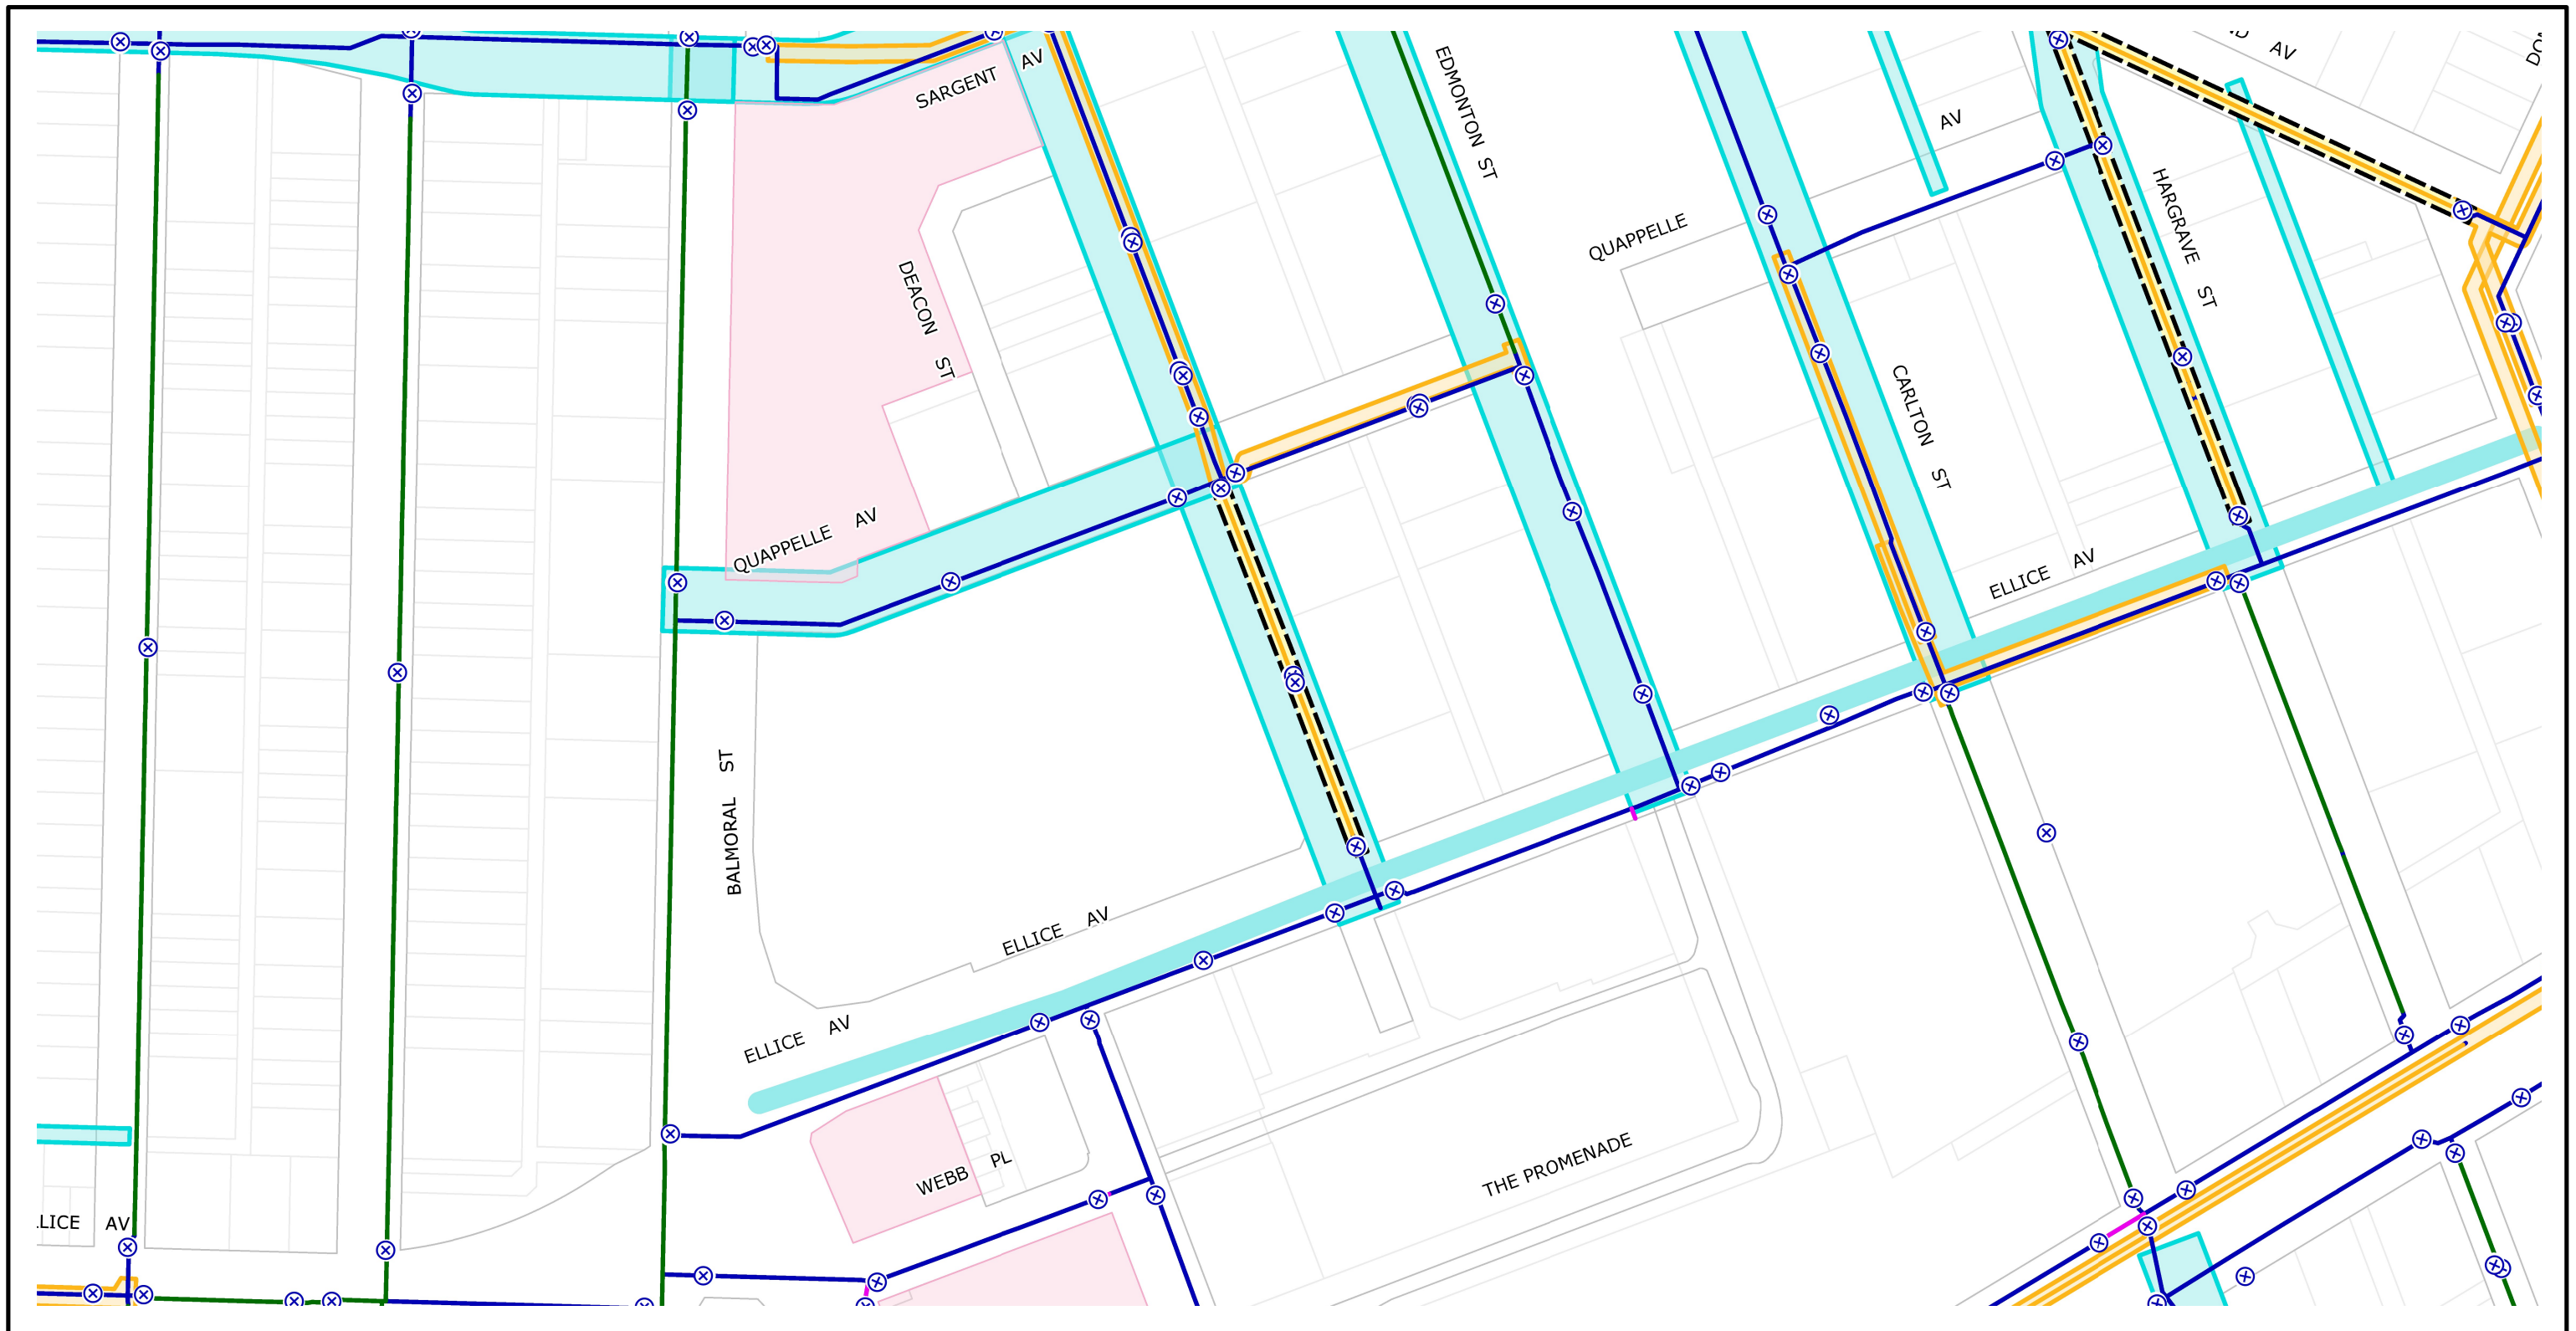

| | | | |
|---------------------|------------------------|------------|-------------------------|
| CI WM | REPAIR 5-15YRS-ABANDON | AQUEDUCT | HISTORICAL PROJECT |
| PVC WM | REPAIR >15YRS | MANHOLE | SCHOOL |
| AC WM | REPAIR >15YRS-ABANDON | SEWERS | PWD PROJECT |
| UNKNOWN WM | VALVE | RAILWAY | SEWER RELIEF WORK |
| REPAIR <5YR | HYDRANT | WM RENEWAL | CATHODIC PROTECTION |
| REPAIR <5YR-ABANDON | HYDRANT BRANCH | WM NEW | FIRE PROTECTION UPGRADE |
| REPAIR 5-15YRS | FEEDER MAIN | WM ABANDON | |

Additional Notes:
 -200mm is actually ok here. upsizing is not necessary
 -Close proximity to Sister MacNamara School

Printed: 9/19/2023

**CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 2024 WATER MAIN RENEWAL PROGRAM**

Location ID: 29 Street: KENNEDY ST

Location Description: ELLICE AVE TO QU'APPELLE AVE

Scale: 1:2000 Renewal Type: PWD-REGIONAL