
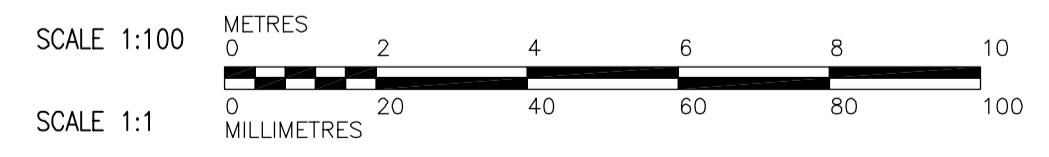


- NOTES:**
- CONSTANT VOLUME VENTURI VALVE BY E.H. PRICE, MODEL MA-CV SIZE 200. ADJUST FOR 118 L/S
  - PROVIDE FIRE DAMPER AT ALL DUCT PENETRATION THRU FLOOR. LOUVERS BY OTHERS
  - PROVIDE DRIP LEG ON GAS PIPES AS REQUIRED BY APPLICABLE GAS CODE.

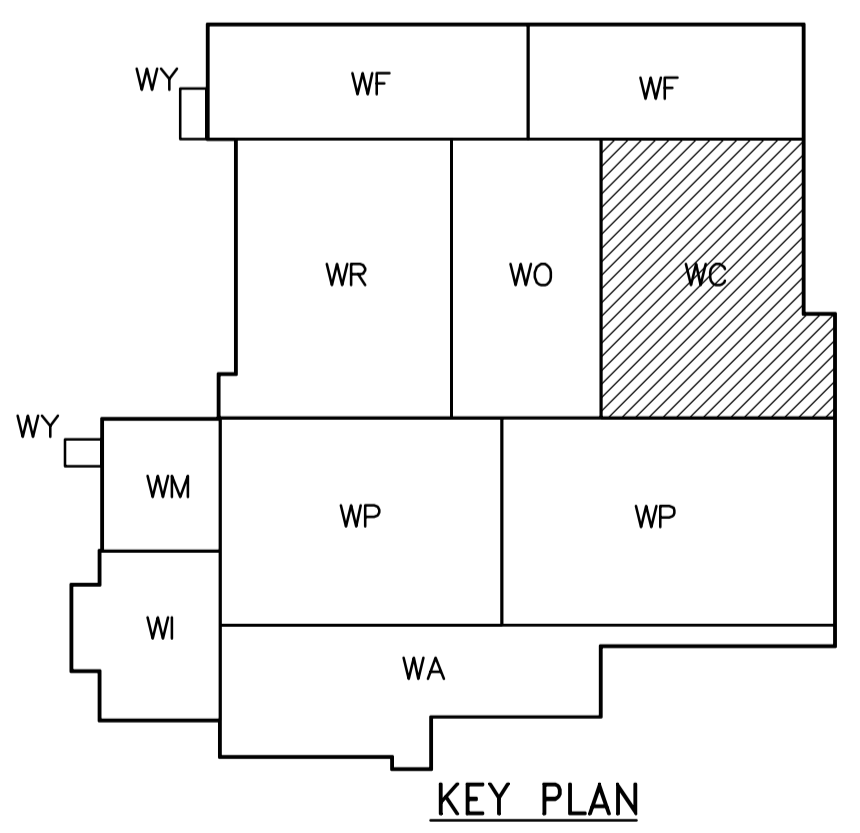

**THIRD FLOOR PLAN**  
1:100

**APEGN**  
Certificate of Authorization  
CH2M HILL Canada Ltd.  
No. 1441 Expiry: April 30, 2007

NO.	REVISIONS	DATE	BY
02	742-2005 ADDENDUM 6	06/05/26	TT
01	742-2005 ADDENDUM 5	06/05/19	TT
00	ISSUED FOR TENDER	06/03/29	SW

DESIGNED BY	TT	CHECKED BY	DL
DRAWN BY	AM	APPROVED BY	AHL
SCALE:	1:100	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2005/07/04	DATE	2006/03/29

ENGINEER'S SEAL  
ORIGINAL SIGNED BY  
D.K. CUDDINGTON  
2006/03/29  
CONSULTANT DRAWING NO.  
WC-H0131

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT  
ENGINEERING DIVISION

WATER TREATMENT PLANT  
CHEMICAL FEED SYSTEMS  
MECHANICAL AND ELECTRICAL

HVAC  
CHEMICAL AREA  
THIRD FLOOR PLAN

CITY FILE NUMBER  
SHEET OF  
CITY DRAWING NUMBER  
1-0601C-A-H0131-001-020