


File Name: P:\Projects\2006\06-0107-08\Elect\Draws\06-0107-08E04R2.dwg - Tab: E4 Plotted By: B.Boige 11/21/2006 [Tue 2:15pm]
 24"x36" PLOT SCALE: 1"=1'

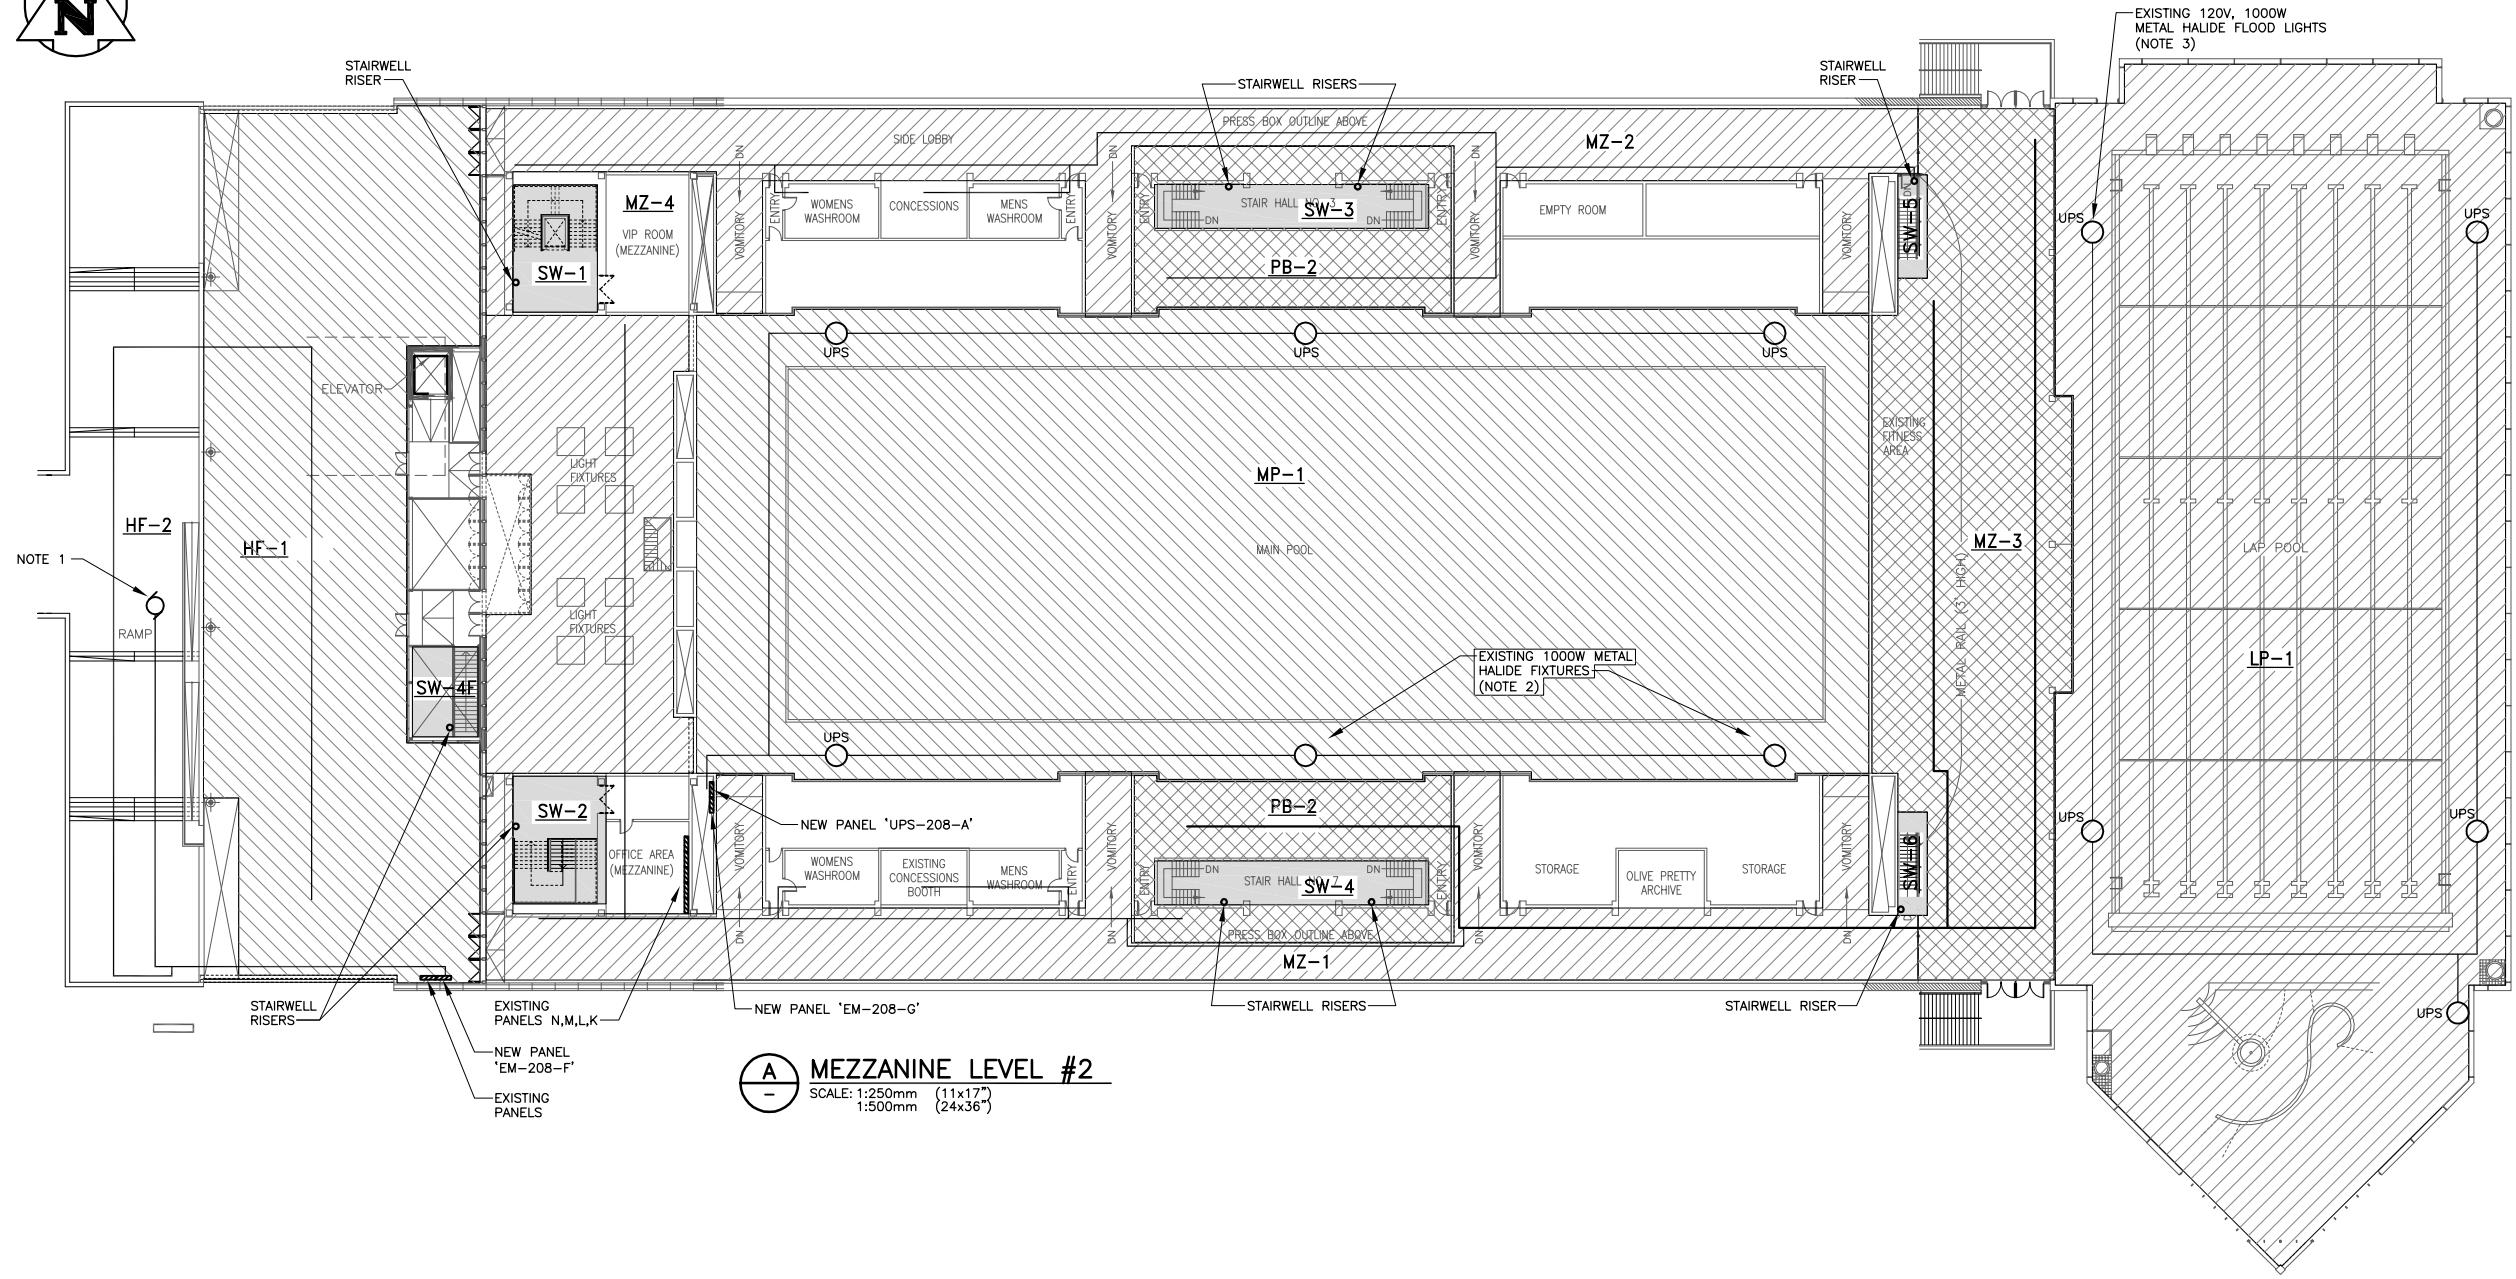

(A) MEZZANINE LEVEL #2
 SCALE: 1:250mm (11x17")
 1:500mm (24x36")

- NOTES:**
1. PROVIDE NEW 15A CIRCUIT FOR EXISTING LIFT, PANEL EM-208-F.
 2. EXISTING 1000W, 208V METAL HALIDE FIXTURES. PROVIDE 208V CIRCUITS FROM NEW UPS PANEL UPS-208-A. BALLASTS ARE REMOVED ONTO CATWALK NEAR FIXTURES. MARK ALL EMERGENCY FIXTURES WITH RED LAMACOIDS TO BE VISIBLE FROM POOL DECK LEVEL.
 3. EXISTING 1000W METAL HALIDE FLOOD LIGHTS. PROVIDE ONE CIRCUIT EACH FOR NINE FIXTURES SHOWN FROM NEW PANEL UPS-208-B. MARK ALL EMERGENCY FIXTURES WITH RED LAMACOIDS TO BE VISIBLE FROM POOL DECK LEVEL.

NO.	D / M / Y	DESCRIPTION	BY
2	22/11/06	ISSUED FOR ADDENDUM #2	
1	15/11/06	ISSUED FOR ADDENDUM	
0	23/10/06	ISSUED FOR TENDER	

REVISIONS / ISSUE

A. SECTION LETTER OR DETAIL NUMBER
 B. DRAWING WHERE SECTION OR DETAIL IS DRAWN
 OR
 DRAWING WHERE SECTION OR DETAIL WAS INDICATED
 - SECTION OR DETAIL SHOWN ON SAME DRAWING

KGS GROUP CONSULTING ENGINEERS & PROJECT MANAGERS
 WINNIPEG (204) 896-1209
 THUNDER BAY (807) 345-2233

CLIENT: CITY OF WINNIPEG
 PUBLIC WORKS DEPARTMENT


PROJECT: INSTALLATION OF EMERGENCY GENERATOR AT PAN-AM POOL - 25 POSEIDON BAY TENDER No. 663-2006

DWG. DESCRIPTION: ELECTRICAL MEZZANINE LEVEL #2

ENG. STAMP	DESIGNED: BY: AP	DRAWN: BY: GCN
	APPROVED: CHECKED:	CHECKED:
	SCALE: AS NOTED	DATE: OCT/2006

CLIENT DWG. NO.: 06-0107-08
 REV: 2
 PROJECT NO.: 663-P-E04

AREA No.	DESCRIPTION	FIXTURES / CIRCUITS	EM PANEL	NO. OF CIRCUITS
HF-1	HALL OF FAME	4 EMERGENCY FIXTURES / 4 HID FIXTURES	EM-208-F	2
LP-1	LAP POOL	5 FIXTURES (UPS)	UPS-208-B	5
PB-1	SOUTH PRESS BOX	2 FIXTURES	EM-208-G	1
PB-2	NORTH PRESS BOX	2 FIXTURES	EM-208-G	1
MZ-1	MEZZANINE LEVEL 2 - SOUTH SIDE LOBBY	12 TO 15 FIXTURES	EM-208-G	3
MZ-2	MEZZANINE LEVEL 2 - NORTH SIDE LOBBY	12 TO 15 FIXTURES	EM-208-G	3
MZ-3	MEZZANINE LEVEL 2 - FITNESS AREA	10 TO 12 FIXTURES	EM-208-G	3
MZ-4	STAIRWELL No.n (VIP)		EM-208-G	
MP-1	MAIN POOL AREA	3 HID PER SIDE	UPS-208-A	6 (208V)
SW-1	STAIRWELL No.1 (NORTHWEST)	MINIMUM ONE FIXTURE PER LANDING (ALL FIXTURES PERMITTED)	EM-208-G	1
SW-2	STAIRWELL No.2 (SOUTHWEST)	MINIMUM ONE FIXTURE PER LANDING (ALL FIXTURES PERMITTED)	EM-208-G	1
SW-3	STAIRWELL No.3 (NORTH CENTRAL)	MINIMUM 3 FIXTURES PER LANDING (ALL FIXTURES PERMITTED)	EM-208-G	1
SW-4	STAIRWELL No.4 (SOUTH CENTRAL)	MINIMUM ONE FIXTURE PER LANDING (ALL FIXTURES PERMITTED)	EM-208-G	1
SW-5	STAIRWELL No.5 (NORTHEAST)	MINIMUM ONE FIXTURE PER LANDING (ALL FIXTURES PERMITTED)	EM-208-G	1
SW-6	STAIRWELL No.6 (SOUTHEAST)	ALL FIXTURES	EM-208-G	1
HF-2	HALL OF FAME GENERAL AREA	ELEVATOR AND HF-1	EM-208-F	1



APEGM
 Certificate of Authorization
 KGS Group
 No. 245 Expiry: April 30, 2007