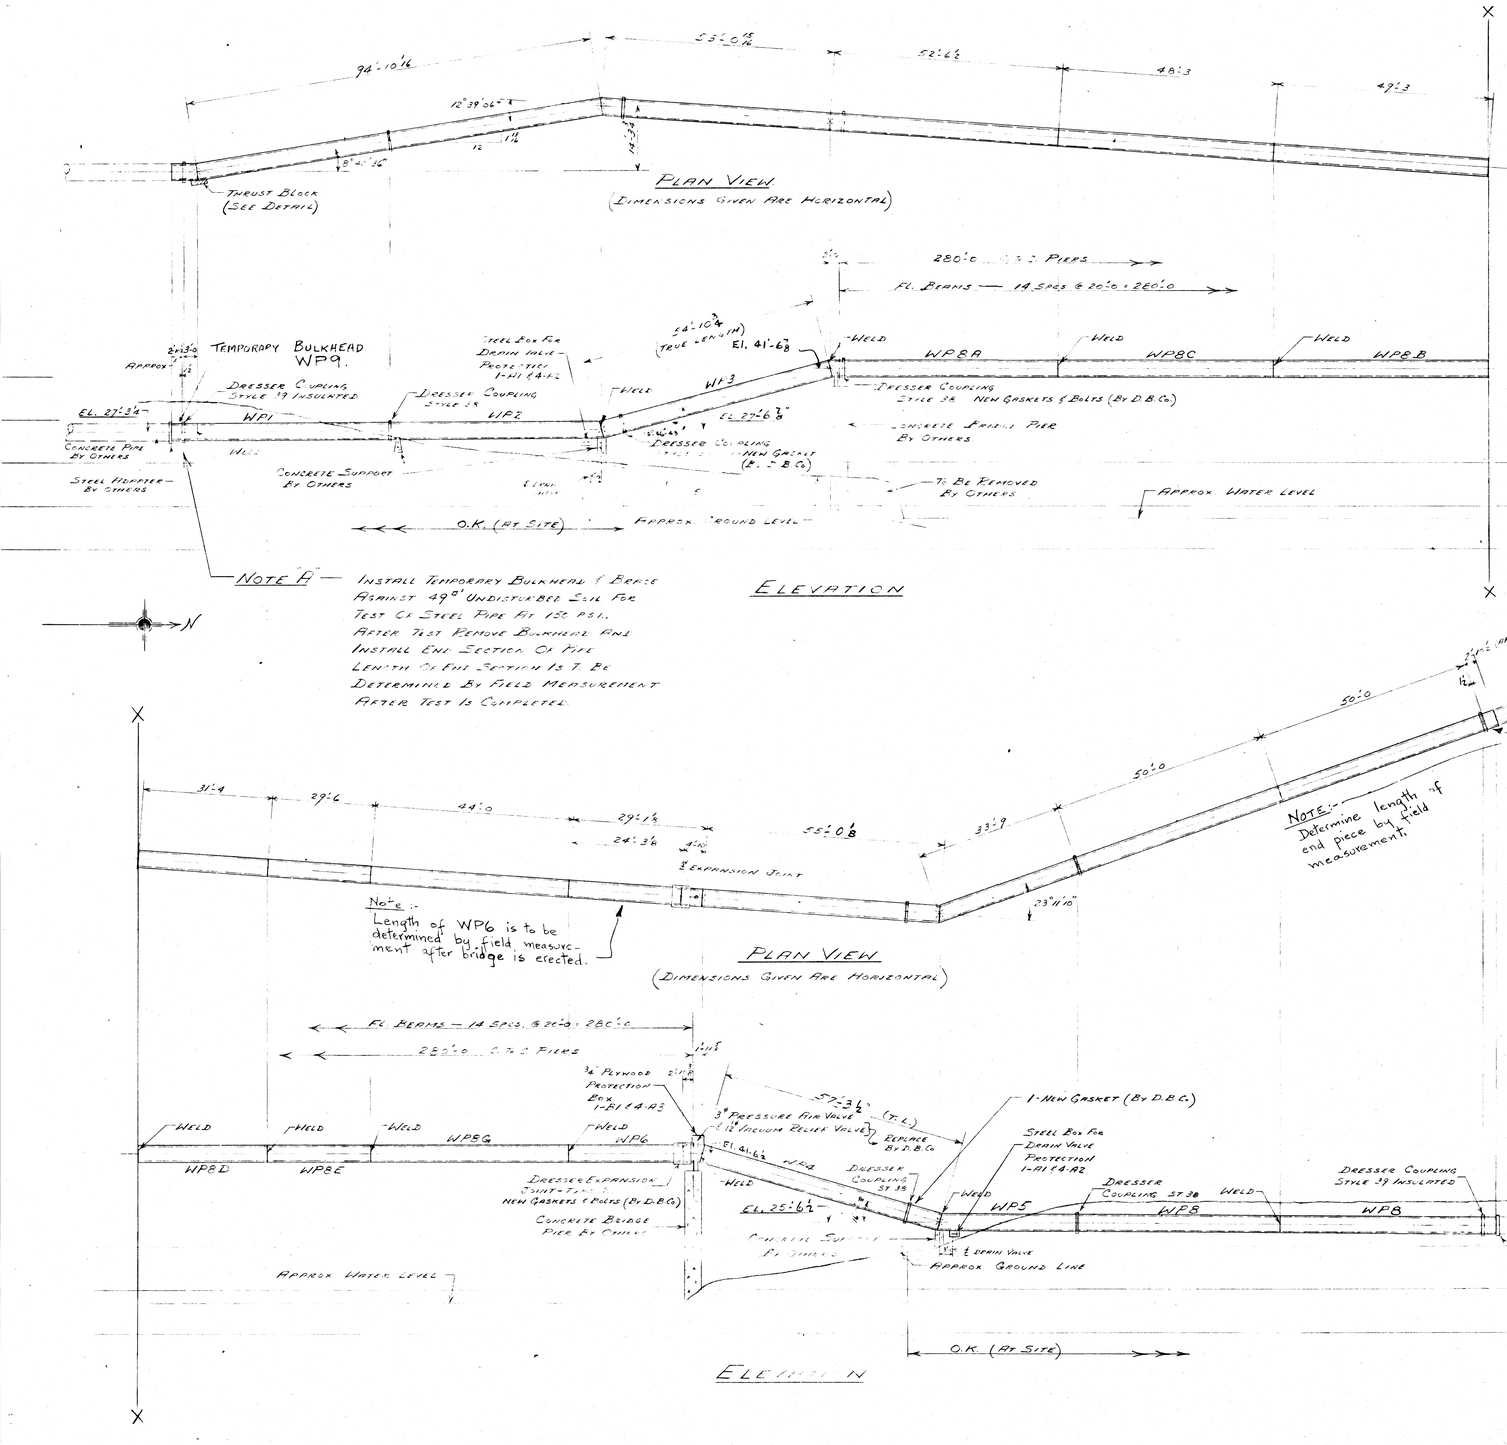

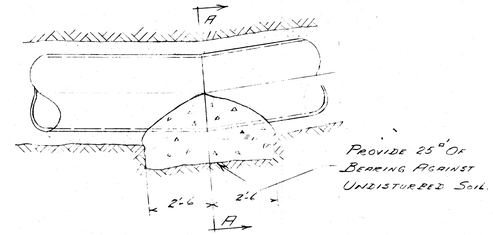

Detail Of Thrust Block



Section "A-A"



Typical Detail For Field Splice Weld

Note "B" - Weld for unfired pressure vessel under test pressure of 150 lb/sq.in.

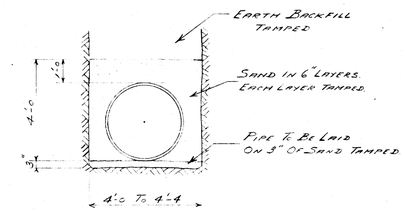

Typical Trench Backfill

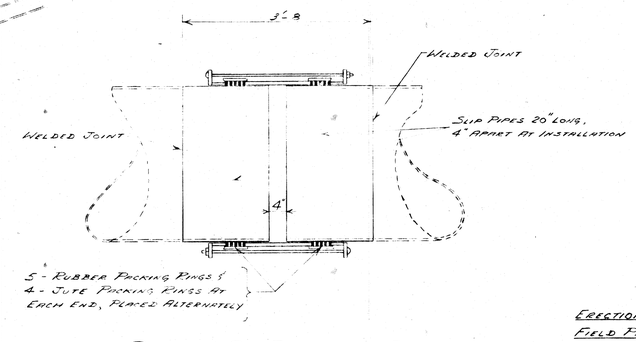

Detail At Expansion Joint

General Notes

Erection — By D.B.Co Ltd.

Field Paint — All Damaged Areas Of Pipe Covering To Be Wire Brushed And Apply One Coat Of Koppers "50 Tar.

Interior Of Pipe At Welds And At Scratched Areas Is To Be Wire Brushed, Then One Coat Of Koppers Tank Solution Applied By Brush.

M.B.E. Ltd. Cont. - M541A

BC4505-25

Ref. — D.B.Co Dwg E1 - Bridge Diagram
Ref. — Templeton Engineering Co. Dwgs. W-9-38, W-17-38 & W-18-38

25

City Of Winnipeg
Aubrey Street Water Crossing, Wpg, Man.
36 Inch Water Pipe

C	Revisions for reconditioned pipe.	HMJ	June 5.58
B	Drain Valves Located & Protection Boxes Added	JCK	Sept. 4/57
A	General Revisions for approval	HMJ	Sept. 10
	Revisions	By	Date

JCK May 30 '57 HMJ July 2. 57

W6217 XI E2-C

Squad Inc.