



SNC • LAVALIN

MacLean Pumping Station Electrical Upgrades

Bid Opportunity 490-2012


References Pictures



Existing Ductwork Below Electrical Room
North-West Corner of Mezzanine Level



Cabling and Cable Tray Below 5kV Switchgear

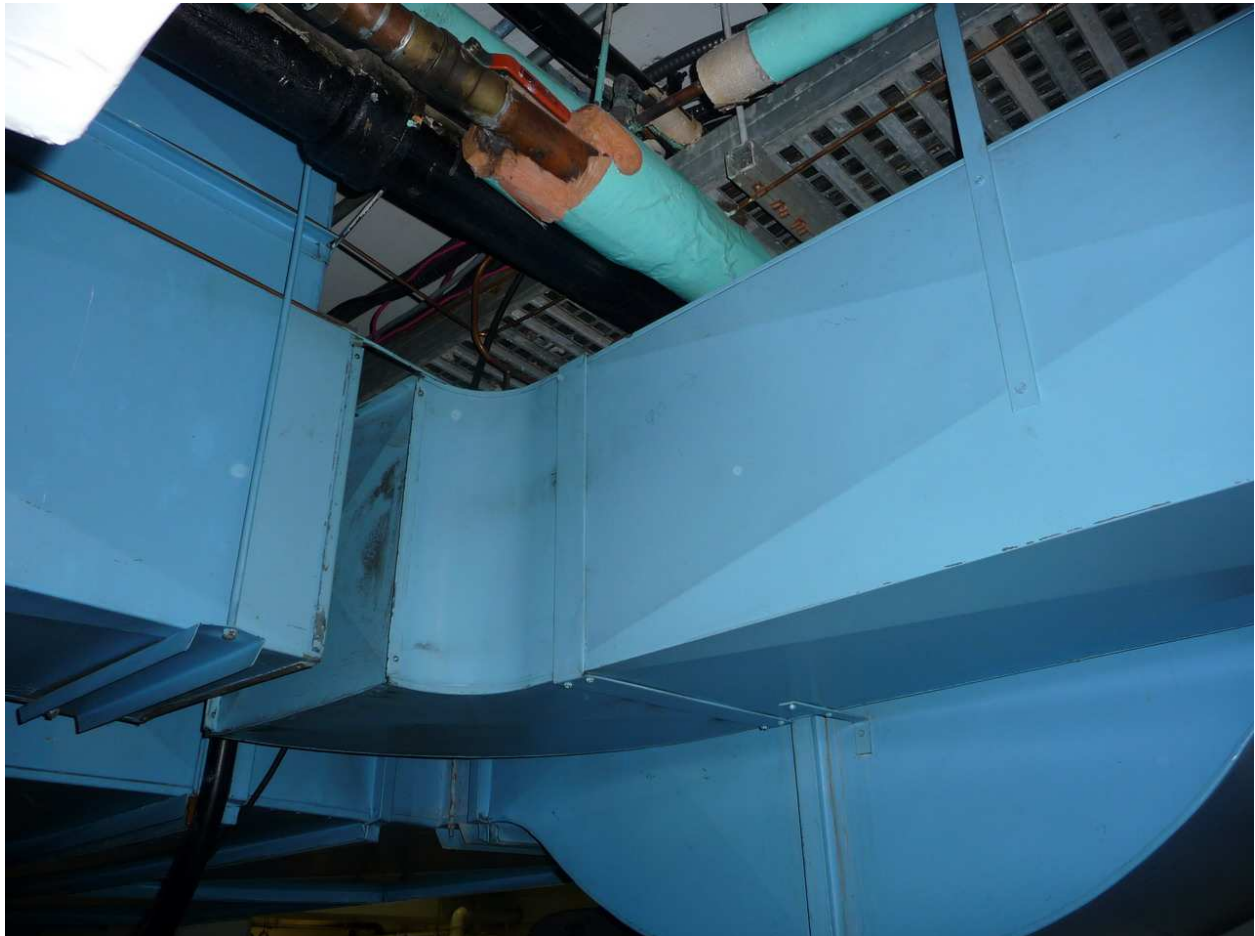

Entry point of conduits routed to roof
Note: the conduits are obscured by piping in this picture



Reservoir Valve House Pullbox
Located at south end of the pumping station on the Mezzanine Level



Reservoir Valve House – Incoming Feeder Cables