




SECOND FLOOR PLAN - HVAC M1 / SCALE: 1:100

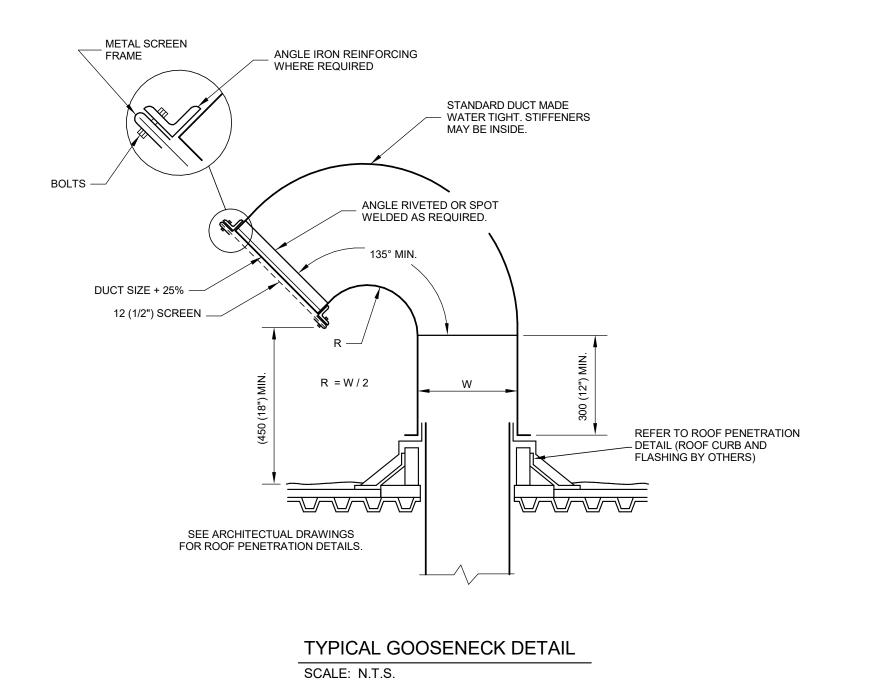

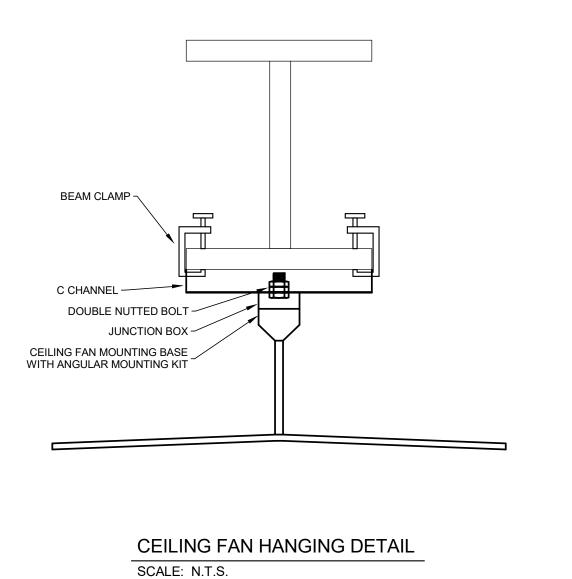

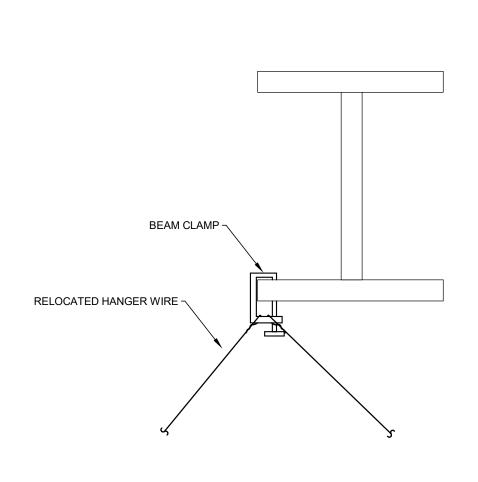


HANGER WIRE RELOCATION DETAIL SCALE: N.T.S.

HVAC GENERAL NOTES



- DUCT TRANSITIONS MAY NOT BE SHOWN IN DETAIL ON PLAN. REFER TO SMACNA -HVAC DUCT CONSTRUCTION STANDARDS FOR REQUIRED DUCT TRANSITIONS AND
- DUCTS LOCATED ABOVE ROOF LEVEL SHALL BE BRACED ON THE METAL ROOF AGAINST SNOW SLIP DAMAGE.
 DUCT INSULATION MATERIALS SHALL MEET SMOKE AND FLAME SPREAD
- REQUIREMENTS FOR PLENUM INSULATION. DUCT INSULATION SHALL FOLLOW THE SPECIFIED SIZE AS A MINIMUM
- REQUIREMENT. THESE REQUIREMENTS SHALL APPLY REGARDLESS OF WHETHER OR NOT DUCT INSULATION IS SHOWN ON THE DRAWINGS. THE INTERRUPTION OF ANY SERVICES SHALL BE COORDINATED WITH THE BUILDING
- THE INTERRUPTION OF ANY SERVICES SHALL BE COURDINATED WITH THE BUILDING END USER AND SHALL BE KEPT TO A MINIMUM.

 DUCT TRANSITIONS MAY NOT BE SHOWN IN DETAIL ON PLAN. REFER TO SMACNA HVAC DUCT CONSTRUCTION STANDARDS FOR REQUIRED DUCT TRANSITIONS AND FITTINGS.

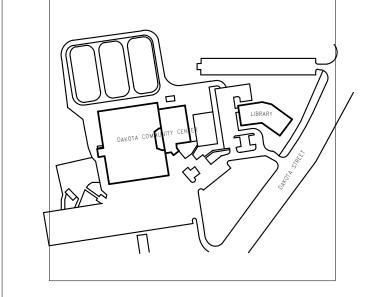

KEY PLAN/DRAWING NOTES


KEY NOTES


ALUMINUM DUCT TAPE.

- REPAIR DUCT SEAM, RE-FASTEN DUCT PAN TO RECTANGULAR DUCT. SEAL DUCT FULL PERIMETER WITH DURODYNE DUCT SEALANT.
- PROVIDE NEW BACKDRAFT DAMPER IN DUCT AT ROOF PENETRATION. REMOVE DUCT INSULATION FROM FAN DISCHARGE TO ROOF PENETRATION AND REPLACE WITH NEW 50 MM FOIL FACED FIBERGLASS INSULATION. RESEAL ALL DUCT JOINTS WITH DURODYNE DUCT SEALANT BEFORE INSULATING. VAPOUR SEAL JOINTS AND EDGES WITH
- REPLACE DUCT TERMINATION ABOVE ROOF FROM UNDERSIDE OF ROOF. TERMINATE WITH NEW GOOSENECK AND PROVIDE NEW BRACING. REPLACE DUCT PENETRATION SEAL AT ROOF. REFER TO DETAILS.
- NEW CEILING FAN LOCATED IN CEILING SPACE, ATTACH TO UNDERSIDE OF BUILDING BEAM. 900MM (36") CEILING FAN, 7000 CFM CAPACITY, 80 WATTS. PROVIDE WITH SINGLE DISCONNECT IN CEILING SPACE ON NEAREST WALL, 300 MM ABOVE CEILING TILE, LABEL SWITCH. WIRE FAN FOR DOWNDRAFT AIRFLOW. LOCATE FAN TO BEST SUITABLE LOCATION

ALONG BEAM. CEILING GRID WIRE INTERFERES WITH INSTALLATION, RELOCATE WIRE

ATTACHMENTS, REFER TO DETAIL. PANEL NA 225A 120/208V 3PH 4W 42 CCT CUTLER HAMMER QL442225 LOCATED ON SECOND FLOOR MECHANICAL ROOM 220. WIRE 2C #10 TECK CABLE. REPLACE AN EXISTING 15A/1P FULL SIZED BREAKER WITH A DUAL 15A/1P MINI BREAKER.



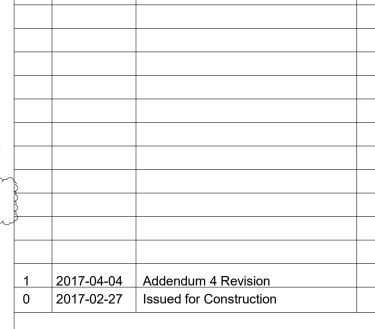









CONSULTING STRUCTURAL ENGINEERS

DAKOTA COMMUNITY CENTRE

BUILDING ENVELOPE UPGRADES 1188 DAKOTA STREET WINNIPEG, MANITOBA

SECOND FLOOR PARTIAL PLAN - HVAC

	Revision	Sheet No.	M1
	Design DR		Drawn DR
	File 17039		Date 2016-08-16
L			

HVAC LEGEND

TIVAO ELOLIND		
	SUPPLY AIR/OUTSIDE AIR DUCT RISER	
	RETURN AIR/EXHAUST AIR DUCT RISER	
	THERMAL INSULATION	
?	KEY NOTE	