


**GENERAL NOTES:**

- A. FAN COIL UNITS TO BE PIPED AS PER HORIZONTAL UNIT HEATER. REFER TO SPECIFICATION DETAILS.
- B. CONTROL VALVES, ISOLATION VALVES AND FLOW CONTROL DEVICES SERVING MAIN FLOOR WALL FIN ARE LOCATED IN THE CRAWLSPACE.
- C. RUNOUTS TO RADIATION AND TERMINAL DEVICES ARE 3" (75 MM) UNLESS NOTED OTHERWISE.

**DRAWING NOTES:**

- 1. 250X250 TRANSFER OPENING.
- 2. HEATING SUPPLY AND RETURN PIPING UP TO EXISTING BOILER ROOM.
- 3. HEATING PIPING (HOT WATER, GLYCOL) UP TO MAIN FLOOR CEILING SPACE TO SERVE THE RENOVATED GARAGE AREA.
- 4. FAN COIL UNIT SERVING VESTIBULE ON MAIN FLOOR.
- 5. OPEN ENDED DUCTS TYPICAL BALANCE TO AIRFLOW INDICATED.
- 6. FAN COIL UNIT SUSPENDED FROM STRUCTURE C/W SPRING ISOLATORS.
- 7. FLEXIBLE DUCT CONNECTION.
- 8. REFER TO DRAWING M2.5 FOR LAYOUT.
- 9. GLYCOL SUPPLY AND RETURN PIPING DOWN FROM NEW BOILER ROOM.
- 10. INTERCONNECTING PIPING FROM NEW HEATING PLANT TO EXISTING PLANT. REFER TO SCHEMATIC.

FOR CONTINUATION, REFER TO DRAWING M2.1

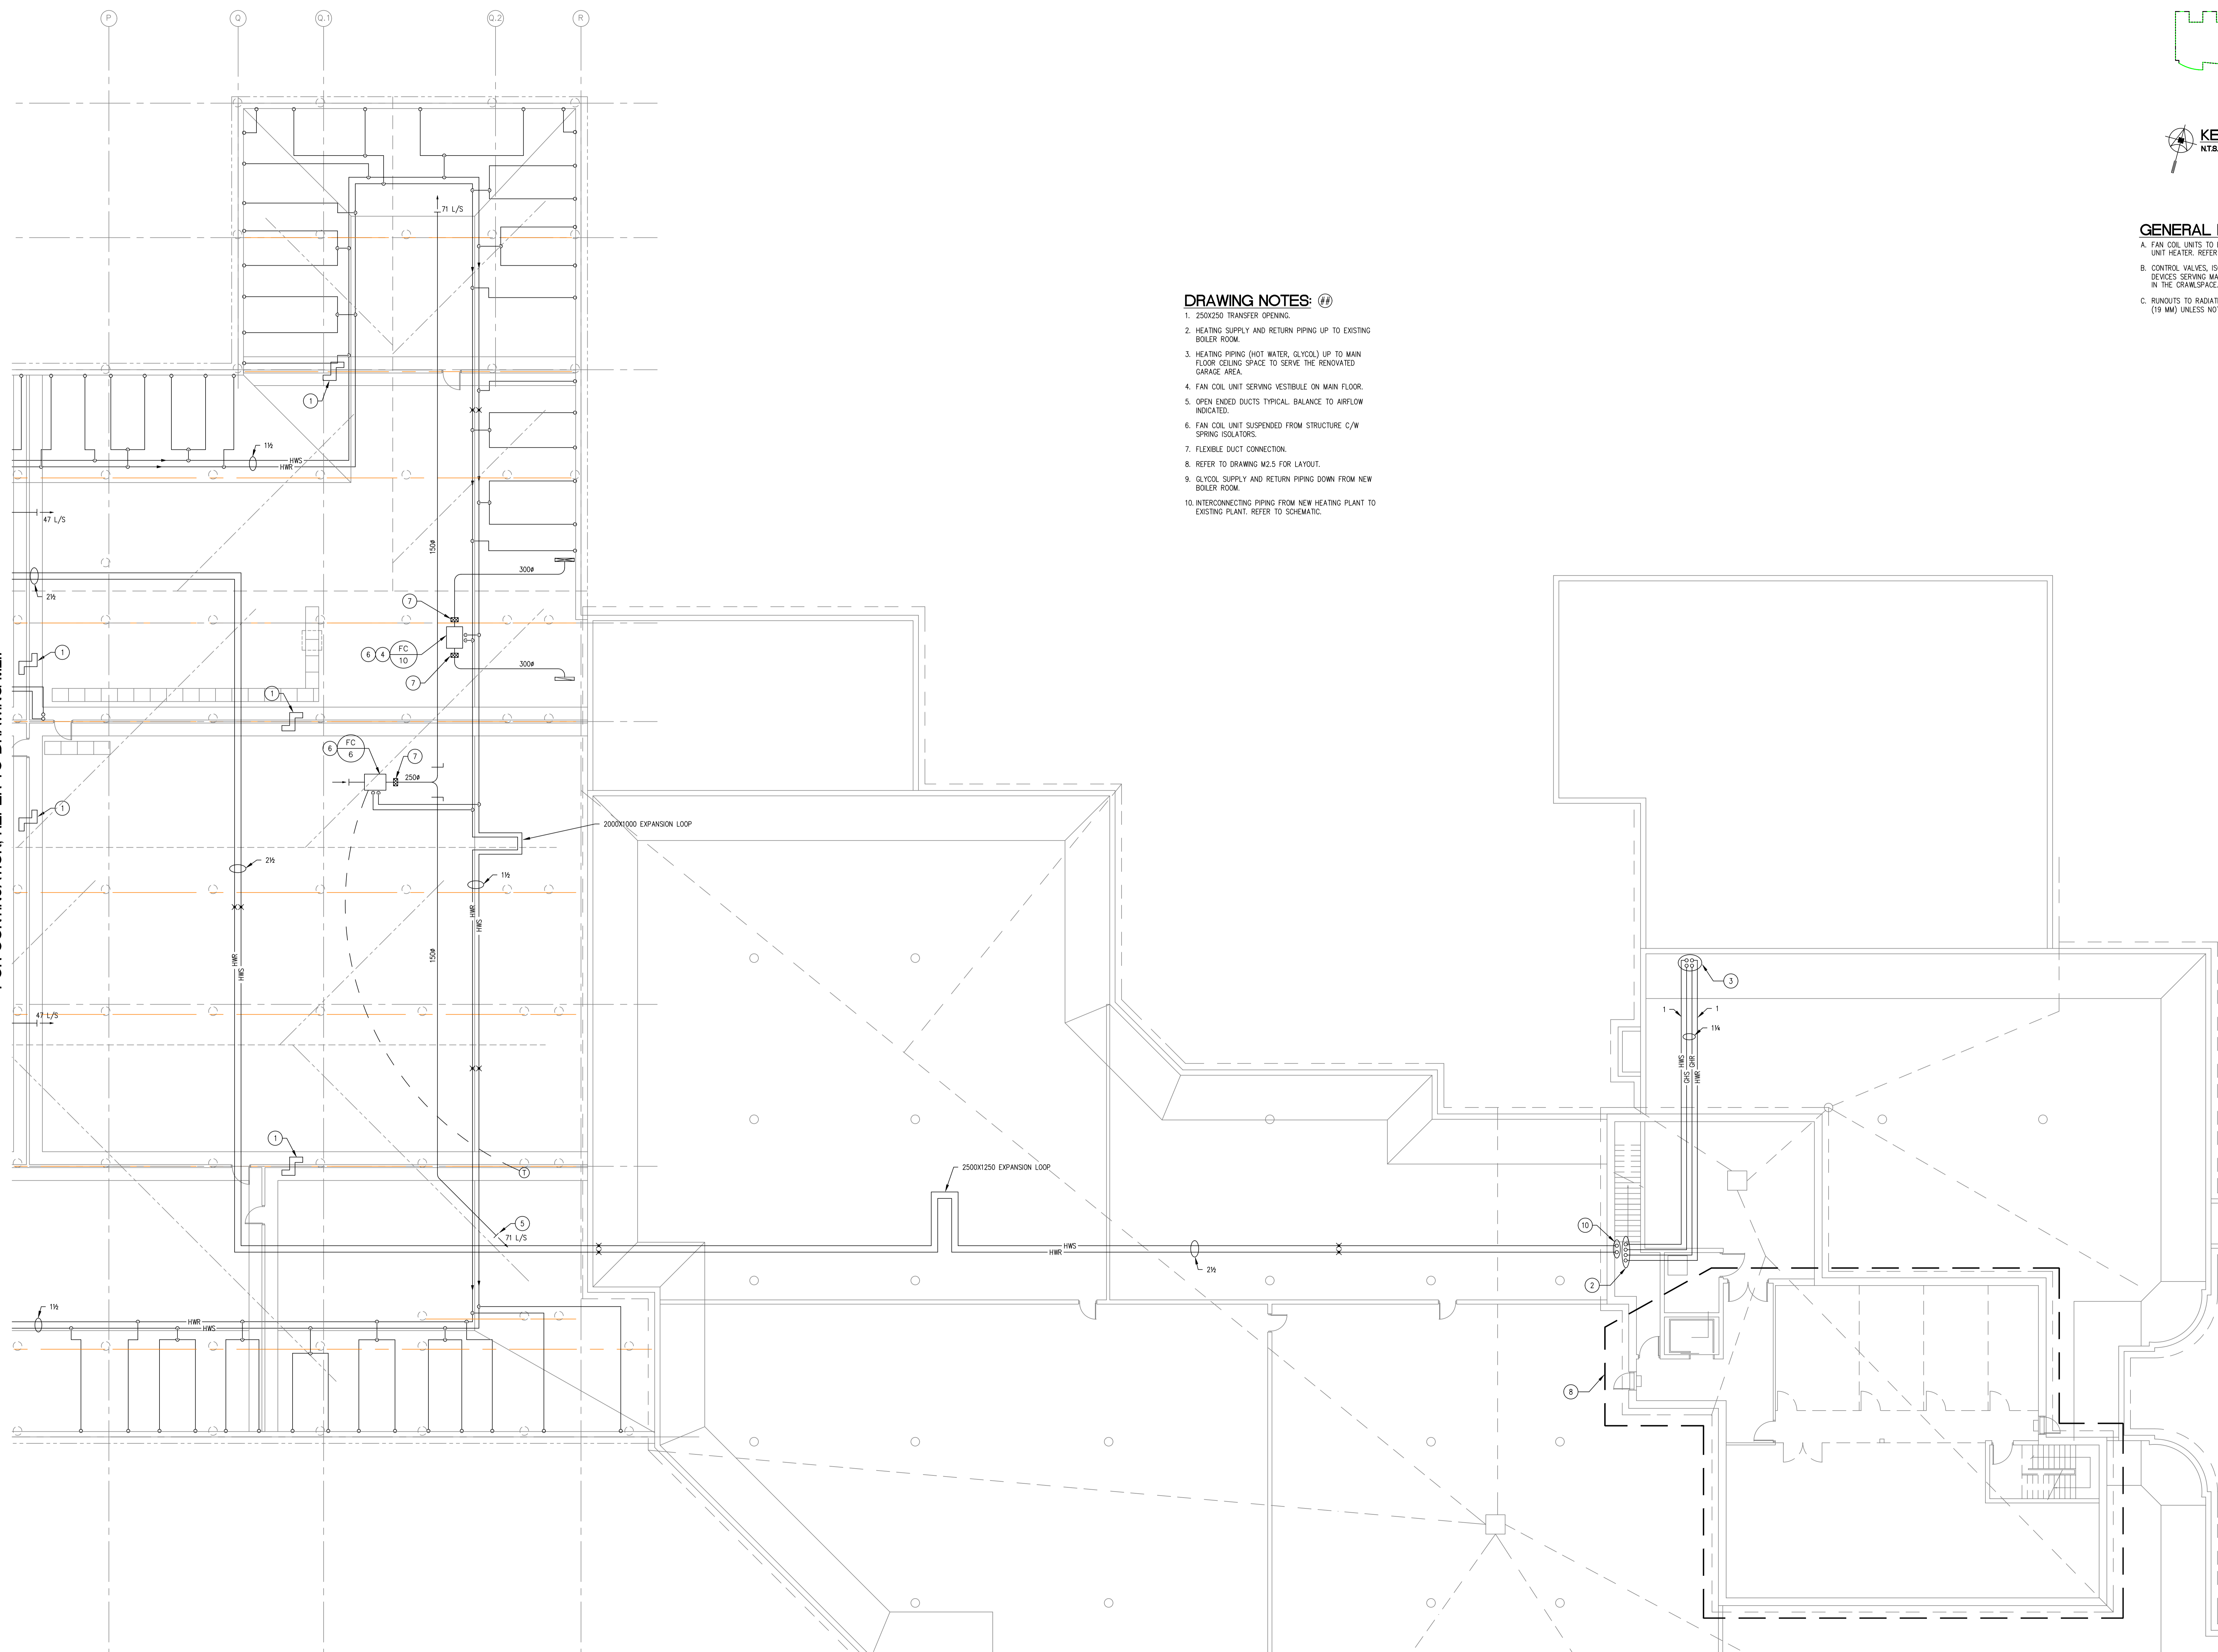

CRAWLSPACE PLAN - PART B  
SCALE 1:100

Friesen Tokar Architects  
200 - 2033 Portage Avenue  
Winnipeg, Canada R3J 0K8  
Tel. 204.888.9323  
Fax. 204.837.7235

DRAWN BY: JC  
CHECKED BY: HW  
DATE: MAY 2004  
PROJECT NO.: 01216

ISSUED FOR 50% REVIEW  
FEBRUARY 6, 2004  
ISSUED FOR 75% REVIEW  
MARCH 5, 2004  
ISSUED FOR PRETENDER REVIEW  
APRIL 2004  
ISSUED FOR TENDER  
MAY 14, 2004

**SMS ENGINEERING**  
SMS Engineering Ltd. Consulting Engineers  
710 Bannock Street Winnipeg, MB Canada R3B 0Y3  
Telephone 204.772.0101 Fax 204.772.0100  
smseng.com

ORIGINAL  
CONTRACT DRAWING  
ISSUED AND RELEASED BY  
V.B. WALKER, P. ENG  
MAY 14, 2004

**APCM**  
Certificate of Authorization  
SMS Engineering Ltd.  
No. 1958 Expiry: April 30, 2005

Drawings and specifications, as  
instruments of service are the  
property of the architect, the  
copyright in the same being  
reserved to him. No reproduction  
may be made without the  
permission of the architect and  
where made, must bear his name.  
All prints to be returned to the  
architect.  
The contractor shall verify  
dimensions and data noted herein  
with conditions on the site and is  
held responsible for reporting any  
discrepancy to the architect for  
adjustment.  
This drawing shall not be used for  
bidding purposes and  
countersigned by:

THE  
CITY OF  
WINNIPEG

OFFICE ADDITION AND RENOVATION  
1155 PACIFIC AVENUE  
WINNIPEG, MANITOBA

**FRIESEN TOKAR ARCHITECTS**

CRAWLSPACE PLAN - PART B  
H.V.A.C.

**M2.2**