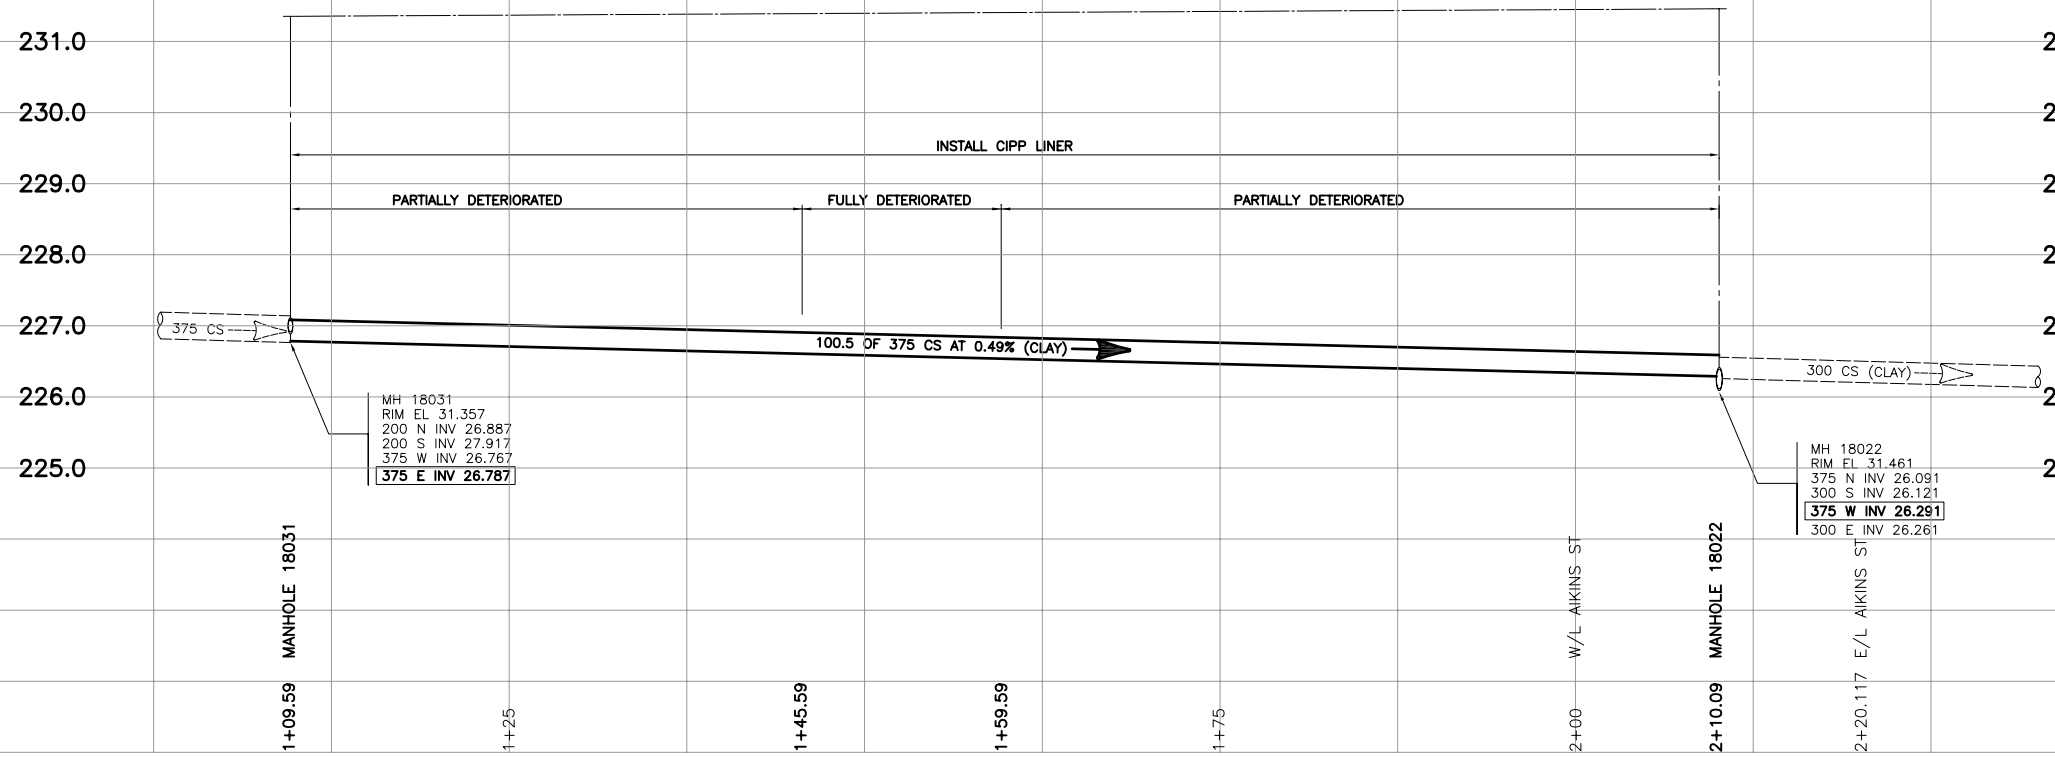

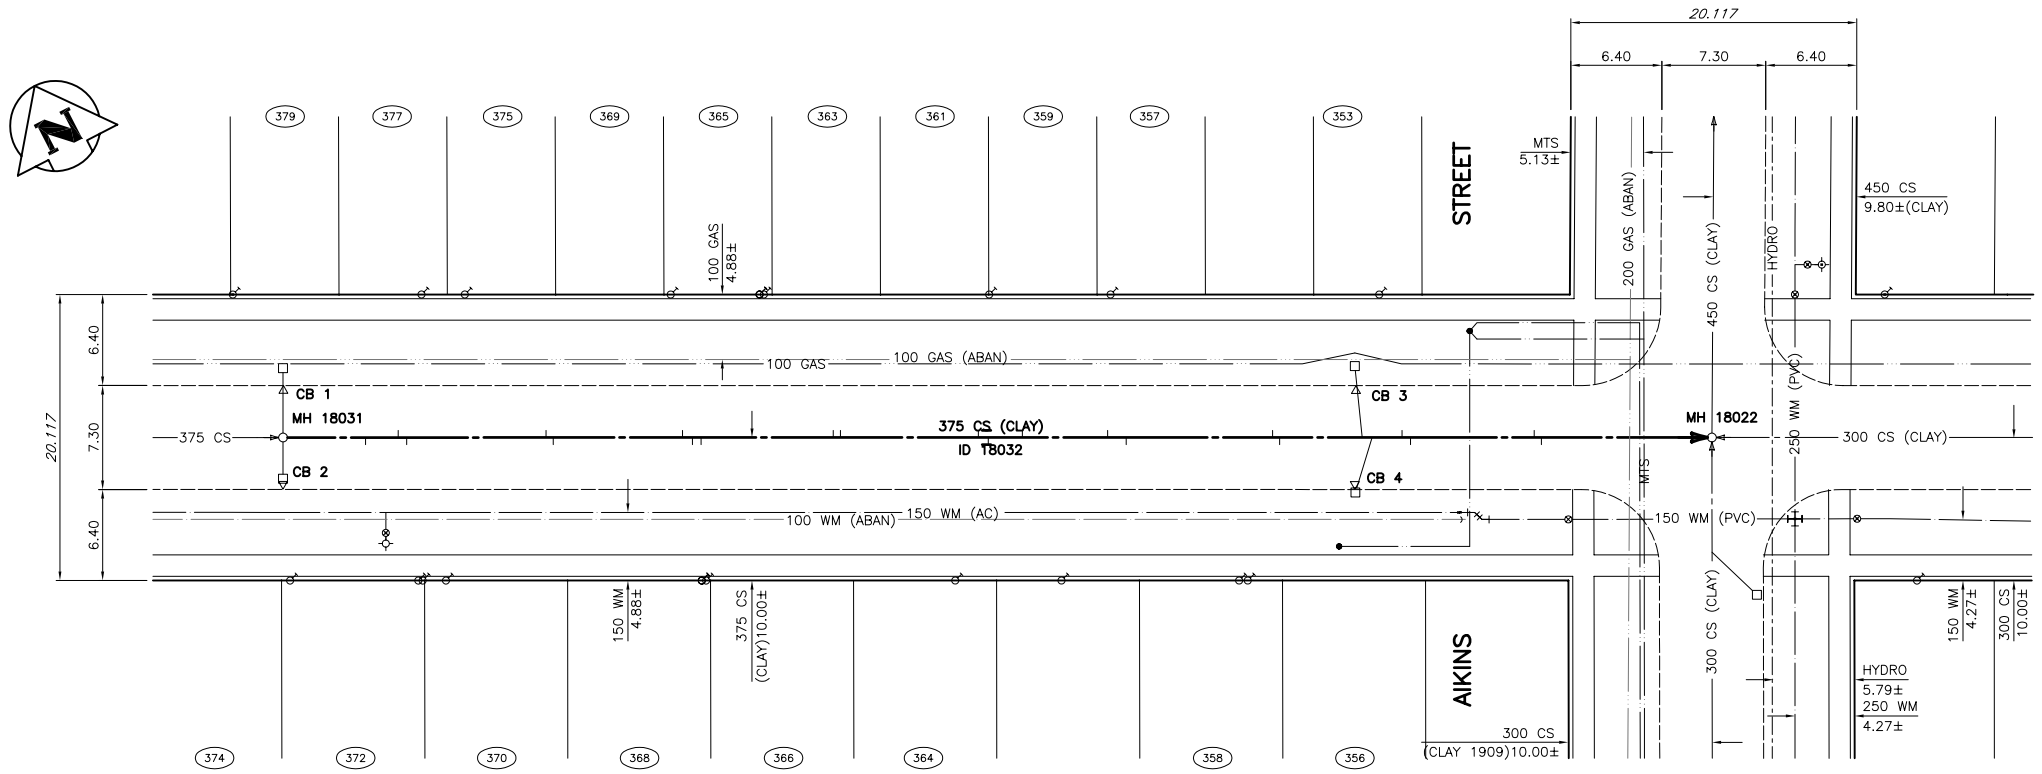

ABERDEEN AVENUE

NOTE:
CHAINAGE IS ALONG SOUTH PROPERTY LINE OF ABERDEEN AVENUE.

1:250 5 0 5 10m

SEWER CONNECTION DATA

ADDRESS	SIZE	PL INV	JUNCTION TIE	PROPERTY LINE TIE SHORT	PROPERTY LINE TIE LONG	REMARKS
			0 = MH AT AIKINS		0 = WPL AIKINS	
No. 347 ABERDEEN	150		UNKNOWN	UNKNOWN	11.3 E	
No. 350 ABERDEEN	150		UNKNOWN	UNKNOWN	11.9 E	
No. 351 ABERDEEN	150		SERVICED OFF AIKINS			
No. 260 AIKINS	150		UNKNOWN	UNKNOWN	UNKNOWN	
No. 353 ABERDEEN	150		21.5	UNKNOWN	13.7 W	
No. 356 ABERDEEN	150		30.2	UNKNOWN	20.1 W	
No. 357 ABERDEEN	150		UNKNOWN	UNKNOWN	UNKNOWN	
No. 358 ABERDEEN	150		30.2	UNKNOWN	20.1 W	
No. 359 ABERDEEN	150		41.0	UNKNOWN	38.4 W	
No. 362 ABERDEEN	150		42.2	UNKNOWN	UNKNOWN	
No. 361 ABERDEEN	150		41.0	UNKNOWN	38.4 W	
No. 363 ABERDEEN	150		62.2	UNKNOWN	UNKNOWN	
No. 364 ABERDEEN	150		UNKNOWN	UNKNOWN	42.4 W	
No. 365 ABERDEEN	150		62.2	UNKNOWN	UNKNOWN	
No. 366 ABERDEEN	150		UNKNOWN	UNKNOWN	UNKNOWN	
No. 368 ABERDEEN	150		71.6	UNKNOWN	60.3 W	
No. 369 ABERDEEN	150		82.0	UNKNOWN	68.3 W	
No. 370 ABERDEEN	150		91.7	UNKNOWN	81.4 W	
No. 372 ABERDEEN	150		91.7	UNKNOWN	81.4 W	
No. 374 ABERDEEN	150		UNKNOWN	UNKNOWN	UNKNOWN	
No. 375 ABERDEEN	150		UNKNOWN	UNKNOWN	78.7 W	
No. 377 ABERDEEN	150		UNKNOWN	UNKNOWN	78.7 W	
No. 379 ABERDEEN	150		UNKNOWN	UNKNOWN	93.6 W	

SEWER JUNCTION INFORMATION BY VIDEO INSPECTION

ABERDEEN AVENUE
1st MANHOLE EAST OF SALTER STREET TO MANHOLE AT AIKINS STREET

DISTANCE	SIZE	DIRECTION	CONDITION
5.9	150	SOUTH	CX
8.2	150	NORTH	JN
8.8	150	SOUTH	JN
18.6	150	NORTH	JX
19.1	150	SOUTH	JN
28.2	150	NORTH	JX
28.9	150	SOUTH	JN (CAP)
29.5	150	NORTH	CXJ
38.8	150	NORTH	JN
39.3	150	NORTH	JX
49.0	150	NORTH	JN
49.7	150	SOUTH	JN
52.1	150	NORTH	CXJ
58.1	150	SOUTH	JN
59.4	150	NORTH	JX
69.7	150	NORTH	JN
70.2	150	SOUTH	JN
76.0	150	NORTH	JN
76.7	150	SOUTH	JN
78.8	150	NORTH	JN
79.4	150	SOUTH	JN (CAP)
88.1	150	NORTH	JN (CAP)
88.6	150	SOUTH	JN (CAP)

MANHOLE INFORMATION

MANHOLE NUMBER	MANHOLE TYPE	RISER SIZE	ADDITIONAL INFORMATION
18031	CONCRETE	750 DIA	GROUT BASE. INSTALL 2 RUNGS. GROUT RISER.
18022	CONCRETE	750 DIA	GROUT BASE. REPLACE BENCHING GROUT RISER.

CATCHBASIN INFORMATION

CATCHBASIN NUMBER	ADDITIONAL INFORMATION
CB 1	REPLACE TOP 0.9 RISER. INSTALL HOOD. INSTALL 4 RUNGS.
CB 2	NO REPAIRS REQUIRED.
CB 3	REPLACE TOP 0.6 RISER. INSTALL 5 RUNGS.
CB 4	INSTALL HOOD.

APEGM
Certificate of Authorization
Wardrop Engineering Inc.
No. 195 Expiry: April 30, 2005

EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED
150 WM	WATERMAIN	150 WM		BEND		←	ANCHOR	
400 FM	FEEDERMAIN	400 FM		TEE			TREE	
300 LDS	LAND DRAINAGE SEWER	300 LDS		CURB STOP		15.240	LEGAL DIMENSION	
250 WWS	WASTEWATER SEWER	250 WWS	)	PLUG	)		SURVEY BAR	
300 CS	COMBINED SEWER	300 CS	○	MANHOLE	●		TRAFFIC SIGNAL	
200 FCM	FORCEMAIN	200 FCM	□	CATCHBASIN	■		GAS	
	JUNCTIONS		▽	CURB INLET	▼		HYDRO	
⊹	HYDRANT	✦	66	ADDRESS			MTS	
⊗	VALVE	⊗	•	HYDRO POLE			SIDEWALK	
	REDUCER			LIGHT STANDARD			CURB	

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES DATE
COMMITTEE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. CITY OF WINNIPEG 26-024
ELEV. 231.334m
F.B. 2031

NO.	REVISIONS	DATE	BY
–	ISSUED FOR TENDER	04.05.28	
–	ISSUED FOR APPROVAL	04.05.25	HAK

WARDROP | Engineering Inc.

DESIGNED BY	TY	CHECKED BY	
DRAWN BY	GMD	APPROVED BY	
HOR. SCALE:	1 : 250	RELEASED FOR CONSTRUCTION	
VERTICAL:	1 : 50		
DATE	04.05.12	DATE SIGNED BY K. ZUREK 04.05.28	

ORIGINAL DRAWING REVISION "0" SEALED BY H.A. KATZ 04.05.28

CONSULTANT DRAWING NO.
0400120200-DWG-C2002

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

2004 COMBINED SEWER RENEWALS
FULL LENGTH LINING BY CIPP METHODS

ABERDEEN AVENUE
1st MANHOLE EAST OF SALTER STREET
TO MANHOLE AT AIKINS STREET

CITY DRAWING NUMBER 05429
SHEET 2 OF 6
C2002