


INSTRUMENT LOOP DIAGRAM

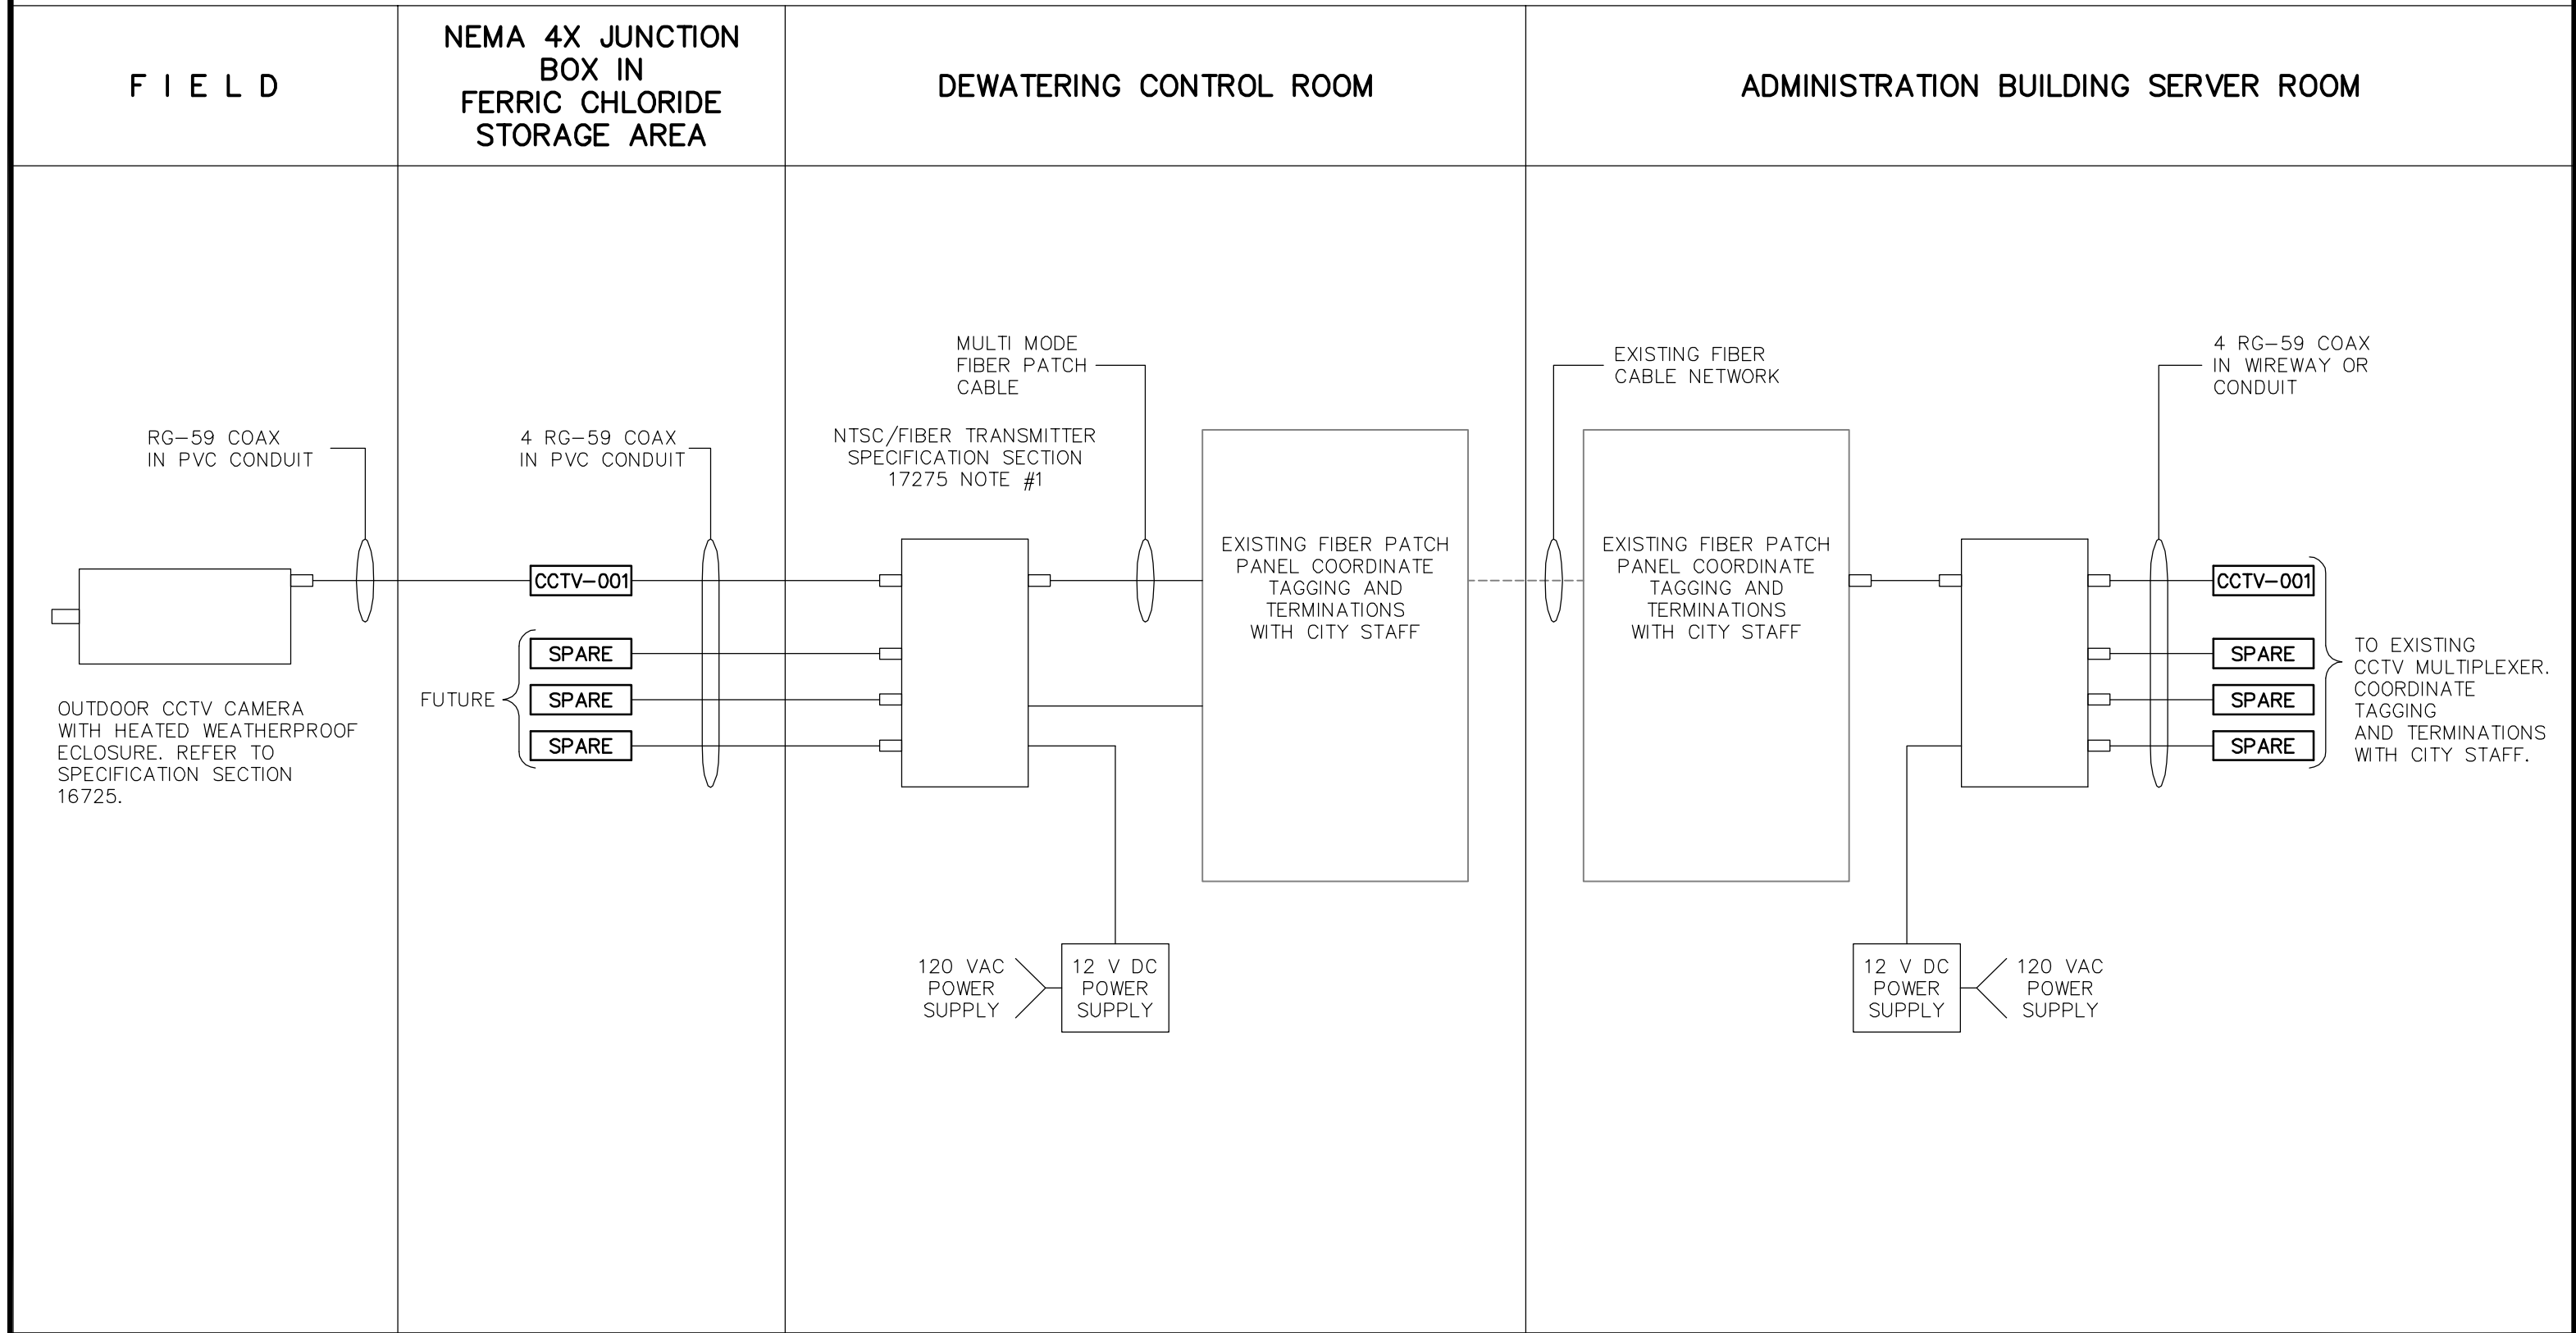

NOTE:
 1). CITY MAY BE ABLE TO ACCOMMODATE NEW NTSC/FIBER TRANSMITTER & RECEIVER IN EXISTING RACK OR PANEL, COORDINATE WITH CITY STAFF. OTHERWISE PROVIDE NEMA 1 JUNCTION BOXES FOR NTSC/FIBER CONVERTERS. C/W 12 VDC POWER SUPPLY AND 120 VAC POWER SUPPLY.

| | | |
|--|----------|------|
| | | |
| Earth Tech (Canada) Inc. Winnipeg, Manitoba 204.477.6381 | | |
| DATE | REVISION | APP. |

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
 NEWPCC - CENTRATE NUTRIENT TREATMENT
 PHOSPHORUS REMOVAL FACILITY

INSTRUMENT LOOP DIAGRAM
TYPICAL CCTV CAMERA

| | |
|-------------|----------|
| SCALE | AS NOTED |
| DATE | 05 10 27 |
| DES | DWN |
| CKD | APP |
| DRAWING NO. | |
| ILD-12 | |